

TECHNICAL GUIDE

XYE/XXE/XQE SERIES
3 - 10 TON
60 HERTZ



Table of Contents

Table of Contents	2
Component Location	3
Factory Installed Options	6
Field Installed Accessories	8
Nomenclature	9
AHRI Cooling Rating Table	12
AHRI 270 Outdoor Sound Power Levels	12
Physical Data	13
Capacity Performance	20
Airflow Performance	61
Power Exhaust Blower Curves	73
Electrical Data	74
Typical Wiring Diagrams	122
Weights and Dimensions	137
Economizer Options	146
Guide Specifications	149

Product Highlights


- Assembled in Norman, OK
- ASHRAE 90.1 Compliant
- R-410A Refrigerant
- Cooling Only configurations available
- Scroll Compressors
- Up to 15.0 SEER and 12.5 EER on the Energy Star Compliant Energy Level
- State of the art Microprocessor Controls with specific programming for unitary product applications
- Evaporator and Condenser Coils coils utilize copper tube/aluminum fin design for proven reliability and performance.
- TXV (Thermostatic Expansion Valve) standard on all models
- Single-stage Cooling (3 -6 ton models)
- Alternate Motor and Drives

Options and Accessories


- Economizers with Barometric Relief
- Louvered Hail Guards
- Non-fused Disconnect
- Power Exhaust
- Smoke Detectors
- Manual and Motorized Dampers
- Hinged Cabinet Doors
- Thru-The-Base Connections for power and control wiring.
- Field Installed Electric Heat Kits. Installation Instruction for the Electric Heat Kits may be found in the Electric Heat Kits.
- IntelliSpeed™ with Premium Efficiency indoor motors to meet ASHRAE 90.1-2010 requirements (6 - 10 ton XX and 7.5-8.5 ton XY models)

Component Location

Heat Pump (3 Through 10 Ton)

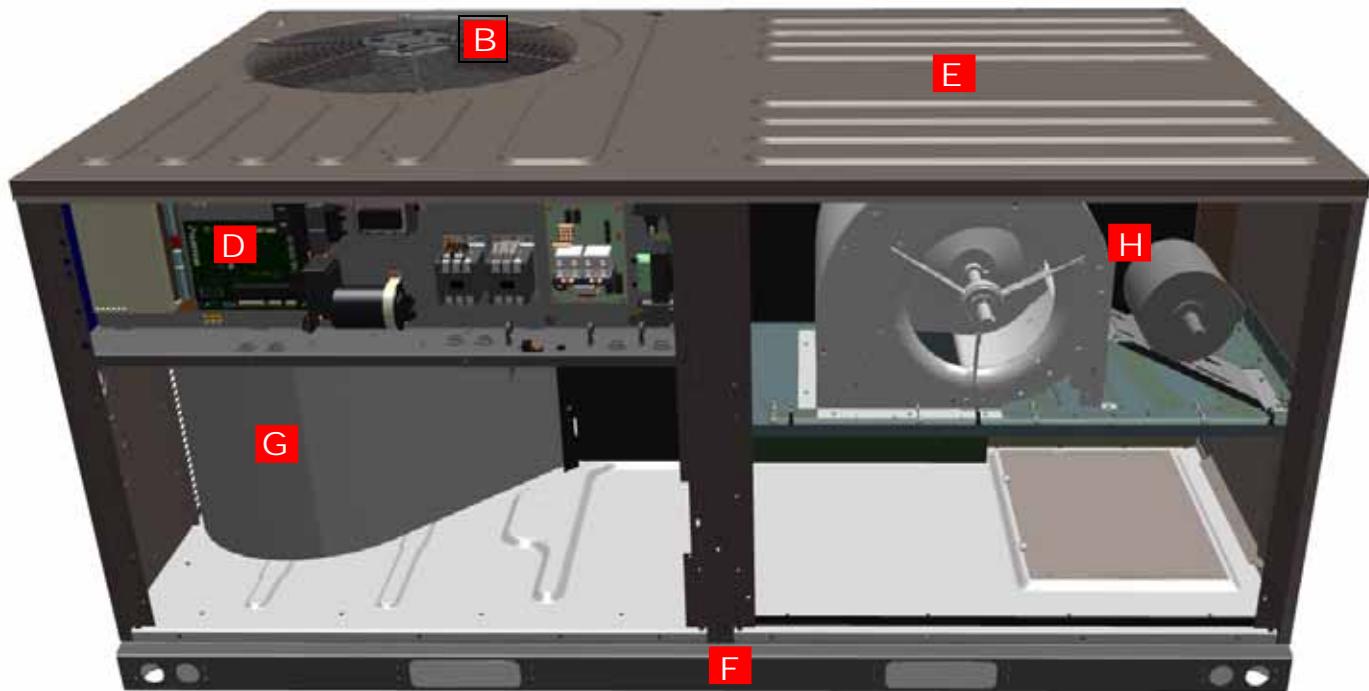

Click on the letters to see a description of the features.

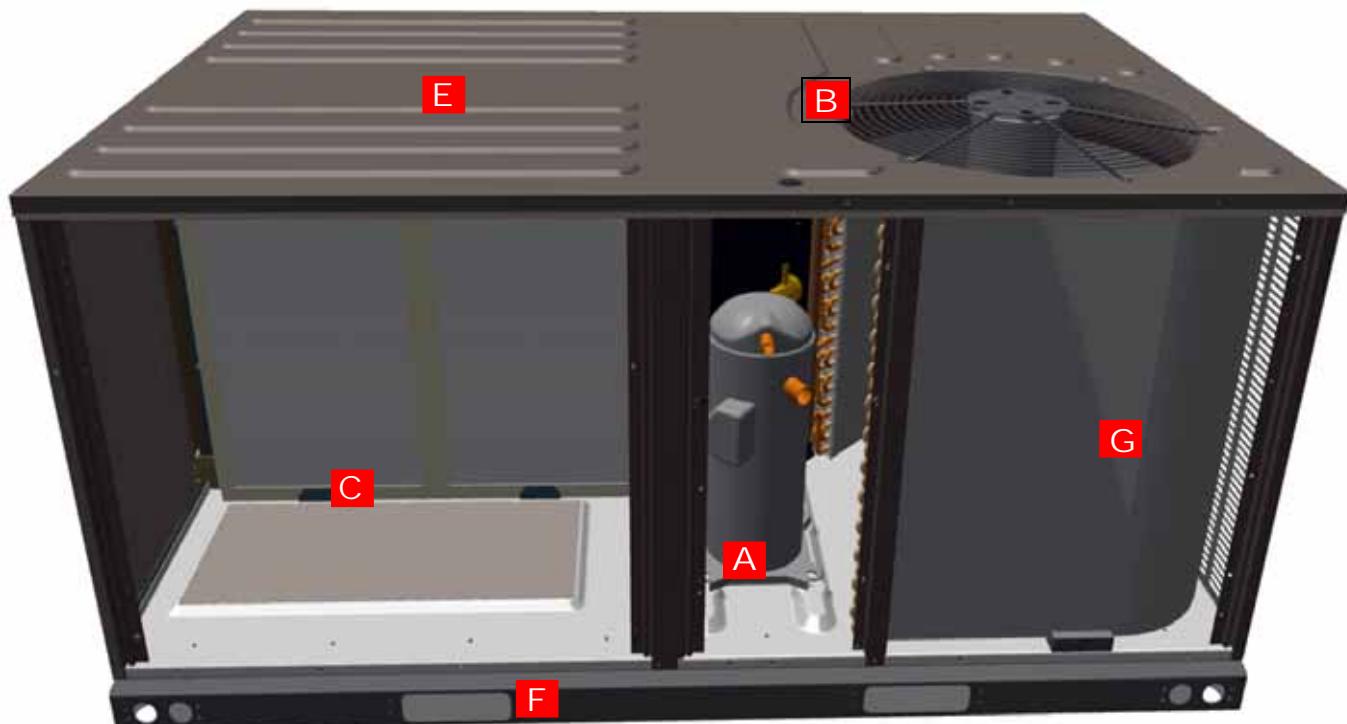

Features and Benefits

Standard and Mid-Efficiency Available - The Mid-efficiency meets the requirements for Energy Star that exceeds 15 SEER and 12 EER. These efficiencies meet or exceed all legislated minimum levels providing lower operating costs.




A All models utilize a scroll compressor that are environmentally friendly by utilizing R-410A refrigerant. Use of the scroll compressor technology means a simple internal design, fewer moving parts, equating to a quiet, reliable, easy to service and efficient system. Internal compressor protection is standard and compressors include protection to prevent liquid damage.

Total system design - A single circuit, single compressor design is used on the 3-5 ton units for cost effectiveness and reliability without compromising quality.


System Protection - Liquid line filter-driers, high and low pressure safeties are standard on each refrigerant circuit. Suction line sensors monitor temperature to prevent possible liquid flood back to the compressors and also protect against loss of charge and coil frosting.



B Balanced outdoor fan design makes for a quieter unit - The outdoor condenser fans are dynamically balanced for better performance and reliability. The direct drive fan design mounted to the fan grill allows for quick and easy service. Where other's components might fail at extreme temperatures UPG's units are tested and rated up to 125°F ambient cooling operation.

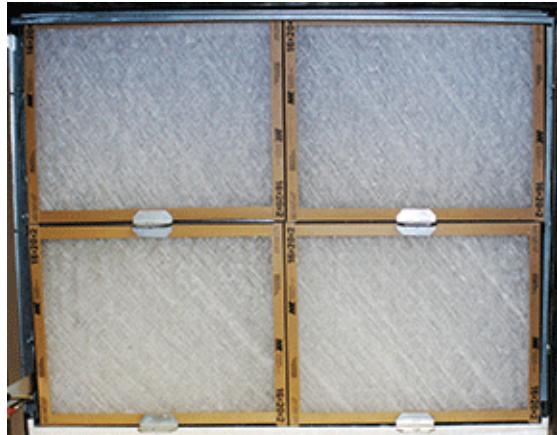

C Convertible Filter Rack - No tools required for easy field conversion of the filter rack to accommodate either 2" or 4" filters. Units will ship with MERV 4 throwaway filters standard; however MERV 8 and MERV 13 filters can be easily added through the tool-free filter access panel to meet LEED requirements. Refer to physical data tables for filter size details.

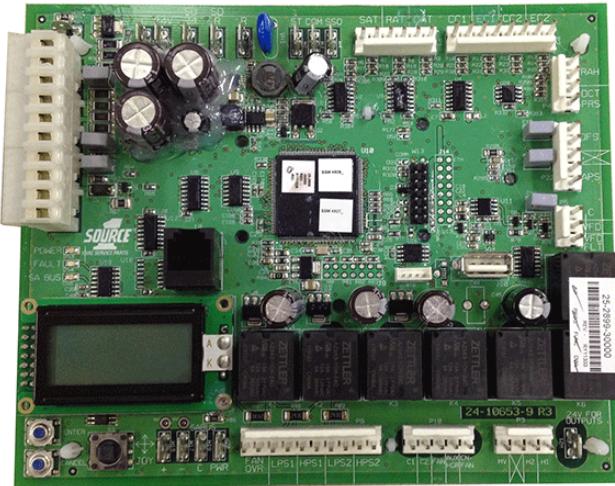

D Units will come with the new state of the art Smart Equipment™ control system. The new unit control incorporates the best of the already proven Smart Equipment™ unitary controls and creates a more robust, intelligent control. The goal of this control is to utilize cutting edge technology making the equipment easier to install, operate, and service. All units are Factory commissioned, configured, and run tested.

Versatile - The Smart Equipment™ control can be configured to use with a standard thermostat (easy to connect screw terminals), a zone sensor, or can be setup to communicate with multiple BAS communication protocols to integrate with building automation systems.

Reduce field installed complexity - Each unit comes equipped with factory installed supply air, return air, and outdoor air temperature sensors providing key temperature readings thus reduce field installed complexity.

On-board USB Port - The new control comes with a long list of features including data logging, current and previous system faults and software update capabilities using the on board USB port and common flash drive. Energy use monitoring capabilities allow custom tailoring to allow a system to work more efficiently at all times and occupancy levels. Self test and start-up reports also available from the board VIA the USB port.

Embedded LCD Display - The board has a easy to read, built-in LCD display and easy to use navigation joystick and buttons allowing the user to quickly navigate the menus displaying unit status, options, current function, supply, return and outdoor temperatures, fault codes and other information.

Safety Monitoring - The control monitors the outdoor, supply, and return air temperatures and the high and low pressure switch status on the independent refrigerant circuits. On units

with heating the high temperature limit switches are monitored on electric heating units. The control also monitors the voltage supplied to the unit and will protect the unit if low voltage due to a brown out, or other electrical issue occurs.

Low Ambient - An integrated low-ambient control allows units to operate in the cooling mode down to 40°F outdoor ambient without additional components or intervention. Optionally, the control board can be programmed to lockout the compressors when the outdoor air temperature is low or when free cooling is available.

Anti-Short Cycle Protection - To aid compressor life, an anti-short cycle delay is incorporated into the standard control. Compressor reliability is further ensured by programmable minimum run times. For testing, the anti-short cycle delay can be temporarily overridden with the push of a button.

Fan Delays - Fan on and fan off delays are fully programmable. Furthermore, the heating and cooling fan delay times are independent of one another. All units are programmed with default values based upon their configuration of cooling and/or heating capacity.

Nuisance Trip Protection and Three Strikes - To prevent nuisance calls, the control board uses a three times, you're out philosophy. The high, low-pressure switch, anti-freeze protection, low voltage or heating high limit must trip three times within two hours before the unit control board will lock out the associated compressor. The same safety must trip three times before a hard lockout will occur.



E Robust design - Each unit is designed with an embossed top to increase structural support and ensure rigidity. The unit has a powder paint exterior finish including a industry leading 1000 hour salt spray rating. All units are painted with a long lasting, powder paint that stands up over the life of the unit.



F Full Perimeter base rail that fits on many existing curbs - This product was designed with the replacement market in mind which is why it will fit on many existing curbs in the field but it also takes into account the new construction market by being versatile and sturdy. This unit is equipped with heavier gauge and innovatively designed base rails to prevent damage from transporting and rigging.



G Coils - All condenser coils utilize copper tube with aluminum fin design for proven reliability and performance.

All evaporator coils utilize copper tube with aluminum fin design for proven reliability and performance.



H Rigid Mounted Blower Assembly - Dynamically balanced indoor fans ensure better performance and reliability. Large

access panels for easier access, service, and maintenance. X13 Direct drive (Standard Static Option) and belt drive (Medium Static and High Static Options) options available on 3-10 ton products.

Warranty - All models include a 1-year limited warranty on the complete unit. Compressors carry a 5-year warranty.

Factory Installed Options

(Nomenclature Digit Position)

Airflow Options (8)

Alternate Indoor Blower Motor - For applications with high static restrictions, units are offered with optional indoor motors providing higher external static capability and/or higher airflow, depending upon the installer's needs.

- A=Standard Static (Direct Drive for 3-5 Ton, Belt Drive 6-10 Ton)
- B=Medium Static (Belt Drive for 3-10 Ton)
- C=High Static (Belt Drive for 3-10 Ton; 3 Phase Models Only)

VFD/VAV Options (9)

IntelliSpeed™ Supply Fan Control Option (ASHRAE 90.1 compliant, section 6.4.3.10) - Units configured with the IntelliSpeed™ Supply Fan Option will contain a VFD for variable volume supply fan operation. This option allows the supply fan RPM to vary based on the number of compressors or heating stages energized. The economizer's minimum position is also configurable.

- 1=None (Comes with standard constant volume controls)
- 3=VFD IntelliSpeed™

Coil Options (10)

E-Coat Coils – Coils are coated with an epoxy polymer coating to protect against corrosion. A 3-year warranty is added when this option is selected.

- A= Standard Indoor & Outdoor Coils (fin/tube design on indoor and outdoor coils with no E-Coat coating added).
- B= Standard Indoor Coil & E-Coat Coil Outdoor Coil (fin/tube design on indoor and outdoor coils. E-Coat coating added to outdoor coil)
- C= E-Coat Indoor Coil & Standard Outdoor Coil (fin/tube design on indoor and outdoor coils. E-Coat coating added to indoor coil)
- D= E-Coat Indoor Coil & Outdoor Coil (fin/tube design on indoor and outdoor coils. E-Coat coating added to indoor and outdoor coil)

<p>Controls (11)</p> <p>Smart Equipment™ - This is the Standard microprocessor control with capabilities to work with a sensor or thermostat only. Smart Equipment™ with BAS includes communication board with BACnet open-protocol system.</p> <p>FDD (Fault Detection and Diagnostics) - Refrigerant side factory installed control system option on the commercial equipment that constantly monitors refrigerant circuit pressures, refrigerant circuit temperatures, as well as the environmental temperatures and humidity via multiple sensor inputs. Provides a building owner, technician or contractor with the operational characteristics of the RTUs entire refrigerant circuit to ensure the unit is functioning at its specified performance level. Provides alarms if the unit is not functioning optimally. Remotely accessible via the Mobile Access Portal (MAP) gateway as well as scrolled on the UCB LCD screen.</p> <p>Verasys - Verasys provides a simple user experience with configurable self-recognizing controllers without the need for any additional tools. Verasys creates enhanced integration of HVACR equipment, zoning, and controls. Contractors are able to offer a complete bundled solution of equipment and controls to serve the light commercial market.</p> <ul style="list-style-type: none"> • A=Smart Equipment™ • B=Smart Equipment™ + BACnet MSTP, Mdb, N2 COM Card • C= Fault Detection Diagnostics (FDD) Refrigerant Side • J=Verasys Single Zone • K=Verasys Change Over Bypass • M=Verasys Single Zone W/FDD • N=Verasys Change Over Bypass W/FDD 	<p>Economizer/Damper (13)</p> <p>Down flow Economizers (with barometric relief) - All units offer a variety of optional factory installed economizers that are shipped, installed and wired with AMCA 511 Licensed Class 1A low leak dampers designed to exceed ASHRAE 90.1-2010 and the International Energy Conservation Code (IECC) certification requirements by achieving leakage rates of 3 cfm/sq. ft. at 1" of static pressure. Each economizer goes through a rigorous 60,000 cycle test. Dry bulb, single enthalpy, and dual enthalpy (with field installed kit) can be selected. All economizer options are fully integrated into the Smart Equipment™ controls. The economizer has spring return, fully modulating damper actuators and is capable of introducing up to 100% outdoor air. As the outdoor air intake dampers open, the return air dampers close. The changeover from mechanical refrigeration to economizer operation is regulated by the outdoor air dry bulb temperature or the outdoor air enthalpy input. The dual enthalpy kit provides a second input used to monitor the return air (field installed). The installer needs only to assemble the outdoor air hood, attach the enthalpy control the hood and mount the hood to the unit (Hood and control are provided).</p> <p>Dry Bulb Economizer - Economizer operation is enabled by the outdoor air temperature being less than the setpoint of the economizer module.</p> <p>Enthalpy Economizer - The added outdoor air enthalpy sensor enables economizer operation if the outdoor enthalpy is less than the setpoint of the economizer logic module.</p> <ul style="list-style-type: none"> • A=None • B=Dry Bulb Economizer • C=Enthalpy Economizer
<p>Sensor Options (12)</p> <ul style="list-style-type: none"> • 1=None (Units come standard with factory installed supply air, return air, and outdoor air temperature sensors) • 2=RA¹ Smoke Detector • 3=SA Smoke Detector • 4=RA¹ & SA Smoke Detector <p>1. Return Air Smoke Detector Sensor Must Be Relocated in the Field. (See Unit Installation Manual.)</p>	<p>Convenience Outlet (14)</p> <p>Convenience Outlet - (Powered and Non-Powered) - This option locates a 120V single-phase GFCI outlet with cover, on the corner of the unit housing adjacent to the compressors. The Non-powered option requires the installer to provide the 120V single-phase power source and wiring. Factory installed option only.</p> <ul style="list-style-type: none"> • 1=None • 2=Non-powered Convenience Outlet • 3=Powered Convenience Outlet

Electrical Options (15)

Disconnect Switch - For units with field installed electric heat kits, two factory installed disconnect sizes are available (60A or 100A non-fused disconnect). Depending on the field installed heater kit selected, the factory installed disconnect may not be sufficient. Always refer to the unit nameplate or unit electrical data for the proper disconnect size. If the heater application requires a disconnect above 100 Amps, the factory installed disconnect should be removed and an appropriately sized external disconnect should be installed.

- 1=None
- 2=Non-fused Disconnect¹

1. Verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat may exceed the factory installed disconnect amperage rating.

Cabinet Options (16)

Louvered Hail Guard - This kit includes a decorative louvered panel which installs over the outside condenser coil and prevents damage to the coil fins from hail strikes.

Hinged Cabinet Doors - The factory installed hinged panel option will save time, money and labor while allowing easy servicing of blower components, filters and controls. With this option there is no longer a need to remove panels to access these critical sections and running the risk of losing panels or roof damage from loose panels and materials. Extra care was taken to design a durable hinged panel with leak tight seal.

- 1=None
- 2=Louvered Panels
- 3=Hinged Cabinet Doors
- 4=Hinged Cabinet Doors And Louvered Panels

Field Installed Accessories


• Down flow Economizers/Horizontal Economizers (with barometric relief) - All units offer a variety of field installed economizers that are installed and wired with AMCA 511 Licensed Class 1A low leak dampers designed to exceed ASHRAE 90.1-2010 and the International Energy Conservation Code (IECC) certification requirements by achieving leakage rates of 3 cfm/sq. ft. at 1" of static pressure. Each economizer goes through a rigorous 60,000 cycle test. Dry bulb, single enthalpy, and dual enthalpy (with field installed kit) can be selected. All economizer options are fully integrated into the Smart Equipment™ controls. The economizer has spring return, fully modulating damper actuators and is capable of introducing up to 100% outdoor air. As the outdoor air intake dampers open, the return air dampers close. The changeover from mechanical refrigeration to economizer operation is regulated by the outdoor air dry bulb temperature or the outdoor air enthalpy input. The dual enthalpy kit provides a second input used to monitor the return air (field installed). The installer needs only to

assemble the outdoor air hood, attach the enthalpy control the hood and mount the hood to the unit (Hood and control are provided).

- **Dry Bulb Economizer** - Economizer operation is enabled by the outdoor air temperature being less than the setpoint of the economizer module.
- **Single Enthalpy Control, Accessory for Economizer** - All field installed economizers will come standard as a dry bulb economizer. This kit adds an outdoor air enthalpy sensor which enables economizer operation if the outdoor enthalpy is less than the setpoint of the economizer logic module.
- **Dual Enthalpy Control, Accessory for Economizer** - All field installed economizers will come standard as a dry bulb economizer. This kit adds an outdoor air enthalpy sensor and return air enthalpy sensor which enables economizer operation if the outdoor enthalpy is less than the setpoint of the economizer logic module.
- **Power Exhaust** - This accessory installs in the unit with a down flow economizer or in the ductwork for a horizontal application.
- **Louvered Hail Guard** - This kit includes a decorative louvered panel which installs over the outside condenser coil and prevents damage to the coil fins from hail strikes.
- **Roof Curbs** - The roof curbs have insulated decks and are shipped disassembled. The roof curbs are available in 14" and 24" heights.
- **Thermostat** - The units are designed to operate with 24-volt electronic and electro-mechanical thermostats.
- **Smoke Detectors** - The smoke detectors stop operation of the unit by interrupting power and providing a fault message to the control board if smoke is detected within the air compartment. Smoke detectors are available for both the supply and/or return air configurations.
- **Hinged Filter Access Panel For Use With Horizontal Flow Economizer** - Allows hinged access to the filter section when used with a horizontal economizer.
- **Low Ambient Head Pressure Control Kit** - The Electronic Low Ambient Controller is designed to regulate condenser head pressure at low ambient temperatures by varying the amount of airflow through the condenser.
- **Manual Outdoor Air Damper** - Like the motorized outdoor air damper, each manual outdoor air damper includes a slide-in damper assembly with an outdoor air hood and filters. Customers have a choice of dampers with ranges of 0% to 100% or 0% to 35% outdoor air entry.
- **Thru The Base Connection** - Kits are available to provide a way to route wiring to the unit through the base of the unit and through the base or through the curb. These kits provide a seal tight way to bring power to the unit without additional roof penetrations.
- **Electric Heat (Field installed option Only)** - Select heater sizes for 3-10 ton units available. Necessary hardware and connectors are included with the heaters.

Nomenclature

3-10 Ton Model Number Nomenclature

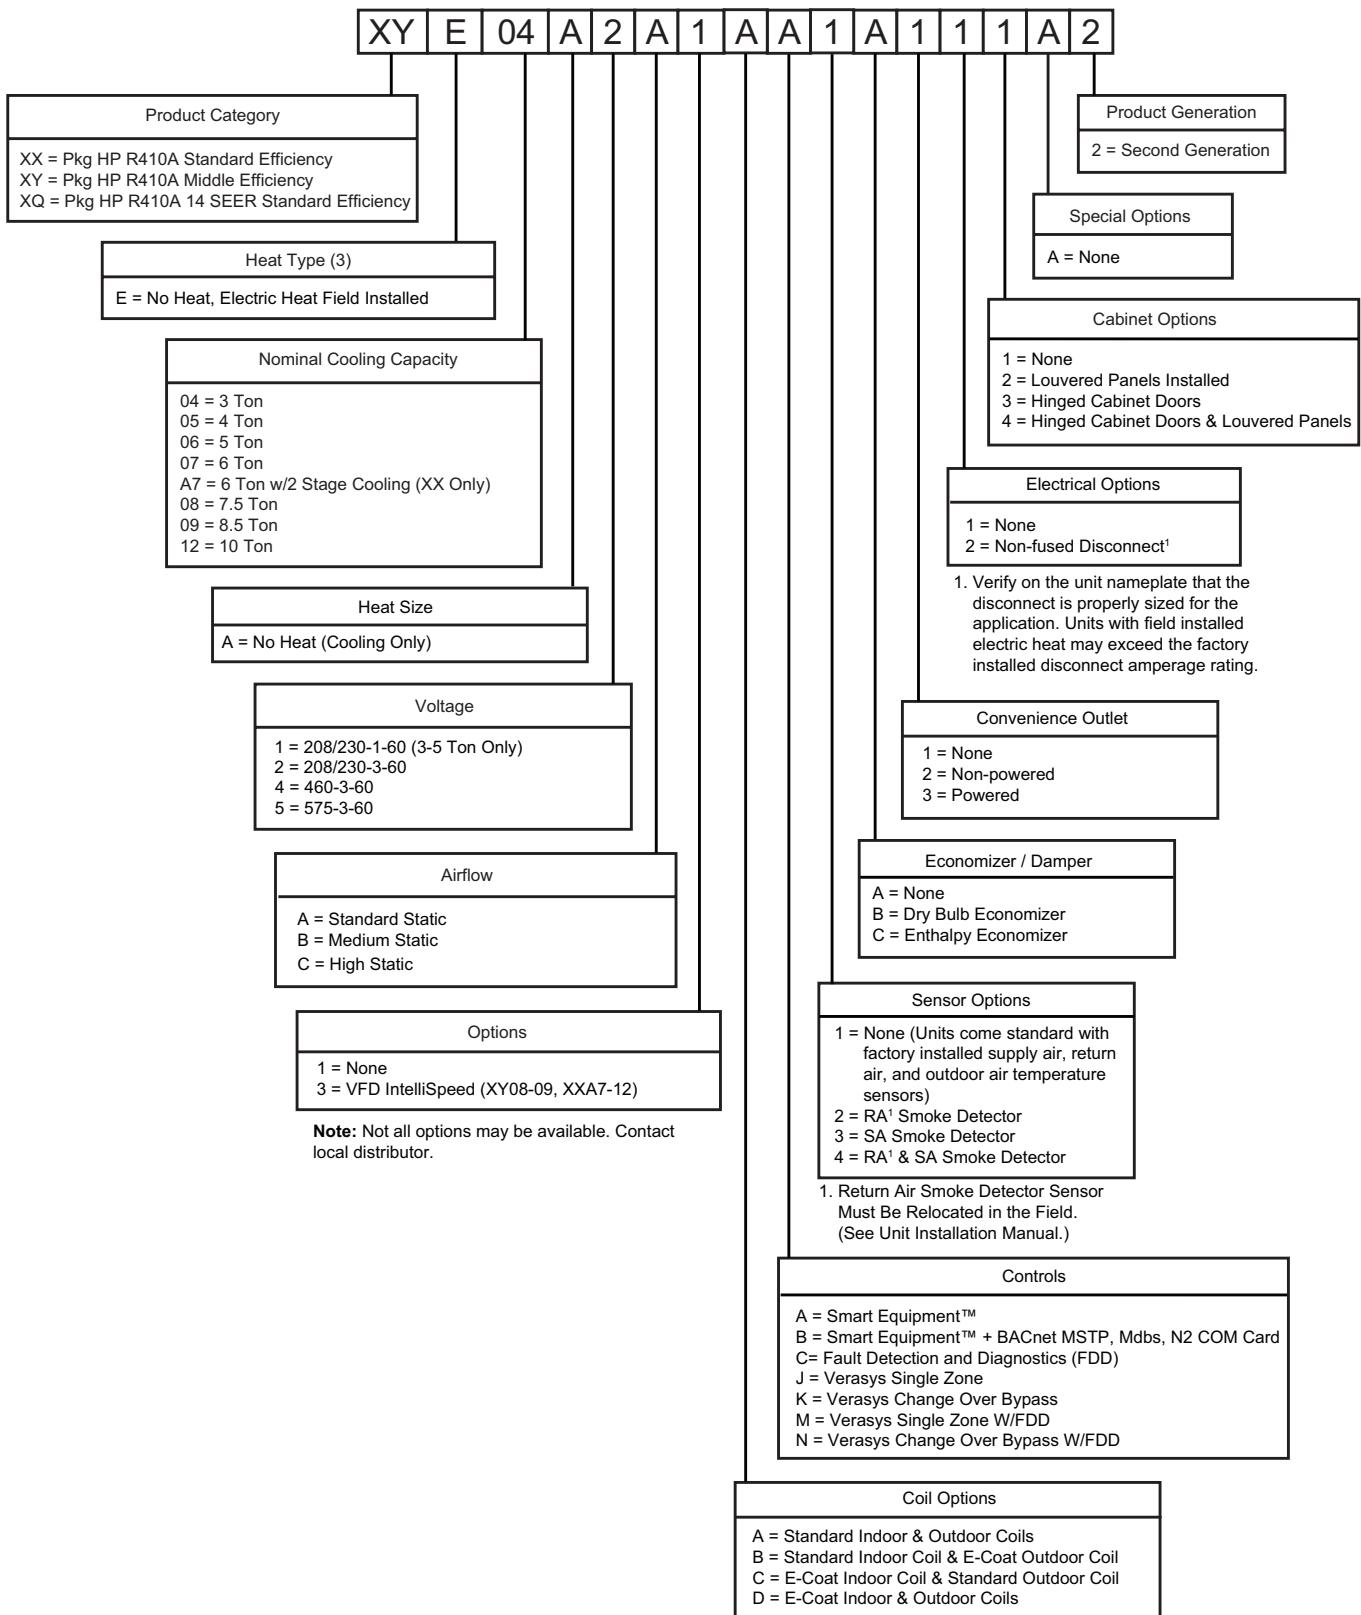

XYE04-09,XXEA7, XXE08-09, XXE12, XQE04-06 Accessories

Accessory Kit Number	Description	Where Used	Voltage
2EE04706724	Econ, DB, Vertical Flow, Small Footprint	XYE04, XYE05, XYE06, XQE04, XQE05, XQE06, XXEA7	All
2EE04706824	Econ, DB, Vertical Flow, Large Footprint	XYE07, XYE08, XYE09, XXE08, XXE09, XXE12	All
2EE04707024	Econ, DB, Horizontal Flow, Small Footprint, Short Cabinet	XYE04, XQE04	All
2EE04707124	Econ, DB, Horizontal Flow, Small Footprint, Tall Cabinet	XYE05, XYE06, XQE05, XQE06, XXEA7	All
2EE04707224	Econ, DB, Horizontal Flow, Large Footprint, Short Cabinet	XYE07	All
2EE04707324	Econ, DB, Horizontal Flow, Large Footprint, Tall Cabinet	XYE08, XYE09, XXE08, XXE09, XXE12	All
1FA0415	Manual Outside Air Damper 0-35%	XYE04, XYE05, XYE06, XQE04, XQE05, XQE06, XXEA7	All
1FA0416	Manual Outside Air Damper 0-35%	XYE07, XYE08, XYE09, XXE08, XXE09, XXE12	All
1FA0417	Manual Outside Air Damper 0-100%	XYE04, XYE05, XYE06, XQE04, XQE05, XQE06, XXEA7	All
1FA0418	Manual Outside Air Damper 0-100%	XYE07, XYE08, XYE09, XXE08, XXE09, XXE12	All
2MD04704224	Motorized Outside Air Damper 0-100%	XYE04, XYE05, XYE06, XQE04, XQE05, XQE06, XXEA7	All
2MD04704324	Motorized Outside Air Damper 0-100%	XYE07, XYE08, XYE09, XXE08, XXE09, XXE12	All
2EC0401	Kit, Single Enthalpy Field Installed	All	All
2EC0402	Kit, Dual Enthalpy Field Installed	All	All
1HD0401	Hinged Filter Access Panel For Units With A Horizontal Economizer	XYE04, XQE04	All
1HD0402	Hinged Filter Access Panel For Units With A Horizontal Economizer	XYE05, XYE06, XQE05, XQE06, XXEA7	All
1HD0403	Hinged Filter Access Panel For Units With A Horizontal Economizer	XYE07	All
1HD0404	Hinged Filter Access Panel For Units With A Horizontal Economizer	XYE08, XYE09, XXE08, XXE09, XXE12	All
1HG0419	Hail Guard Kit Small Footprint, Short Cabinet	XYE04, XQE04	All
1HG0420	Hail Guard Kit Small Footprint, Tall Cabinet	XYE05, XYE06, XQE05, XQE06, XXEA7	All
1RC0456	Curb Rigid 14" Small Footprint	XYE04, XYE05, XYE06, XQE04, XQE05, XQE06, XXEA7	All
1RC0457	Curb Rigid 14" Large Footprint	XYE07, XYE08, XYE09, XXE08, XXE09, XXE12	All
1RC0458	Curb Rigid 24" Small Footprint	XYE04, XYE05, XYE06, XQE04, XQE05, XQE06, XXEA7	All
1RC0459	Curb Rigid 24" Large Footprint	XYE07, XYE08, XYE09, XXE08, XXE09, XXE12	All
2PE04704206	Power Exhaust Vert Flow Small Footprint 208V-230V 1-ph	XYE04, XYE05, XYE06, XQE04, XQE05, XQE06, XXEA7	208/230-1-60
2PE04704225	Power Exhaust Vert Flow Small Footprint 208V-230V 3-ph	XYE04, XYE05, XYE06, XQE04, XQE05, XQE06, XXEA7	208/230-3-60
2PE04704246	Power Exhaust Vert Flow Small Footprint 460V 3-ph	XYE04, XYE05, XYE06, XQE04, XQE05, XQE06, XXEA7	460-3-60
2PE04704258	Power Exhaust Vert Flow Small Footprint 575V 3-ph	XYE04, XYE05, XYE06, XQE04, XQE05, XQE06, XXEA7	575-3-60
2PE04704325	Power Exhaust Vert Flow Large Footprint 208V-230V 3-ph	XYE07, XYE08, XYE09, XXE08, XXE09, XXE12	208/230-3-60
2PE04704346	Power Exhaust Vert Flow Large Footprint 460V 3-ph	XYE07, XYE08, XYE09, XXE08, XXE09, XXE12	460-3-60
2PE04704358	Power Exhaust Vert Flow Large Footprint 575V 3-ph	XYE07, XYE08, XYE09, XXE08, XXE09, XXE12	575-3-60
2PE04704406	Power Exhaust Horiz Flow Small Footprint 208V-230V 1-ph	XYE04, XYE05, XYE06, XQE04, XQE05, XQE06, XXEA7	208/230-1-60
2PE04704425	Power Exhaust Horiz Flow Small Footprint 208V-230V 3-ph	XYE04, XYE05, XYE06, XQE04, XQE05, XQE06, XXEA7	208/230-3-60
2PE04704446	Power Exhaust Horiz Flow Small Footprint 460V 3-ph	XYE04, XYE05, XYE06, XQE04, XQE05, XQE06, XXEA7	460-3-60
2PE04704458	Power Exhaust Horiz Flow Small Footprint 575V 3-ph	XYE04, XYE05, XYE06, XQE04, XQE05, XQE06, XXEA7	575-3-60
2PE04704525	Power Exhaust Horiz Flow Large Footprint 208V-230V 3-ph	XYE07, XYE08, XYE09, XXE08, XXE09, XXE12	208/230-3-60
2PE04704546	Power Exhaust Horiz Flow Large Footprint 460V 3-ph	XYE07, XYE08, XYE09, XXE08, XXE09, XXE12	460-3-60

XYE04-09, XXEA7, XYE08-09, XXE12, XQE04-06 Accessories (Continued)

Accessory Kit Number	Description	Where Used	Voltage
2PE04704558	Power Exhaust Horiz Flow Large Footprint 575V 3-ph	XYE07, XYE08, XYE09, XXE08, XXE09, XXE12	575-3-60
2EK04510625	6.5 KW Electric Heat	XYE04, XYE05, XYE06, XQE04, XQE05, XQE06, XXEA7	208/230-3-60
2EK04510646	6.0 KW Electric Heat	XYE04, XYE05, XYE06, XQE04, XQE05, XQE06, XXEA7	480-3-60
2EK04511058	9.2 KW Electric Heat	XYE04, XYE05, XQE04, XQE05	575-3-60
2EK04511125	10.5 KW Electric Heat	XYE04, XYE05, XYE06, XQE04, XQE05, XQE06, XXEA7	208/230-(1 or 3)-60
2EK04511625	16 KW Electric Heat	XYE04, XYE05, XYE06, XQE04, XQE05, XQE06, XXEA7	208/230-3-60
2EK04511146	11.5 KW Electric Heat	XYE04, XYE05, XYE06, XQE04, XQE05, XQE06, XXEA7	480-3-60
2EK04511458	13.8 KW Electric Heat	XYE04, XYE05, XYE06, XQE04, XQE05, XQE06, XXEA7	575-3-60
2EK04511446	14 KW Electric Heat	XYE04, XYE05, XYE06, XQE04, XQE05, XQE06, XXEA7	480-3-60
2EK04510725	6.0 KW Electric Heat	XYE07	208/230-3-60
2EK04510746	6.0 KW Electric Heat	XYE07	460-3-60
2EK04511725	16 KW Electric Heat	XYE07, XYE08, XYE09, XXE08, XXE09, XXE12	208/230-3-60
2EK04511746	16.5 KW Electric Heat	XYE07, XYE08, XYE09, XXE08, XXE09, XXE12	460-3-60
2EK04511758	17 KW Electric Heat	XYE07, XYE08, XYE09, XXE08, XXE09, XXE12	575-3-60
2EK04512358	23 KW Electric Heat	XYE06, XQE06, XXEA7	575-3-60
2EK04512525	24.8 KW Electric Heat	XYE07, XYE08, XYE09, XXE08, XXE09, XXE12	208/230-3-60
2EK04512646	25.5 KW Electric Heat	XYE07	460-3-60
2EK04512658	25.7 KW Electric Heat	XYE07	575-3-60
2EK04512846	27.8 KW Electric Heat	XYE07, XYE08, XYE09, XXE08, XXE09, XXE12	460-3-60
2EK04513225	32 KW Electric Heat	XYE07, XYE08, XYE09, XXE08, XXE09, XXE12	208/230-3-60
2EK04513346	33 KW Electric Heat	XYE07, XYE08, XYE09, XXE08, XXE09, XXE12	460-3-60
2EK04513458	34 KW Electric Heat	XYE07, XYE08, XYE09, XXE08, XXE09, XXE12	575-3-60
2EK04514225	42.4 KW Electric Heat	XYE07, XYE08, XYE09, XXE08, XXE09, XXE12	208/230-3-60
2EK04514246	41.7 KW Electric Heat	XYE07, XYE08, XYE09, XXE08, XXE09, XXE12	460-3-60
2SD04701224	Supply Air Stream Smoke Detector	XYE04, XYE05, XYE06, XYE07, XYE08, XYE09, XXE12, XQE04, XQE05, XQE06	All
2SD04701124	Return Air Stream Smoke Detector	XYE04, XYE05, XYE06, XQE04, XQE05, XQE06 XXEA7	All
2SD04701424	Return Air Stream Smoke Detector	XYE07, XYE08, XYE09, XXE08, XXE09, XXE12	All
2SD04701324	Combination Supply & Return Air Stream Smoke Detector	XYE04, XYE05, XYE06, XQE04, XQE05, XQE06, XXEA7	All
2SD04701624	Combination Supply & Return Air Stream Smoke Detector	XYE07, XYE08, XYE09, XXE08, XXE09, XXE12	All
2FDD61	Field Installed Refrigeration-side FDD accessory for use with SE Controls	XY04, XY05, XY06, XY07, XQ04, XQ05, XQ06, XXEA7	All
2FDD62	Field Installed Refrigeration-side FDD accessory for use with SE Controls	XY08, XY09, XX08, XX09, XX12	All
1TB0403	Small Footprint Thru The Base Electrical	XYE04, XYE05, XYE06, XQE04, XQE05, XQE06, XXEA7	All
1TB0404	Large Footprint Thru The Base Electrical & Gas	XYE07, XYE08, XYE09, XX08, XX09, XXE12	All
1BD0409	Burglar Bar Kit	XYE04, XYE05, XYE06, XQE04, XQE05, XQE06, XXEA7	All
1BD0410	Burglar Bar Kit	XYE07, XYE08, XYE09, XX08, XX09, XXE12	All

AHRI Cooling Rating Table

UNIT	COOLING STAGES	NOM. COOLING CAPACITY (TONS)	NET COOLING CAPACITY (MBH)	17F Heating Capacity (MBH)	47F High Heating Capacity (MBH)	TOTAL POWER (kW)	SEER	HSPF	EER	IEER	IEER IntelliSpeed
XYE04	1	3	36.4	18.4	34.0	2.9	15.0	8.0	12.5	---	---
XYE05	1	4	47.0	26.0	46.0	3.8	15.0	8.2	12.5	---	---
XYE06	1	5	58.5	30.0	55.0	4.7	15.0	8.2	12.5	---	---
XYE07	1	6	71.0	39.0	69.5	5.9	N/A	N/A	12.0	13.2	---
XYE08	2	7.5	88.0	47.0	84.0	7.3	N/A	N/A	12.1	14.0	16.0
XYE09	2	8.5	98.0	54.5	96.5	8.2	N/A	N/A	12.0	13.8	15.8
XXEA7	2	6	66.7	35.0	64.4	6.1	N/A	N/A	11.0	12.7	13.2
XXE08	2	7.5	90.0	49.0	84.0	8.4	N/A	N/A	11.5	13.3	15.1
XXE09	2	8.5	102.0	57.0	94.0	8.8	N/A	N/A	11.8	13.1	14.4
XXE12	2	10	116.0	62.0	108.8	10.2	N/A	N/A	11.0	N/A	13.4
XQE04	1	3	35.6	18.5	34.2	2.9	14	8.1	12.1	---	---
XQE05	1	4	48	26.4	46.7	3.9	14.5	8	12.25	---	---
XQE06	1	5	57.4	30.6	54.5	4.7	14.5	8.25	12.25	---	---

AHRI 270 Outdoor Sound Power Levels

Unit (Tons)	Sound Rating ¹ (dB-A)	Octave Bands (Hz)							
		63	125	250	500	1000	2000	4000	8000
XYE04 (3)	79	81.5	84.5	76.5	75.0	74.0	69.5	65.5	61.0
XYE05 (4)	79	82.0	85.0	77.5	75.5	74.0	70.0	66.5	62.0
XYE06 (5)	80	83.0	85.0	77.0	75.5	75.0	70.0	66.0	62.0
XYE07 (6)	82.73	88.0	87.0	81.5	80.5	78.0	73.0	68.5	61.5
XYE08 (7.5)	88.86	93.5	82.5	83.0	84.5	85.5	81.5	75.5	70.0
XYE09 (8.5)	86.25	92.0	82.5	83.5	83.5	81.5	76.5	71.5	66.0
XXEA7 (6)	77.48	85.0	83.5	78.0	74.0	72.5	67.5	64.5	60.5
XXE08 (7.5)	83.16	86.5	85.5	81.0	80.0	79.0	74.5	70.5	66.00
XXE09 (8.5)	87.59	87.5	85.0	82.5	81.5	80.0	80.5	74.0	67.5
XXE12 (10)	85.76	97.5	83.5	84.5	82.5	80.5	76.5	75.0	70.0
XQE04 (03)	78.41	79.5	80.5	79.0	75.5	73.5	68.5	64.5	61.5
XQE05 (04)	78.41	79.5	80.5	79	75.5	73.5	68.5	64.5	61.5
XQE06 (05)	77.78	83.5	83.5	76.0	74.0	73.0	68.5	66.5	60.0

1. Rated in accordance with AHRI 270 standard.

Physical Data

XYE04 thru 09

Component	Models					
	XYE04	XYE05	XYE06	XYE07	XYE08	XYE09
Nominal Tonnage	3	4	5	6	7.5	8.5
AHRI COOLING PERFORMANCE						
Gross Capacity @ AHRI A point (Btu)	37,300	48,600	60,000	73,000	90,500	101,000
AHRI net capacity (MBH)	36,400	47,000	58,500	71,000	88,000	98,000
EER	12.5	12.5	12.5	12.0	12.1	12.0
SEER	15.0	15.0	15.0	-	-	-
IEER	-	-	-	13.2	14.0	13.8
IEER IntelliSpeed	-	-	-	-	16.0	15.8
CFM	1,250	1,490	1,682	2,440	2,850	3,000
System power (KW)	2.9	3.8	4.7	5.9	7.3	8.2
Refrigerant type	R410A	R410A	R410A	R410A	R410A	R410A
Refrigerant charge (lb-oz)						
System 1	12-0	14-0	16-0	19.25	14.38	14.50
System 2	-	-	-	-	14.25	14.63
ARI HEATING PERFORMANCE						
47°F capacity rating (MBH)	34,000	46,000	55,000	69,000	84,000	96,500
System power (KW) / COP	3.0 / 3.3	3.8 / 3.6	4.4 / 3.6	6.0 / 3.4	7.0 / 3.5	8.3 / 3.4
17°F capacity rating (MBH)	18,400	26,000	30,000	39,000	47,000	54,500
System power (KW) / COP	2.7 / 2.0	3.3 / 2.3	3.9 / 2.3	4.8 / 2.4	5.7 / 2.4	7.1 / 2.26
HSPF (Btu/Watts-hr)	8.0	8.2	8.2	-	-	-
DIMENSIONS (inches)						
Length	74.1	74.1	74.1	87.2	87.2	87.2
Width	48.9	48.9	48.9	61.7	61.7	61.7
Height	32.5	40.6	40.6	40.6	55.3	55.3
OPERATING WT. (lbs.)	535	614	653	861	1,060	1,061
COMPRESSORS						
Type	SCROLL	SCROLL	SCROLL	SCROLL	SCROLL	SCROLL
Quantity	1	1	1	1	2	2
Unit Capacity Steps (%)	-	-	-	100	50/100	50/100
OUTDOOR COIL DATA						
Face area (Sq. Ft.)	15.1	19.4	19.4	21.0	25.6	25.6
Rows	2	2	2	3	3	3
Fins per inch	17	17	17	13	17	17
Tube diameter	0.375	0.375	0.375	0.375	0.375	0.375
Circuitry Type	Split-face	Split-face	Split-face	Intertwined	Intertwined	Intertwined
Refrigerant control	TXV	TXV	TXV	TXV	TXV	TXV
INDOOR COIL DATA						
Face area (Sq. Ft.)	5.5	7.3	7.3	8.9	11.1	11.1
Rows	3	3	4	4	4	4
Fins per inch	15	15	15	15	15	15
Tube diameter	0.375	0.375	0.375	0.375	0.375	0.375
Circuitry Type	Intertwined	Intertwined	Intertwined	Intertwined	Intertwined	Intertwined
Refrigerant control	TXV	TXV	TXV	TXV	TXV	TXV
OUTDOOR FAN DATA						
Quantity	1	1	1	2	1	1
Fan diameter (Inch)	22	22	22	22	30	30
Type	Prop	Prop	Prop	Prop	Prop	Prop
Drive type	DIRECT DRIVE					
No. speeds	1	1	1	1	1	1
Number of motors	1	1	1	2	1	1

XYE04 thru 09 (Continued)

Component	Models											
	XYE04		XYE05		XYE06		XYE07			XYE08		
Nominal Tonnage	3		4		5		6			7.5		
Motor HP each	1/2		1/2		1/2		1/2			1 1/2		
RPM	1100		1100		1100		1100			1140		
Total CFM	3600		4000		4300		7600			9700		
BELT DRIVE INDOOR FAN DATA												
Airflow Option	B	C	B	C	B	C	A	B	C	A	B	C
Quantity	1		1		1		1			1		
Fan diameter (Inch)	10 x 10		10 x 10		11 x 10		15 x 15			15 x 15		
Type	Centrifugal		Centrifugal		Centrifugal		Centrifugal			Centrifugal		
Motor Sheave	1VL34	1VL44	1VL34	1VL44	1VL34	1VL44	1VL34	1VL44	1VP50	1VL34	1VL44	1VP50
Blower Sheave	AK46	AK46	AK46	AK46	AK46	AK46	AK74	AK74	AK74	AK74	AK74	AK74
Belt	A39	A40	A39	A40	A37	A39	A47	A48	A48	A47	A48	A50
Motor Max HP, 1 Phase	1.5	-	1.5	-	1.5	-	-	-	-	-	-	-
Motor Max BHP, 3 Phase	2.4	2.4	2.4	2.4	2.4	2.9	2.4	2.9	3.7	2.4	2.4	3.7
RPM	1725		1725		1750		1725	1725	1725	1725	1725	1725
Frame size	56Y		56Y		56HZ		56Y	56Y	56HZ	56Y	56Y	65HZ
DIRECT DRIVE INDOOR FAN DATA												
Air Flow Option	A		A		A		-			-		
Quantity	1		1		1		-			-		
Fan Size (Inch)	10 x 10		10 x 10		11 x 10		-			-		
Type	Centrifugal		Centrifugal		Centrifugal		-			-		
Motor HP each	3/4		1		1		-			-		
RPM	1050		1050		1050		-			-		
FILTERS												
Quantity - Size	2 - (16 x 25 x 2) ¹		4 - (16 x 16 x 2) ¹		4 - (16 x 16 x 2) ¹		4 - (16 x 20 x 2) ¹			4 - (20 x 20 x 2) ¹		

1. 2-inch Throwaway, Standard, MERV 4 (Minimum Efficiency Reporting Value)

XXEA7, XXE08-09, XXE12

Component	Models			
	XXEA7	XXE08	XXE09	XXE12
Nominal Tonnage	6	7.5	8.5	10
AHRI COOLING PERFORMANCE				
Gross Capacity @ AHRI A point (Btu)	68,500	93,000	105,000	119,000
AHRI net capacity (MBH)	66,700	90,000	102,000	116,000
EER	11.0	11.5	11.8	11.0
SEER	-	-	-	-
IEER	12.7	13.3	13.1	-
IEER IntelliSpeed	14.8	15.1	14.4	13.4
Nominal CFM	2,000	3,300	3,400	3,830
System power (KW)	6.1	8.4	8.8	10.5
Refrigerant type	R410A	R410A	R410A	R410A
Refrigerant charge (lb-oz)				
System 1	15.75	12.00	14.00	13.50
System 2	-	12.00	14.00	13.50
ARI HEATING PERFORMANCE				
47°F capacity rating (MBH)	64,400	84,000	94,000	108,500
System power (KW) / COP	5.3 / 3.5	7.0 / 3.5	8.3 / 3.35	9.4 / 3.30
17°F capacity rating (MBH)	35,000	49,000	57,000	62,000
System power (KW) / COP	4.7 / 2.3	6.4 / 2.25	7.5 / 2.25	3.0 / 2.25
HSPF (Btu/Watts-hr)	-	-	-	-
DIMENSIONS (inches)				
Length	74.1	87.2	87.2	87.2
Width	48.9	61.7	61.7	61.7
Height	40.6	48.6	48.6	48.6
OPERATING WT. (lbs.)				
	652	976	1,025	1060
COMPRESSORS				
Type	2-STAGE SCROLL	SCROLL	SCROLL	SCROLL
Quantity	1	2	2	2
Unit Capacity Steps (%)	67/100	50/100	50/100	50/100
CONDENSER COIL DATA				
Face area (Sq. Ft.)	19.4	25.6	25.6	25.6
Rows	2	2	3	3
Fins per inch	15	17	13	17
Tube diameter	0.375	0.375	0.375	0.375
Circuitry Type	Intertwined	Intertwined	Intertwined	Intertwined
Refrigerant control	TXV	TXV	TXV	TXV
EVAPORATOR COIL DATA				
Face area (Sq. Ft.)	7.3	11.1	11.1	11.1
Rows	4	4	4	4
Fins per inch	15	15	15	15
Tube diameter	0.375	0.375	0.375	0.375
Circuitry Type	Intertwined	Intertwined	Intertwined	Intertwined
Refrigerant control	TXV	TXV	TXV	TXV
CONDENSER FAN DATA				
Quantity of fans	1	2	2	1
Fan diameter (Inch)	22	22	22	30

XXEA7, XXE08-09, XXE12 (Continued)

Component	Models											
	XXEA7	XXE08		XXE09		XXE12						
Nominal Tonnage	6	7.5		8.5		10						
Type	Prop	Prop		Prop		Prop						
Drive type	DIRECT DRIVE	DIRECT DRIVE		DIRECT DRIVE		DIRECT DRIVE						
Number of motors	1	2		2		1						
Motor HP each	1/2	1/2		1/2		1 1/2						
No. speeds	1	1		1		1						
RPM	1085	1085		1085		1140						
Total CFM	4600	7600		7600		9700						
EVAP FAN DATA BELT DRIVE												
Airflow Option	A	B	C	A	B	C	A	B	C			
Quantity	1		1		1		1					
Fan diameter (Inch)	11 x 10		15 x 15		15 x 15		15 x 15					
Type	Centrifugal		Centrifugal		Centrifugal		Centrifugal					
Motor Sheave	1VL34	1VL44	1VP50	1VL34	1VL44	1VP50	1VL34	1VL44	1VP50	1VP56		
Blower Sheave	AK51	AK51	AK51	AK74	AK74	AK74	AK74	AK74	AK74	AK79	AK79	AKBK85
Belt	A39	A40	A41	A47	A48	A50	A47	A48	A50	A50	BX52	
Motor Max BHP, 3 Phase	2.4	2.9	3.7	2.4	2.4	3.7	2.4	2.4	3.7	3.7	5.25	
RPM	1725	1725	1725	1725	1725	1725	1725	1725	1725	1725	1725	
Frame size	56Y	56Y	56HZ	56Y	56Y	65HZ	56Y	56Y	65HZ	56Y	56HZ	145TY
FILTERS												
Quantity - Size	4 - (16 x 16 x 2) ¹		4 - (20 x 20 x 2) ¹		4 - (20 x 20 x 2) ¹		4 - (20 x 20 x 2) ¹					

1. 2-inch Throwaway, Standard, MERV 4 (Minimum Efficiency Reporting Value)

XQE04 thru 06

Component	Models		
	XQE04	XQE05	XQE06
Nominal Tonnage	3	4	5
AHRI COOLING PERFORMANCE			
Gross Capacity @ AHRI A point (Btu)	36,238	49,153	58,512
AHRI net capacity (MBH)	35,600	48,000	57,000
EER	12.1	12.25	12.25
SEER	14.0	14.5	14.5
IEER	-	-	-
IEER IntelliSpeed	-	-	-
CFM	1,238	1,550	1,640
System power (KW)	2.85	3.85	4.69
Refrigerant type	R410A	R410A	R410A
Refrigerant charge (lb-oz)			
System 1	10-12	13-4	14-8
System 2	-	-	-
ARI HEATING PERFORMANCE			
47°F capacity rating (MBH)	34,200	46,700	53,000
System power (KW) / COP	2.9 / 3.25	3.8 / 3.50	4.5 / 3.50
17°F capacity rating (MBH)	18,500	26,400	29,000
System power (KW) / COP	2.6 / 2.12	3.6 / 2.00	4.0 / 2.20
HSPF (Btu/Watts-hr)	8.1	8.0	8.30
DIMENSIONS (inches)			
Length	74.1	74.1	74.1
Width	48.9	48.9	48.9
Height	32.5	40.6	40.6
OPERATING WT. (lbs.)	529	554	627
COMPRESSORS			
Type	SCROLL	SCROLL	SCROLL
Quantity	1	1	1
OUTDOOR COIL DATA			
Face area (Sq. Ft.)	15.1	19.4	19.4
Rows	2	2	2
Fins per inch	17	17	17
Tube diameter	0.375	0.375	0.375
Circuitry Type	Split-face	Split-face	Split-face
Refrigerant control	TXV	TXV	TXV
INDOOR COIL DATA			
Face area (Sq. Ft.)	5.5	7.3	7.3
Rows	4	3	4
Fins per inch	15	15	15
Tube diameter	0.375	0.375	0.375
Circuitry Type	Intertwined	Intertwined	Intertwined
Refrigerant control	TXV	TXV	TXV
OUTDOOR FAN DATA			
Quantity	1	1	1
Fan diameter (Inch)	22	22	22
Type	Prop	Prop	Prop
Drive type	DIRECT DRIVE	DIRECT DRIVE	DIRECT DRIVE
No. speeds	1	1	1
Number of motors	1	1	1
Motor HP each	1/2	1/2	1/2
RPM	1100	1085	1100

XQE04 thru 06 (Continued)

Component	Models				
	XQE04	XQE05	XQE06		
Nominal Tonnage	3	4	5		
Total CFM	3600	4000	4300		
BELT DRIVE INDOOR FAN DATA					
Quantity	1	1	1		
Fan diameter (Inch)	10 x 10	10 x 10	11 x 10		
Type	Centrifugal	Centrifugal	Centrifugal		
Motor Sheave	1VL34	1VL44	1VL34	1VL44	1VL34
Blower Sheave	AK46	AK46	AK46	AK46	AK46
Belt	A39	A40	A39	A40	A37
Motor HP each, 1 Phase	1.5	-	1.5	-	1.5
Motor HP each, 3 Phase	2.4	2.4	2.4	2.4	2.9
RPM	1725	1725	1750		
Frame size	56Y	56Y	56HZ		
DIRECT DRIVE INDOOR FAN DATA					
Quantity	1	1	1		
Fan Size (Inch)	10 x 10	10 x 10	11 x 10		
Type	Centrifugal	Centrifugal	Centrifugal		
Motor HP each	3/4	1	1		
RPM	1050	1050	1050		
FILTERS					
Quantity - Size	2 - (16 x 25 x 2) ¹	4 - (16 x 16 x 2) ¹	4 - (16 x 16 x 2) ¹		

1. 2-inch Throwaway, Standard, MERV 4 (Minimum Efficiency Reporting Value)

XYE04-09, XQE04-06, XXEA7, XXE08-09, XXE12 Unit Limitations

Model	Size (Tons)	Unit Voltage	Unit Limitations		
			Applied Voltage		Outdoor DB Temp
			Min	Max	Max (°F)
XYE/XQE	04 (3)	208/230-1-60	187	252	125
		208/230-3-60	187	252	125
		460-3-60	432	504	125
		575-3-60	540	630	125
XYE/XQE	05 (4)	208/230-1-60	187	252	125
		208/230-3-60	187	252	125
		460-3-60	432	504	125
		575-3-60	540	630	125
XYE/XQE	06 (5)	208/230-1-60	187	252	125
		208/230-3-60	187	252	125
		460-3-60	432	504	125
		575-3-60	540	630	125
XYE/XXE	A7 (6) 07 (6)	208/230-3-60	187	252	125
		460-3-60	432	504	125
		575-3-60	540	630	125
XYE/XXE	08 (7.5)	208/230-3-60	187	252	125
		460-3-60	432	504	125
		575-3-60	540	630	125
XYE/XXE	09 (8.5)	208/230-3-60	187	252	125
		460-3-60	432	504	125
		575-3-60	540	630	125
XXE	12 (10)	208/230-3-60	187	252	125
		460-3-60	432	504	125
		575-3-60	540	630	125

Capacity Performance

XYE04-09, XXEA7,XXE08-09, XXE12, XQE04-06 Cooling Capacities

XYE04 (3.0 Ton)

Air on Evaporator Coil		Temperature of Air on Condenser Coil															
		Total Capacity ¹ (MBh)	Total Input (kW) ²	Sensible Capacity (MBh)						Total Capacity ¹ (MBh)	Total Input (kW) ²	Sensible Capacity (MBh)					
				Return Dry Bulb (°F)									Return Dry Bulb (°F)				
		75°F														85°F	
750	77	47.1	2.1	22.8	19.2	15.5	-	-	-	44.3	2.4	21.6	17.9	14.2	-	-	-
	72	43.0	2.1	27.9	23.7	19.6	15.4	-	-	40.3	2.4	26.7	22.6	18.4	14.2	-	-
	67	38.9	2.1	32.9	28.3	23.6	19.5	15.3	-	36.3	2.4	31.9	27.3	22.6	18.5	14.3	-
	62	37.2	2.1	35.9	31.7	27.6	22.9	19.4	15.4	35.2	2.4	33.9	30.4	26.9	22.3	18.4	14.2
900	77	47.8	2.1	25.9	21.0	16.2	-	-	-	44.9	2.4	24.8	19.8	14.8	-	-	-
	72	44.1	2.1	30.7	25.8	20.9	16.1	-	-	41.4	2.4	29.5	24.6	19.7	14.8	-	-
	67	40.4	2.1	35.5	30.6	25.7	20.9	16.0	-	38.0	2.4	34.3	29.5	24.7	19.8	14.9	-
	62	39.1	2.1	38.0	34.2	30.5	25.2	20.9	16.1	37.0	2.4	36.0	32.8	29.7	24.5	19.8	14.9
	57	38.0	2.1	38.0	36.6	35.3	30.5	25.7	21.0	36.3	2.4	36.3	35.6	34.6	29.7	24.7	19.8
1050	77	48.5	2.1	28.9	22.8	16.8	-	-	-	45.5	2.4	28.0	21.7	15.4	-	-	-
	72	45.3	2.1	33.5	27.9	22.3	16.7	-	-	42.6	2.4	32.3	26.7	21.1	15.4	-	-
	67	42.0	2.1	38.2	33.0	27.8	22.3	16.7	-	39.6	2.4	36.6	31.7	26.8	21.1	15.5	-
	62	41.0	2.1	40.1	36.8	33.4	27.5	22.3	16.8	38.9	2.4	38.1	35.3	32.5	26.6	21.1	15.5
	57	40.1	2.1	40.1	39.4	38.8	33.4	27.9	22.4	38.3	2.4	38.3	38.1	32.5	26.8	21.1	-
1200	77	49.3	2.1	32.0	24.7	17.4	-	-	-	46.1	2.4	31.2	23.6	16.0	-	-	-
	72	46.4	2.1	36.4	30.0	23.7	17.4	-	-	43.7	2.4	35.1	28.7	22.4	16.0	-	-
	67	43.6	2.1	40.8	35.4	30.0	23.7	17.4	-	41.3	2.4	38.9	33.9	28.8	22.5	16.1	-
	62	42.8	2.1	42.3	39.3	36.3	29.7	23.7	17.5	40.8	2.4	40.1	37.7	35.3	28.7	22.5	16.1
	57	42.3	2.1	42.3	42.3	36.3	30.1	23.9	17.5	40.3	2.4	40.3	40.3	35.3	28.9	22.5	-
1350	72	47.6	2.1	39.2	32.1	25.1	18.0	-	-	44.8	2.4	37.9	30.8	23.7	16.6	-	-
	67	45.1	2.1	43.4	37.7	32.1	25.1	18.1	-	43.0	2.4	41.3	36.1	30.9	23.8	16.7	-
	62	44.7	2.1	44.4	41.8	39.2	32.0	25.2	18.2	42.6	2.4	42.2	40.1	38.0	30.9	23.8	16.7
	57	44.4	2.1	44.4	44.4	39.3	32.3	25.3	18.2	42.3	2.4	42.3	42.3	38.1	31.0	23.9	-
	72	48.7	2.1	42.0	34.2	26.4	18.7	-	-	45.9	2.4	40.7	32.9	25.0	17.2	-	-
1500	67	46.7	2.1	46.0	40.1	34.2	26.5	18.7	-	44.6	2.4	43.6	38.3	32.9	25.1	17.3	-
	62	46.6	2.1	46.5	44.3	42.1	34.3	26.6	18.9	44.5	2.4	44.3	42.5	40.8	33.0	25.2	17.4
	57	46.5	2.1	46.5	46.5	46.5	42.2	34.5	26.8	44.3	2.4	44.3	44.3	40.9	33.1	25.2	-
		95°F														105°F	
750	77	41.6	2.7	20.3	16.5	12.8	-	-	-	38.4	3.0	20.0	16.1	12.3	-	-	-
	72	37.6	2.6	25.6	21.4	17.2	13.1	-	-	35.1	3.0	24.7	20.5	16.4	12.2	-	-
	67	33.7	2.6	30.9	26.3	21.7	17.4	13.2	-	31.8	3.0	29.4	24.9	20.5	16.3	12.1	-
	62	33.2	2.6	32.0	29.1	26.2	21.8	17.4	13.1	31.4	3.0	30.2	27.4	24.6	20.4	16.2	12.0
900	77	42.0	2.7	23.7	18.5	13.4	-	-	-	38.8	3.0	23.0	17.8	12.5	-	-	-
	72	38.7	2.6	28.3	23.4	18.5	13.6	-	-	36.0	3.0	27.1	22.3	17.4	12.6	-	-
	67	35.5	2.6	33.0	28.3	23.7	18.7	13.7	-	33.3	3.0	31.2	26.8	22.4	17.5	12.6	-
	62	35.0	2.6	34.0	31.4	28.9	23.8	18.7	13.6	33.0	3.0	32.0	29.7	27.4	22.4	17.4	12.4
	57	34.5	2.6	34.5	34.0	28.9	23.7	18.5	13.6	32.6	3.0	32.6	32.5	32.4	27.3	22.3	17.2
1050	77	42.4	2.7	27.1	20.5	13.9	-	-	-	39.2	3.0	26.1	19.4	12.7	-	-	-
	72	39.8	2.6	31.1	25.4	19.8	14.2	-	-	37.0	3.0	29.6	24.1	18.5	13.0	-	-
	67	37.2	2.6	35.0	30.4	25.7	20.0	14.3	-	34.8	3.0	33.1	28.7	24.4	18.7	13.0	-
	62	36.8	2.6	36.0	33.8	31.6	25.8	20.0	14.2	34.6	3.0	33.7	32.0	30.2	24.4	18.6	12.8
	57	36.4	2.6	36.4	36.4	36.4	31.6	25.7	19.8	34.3	3.0	34.3	34.3	30.1	24.2	18.3	-
1200	77	42.8	2.6	30.5	22.5	14.5	-	-	-	39.6	3.0	29.2	21.0	12.9	-	-	-
	72	40.9	2.6	33.8	27.5	21.1	14.7	-	-	38.0	3.0	32.0	25.8	19.6	13.4	-	-
	67	39.0	2.6	37.1	32.4	27.7	21.2	14.8	-	36.4	3.0	34.9	30.6	26.3	19.9	13.5	-
	62	38.7	2.6	38.0	36.1	34.2	27.7	21.2	14.7	36.1	3.0	35.4	34.2	33.0	26.4	19.8	13.2
	57	38.4	2.6	38.4	38.4	38.4	34.3	27.7	21.1	35.9	3.0	35.9	35.9	33.0	26.2	19.4	-
1350	72	42.0	2.6	36.6	29.5	22.4	15.3	-	-	38.9	3.0	34.5	27.6	20.7	13.8	-	-
	67	40.8	2.6	39.2	34.4	29.7	22.5	15.3	-	37.9	3.0	36.7	32.5	28.3	21.1	14.0	-
	62	40.5	2.6	40.0	38.5	36.9	29.7	22.5	15.3	37.7	3.0	37.2	36.5	35.9	28.5	21.1	13.6
	57	40.3	2.6	40.3	40.3	40.3	36.9	29.7	22.4	37.5	3.0	37.5	37.5	35.8	28.1	20.5	-
	72	43.1	2.6	39.3	31.5	23.7	15.8	-	-	39.9	3.0	36.9	29.3	21.8	14.2	-	-
1500	67	42.5	2.6	41.3	36.5	31.6	23.8	15.9	-	39.5	3.0	38.5	34.4	30.2	22.3	14.5	-
	62	42.4	2.6	42.0	40.8	39.6	31.7	23.8	15.9	39.3	3.0	38.9	38.8	38.7	30.5	22.3	14.1
	57	42.2	2.6	42.2	42.2	42.2	39.6	31.7	23.7	39.2	3.0	39.2	39.2	38.6	30.1	21.6	-

XYE04 (3.0 Ton) (Continued)

Air on Evaporator Coil		Temperature of Air on Condenser Coil																
		Total Capacity ¹ (MBh)	Total Input (kW) ²	Sensible Capacity (MBh)						Total Capacity ¹ (MBh)	Total Input (kW) ²	Sensible Capacity (MBh)						
				Return Dry Bulb (°F)									Return Dry Bulb (°F)					
115°F																		
750	77	35.1	3.4	19.6	15.7	11.8	-	-	-	31.9	3.7	19.3	15.3	11.2	-	-	-	
	72	32.5	3.4	23.8	19.7	15.5	11.3	-	-	29.9	3.7	23.0	18.8	14.6	10.4	-	-	
	67	29.8	3.3	28.0	23.6	19.2	15.1	11.0	-	27.9	3.7	26.6	22.3	18.0	14.0	10.0	-	
	62	29.6	3.3	28.4	25.7	22.9	18.9	15.0	11.0	27.8	3.7	26.6	24.0	21.3	17.5	13.7	9.9	
900	77	35.5	3.4	22.4	17.0	11.6	-	-	-	32.2	3.7	21.7	16.2	10.7	-	-	-	
	72	33.3	3.4	26.0	21.2	16.4	11.6	-	-	30.6	3.7	24.8	20.0	15.3	10.5	-	-	
	67	31.1	3.4	29.5	25.3	21.1	16.3	11.4	-	29.0	3.7	27.8	23.8	19.8	15.1	10.3	-	
	62	30.9	3.4	29.9	27.9	25.9	21.0	16.1	11.2	28.9	3.7	27.9	26.1	24.4	19.6	14.8	10.0	
	57	30.7	3.4	30.3	30.3	30.3	25.7	20.8	15.9	28.8	3.7	27.9	27.9	24.2	19.4	14.5		
1050	77	35.9	3.4	25.1	18.3	11.4	-	-	-	32.6	3.7	24.2	17.2	10.2	-	-	-	
	72	34.2	3.4	28.1	22.7	17.2	11.8	-	-	31.3	3.7	26.6	21.3	16.0	10.6	-	-	
	67	32.4	3.4	31.1	27.1	23.1	17.4	11.8	-	30.0	3.7	29.1	25.4	21.7	16.2	10.6	-	
	62	32.3	3.4	31.4	30.1	28.9	23.1	17.3	11.5	30.0	3.7	29.1	28.3	27.5	21.7	15.9	10.1	
	57	32.1	3.4	31.7	31.7	31.7	28.7	22.7	16.8	29.9	3.7	29.1	29.1	27.3	21.3	15.2		
1200	77	36.3	3.4	27.9	19.6	11.3	-	-	-	33.0	3.7	26.6	18.1	9.6	-	-	-	
	72	35.0	3.4	30.2	24.2	18.1	12.1	-	-	32.1	3.7	28.4	22.5	16.6	10.7	-	-	
	67	33.7	3.4	32.6	28.8	25.0	18.6	12.2	-	31.1	3.7	30.3	27.0	23.6	17.3	10.9	-	
	62	33.6	3.4	32.9	32.4	31.9	25.1	18.4	11.7	31.1	3.7	30.3	30.3	30.3	23.9	17.0	10.2	
	57	33.5	3.4	33.2	33.2	33.2	31.7	24.7	17.6	31.0	3.7	30.3	30.3	30.3	23.2	15.9		
1350	72	35.9	3.4	32.4	25.7	19.0	12.3	-	-	32.8	3.8	30.3	23.8	17.3	10.8	-	-	
	67	35.1	3.4	34.1	30.5	26.9	19.8	12.6	-	32.2	3.8	31.6	28.6	25.5	18.4	11.3	-	
	62	34.9	3.4	34.4	34.4	34.4	27.2	19.6	12.0	32.2	3.8	31.6	31.6	26.0	18.2	10.4		
	57	34.8	3.4	34.6	34.6	34.6	34.6	26.6	18.5	32.1	3.7	31.6	31.6	31.6	25.1	16.6		
1500	72	36.7	3.4	34.5	27.2	19.9	12.6	-	-	33.5	3.8	32.1	25.0	18.0	10.9	-	-	
	67	36.4	3.4	35.6	32.2	28.8	20.9	13.0	-	33.3	3.8	32.8	30.1	27.4	19.5	11.6	-	
	62	36.3	3.4	35.9	35.9	35.9	29.3	20.8	12.3	33.2	3.8	32.8	32.8	28.1	19.3	10.5		
	57	36.2	3.4	36.1	36.1	36.1	36.1	28.5	19.4	33.2	3.7	32.8	32.8	32.8	27.0	17.3		

1. These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat ($MBh = 3.415 \times kW$). Refer to the appropriate Blower Performance Table for the kW of the supply air blower motor.

2. These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

XYE05 (4.0 Ton)

Air on Evaporator Coil		Temperature of Air on Condenser Coil																
		Total Capacity ¹ (MBh)	Total Input (kW) ²	Sensible Capacity (MBh)						Total Capacity ¹ (MBh)	Total Input (kW) ²	Sensible Capacity (MBh)						
				Return Dry Bulb (°F)									Return Dry Bulb (°F)					
75°F																		
1000	77	64.4	2.8	32.4	27.2	22.0	-	-	-	60.0	3.1	30.3	25.2	20.1	-	-	-	
	72	58.1	2.8	38.1	32.5	27.0	21.4	-	-	54.2	3.1	36.3	30.8	25.2	19.7	-	-	
	67	51.8	2.8	43.8	37.9	31.9	26.3	20.9	-	48.5	3.1	42.2	36.3	30.4	24.8	19.4	-	
	62	48.4	2.8	48.4	42.6	36.9	30.3	25.9	20.5	46.4	3.1	46.0	40.8	35.6	29.5	24.5	19.0	
1200	77	64.4	2.8	35.0	28.4	21.8	-	-	-	60.3	3.1	33.7	26.9	20.1	-	-	-	
	72	58.9	2.8	41.0	34.6	28.1	21.7	-	-	55.3	3.1	39.5	33.0	26.6	20.1	-	-	
	67	53.5	2.8	47.1	40.8	34.5	27.9	21.5	-	50.2	3.1	45.2	39.1	33.0	26.4	20.0	-	
	62	50.6	2.8	50.6	45.7	40.9	33.5	27.8	21.2	48.5	3.1	48.2	43.8	39.5	32.5	26.3	19.7	
	57	47.6	2.8	50.6	47.6	47.3	40.7	34.0	27.4	46.7	3.1	58.2	46.7	45.9	39.3	32.6	26.0	
1400	77	64.3	2.8	37.6	29.5	21.5	-	-	-	60.6	3.2	37.1	28.6	20.1	-	-	-	
	72	59.8	2.8	44.0	36.6	29.3	22.0	-	-	56.3	3.1	42.6	35.3	27.9	20.5	-	-	
	67	55.2	2.8	50.4	43.8	37.1	29.6	22.1	-	51.9	3.1	48.2	41.9	35.6	28.1	20.6	-	
	62	52.8	2.8	52.8	48.9	45.0	36.7	29.6	22.0	50.6	3.1	50.4	46.9	43.4	35.4	28.1	20.4	
	57	50.4	2.8	52.8	50.4	50.2	45.0	37.1	29.3	49.2	3.1	50.4	49.2	49.2	43.3	35.6	27.8	
1600	77	64.3	2.8	40.2	30.7	21.2	-	-	-	60.9	3.2	40.5	30.4	20.2	-	-	-	
	72	60.6	2.8	46.9	38.7	30.5	22.2	-	-	57.3	3.2	45.8	37.5	29.2	20.9	-	-	
	67	56.9	2.8	53.6	46.7	39.8	31.2	22.8	-	53.7	3.1	51.1	44.7	38.2	29.7	21.2	-	
	62	55.0	2.8	55.0	52.0	49.0	39.8	31.5	22.7	52.7	3.1	52.5	49.9	47.3	38.4	29.9	21.2	
	57	53.1	2.8	55.0	53.1	53.1	49.3	40.2	31.2	51.7	3.1	52.5	51.7	47.4	38.5	29.6	-	
1800	72	61.4	2.8	49.8	40.7	31.6	22.5	-	-	58.3	3.2	49.0	39.8	30.5	21.3	-	-	
	67	58.6	2.8	56.9	49.6	42.4	32.9	23.4	-	55.4	3.1	54.1	47.5	40.9	31.3	21.9	-	
	62	57.2	2.8	57.2	55.1	53.1	43.0	33.4	23.5	54.8	3.1	54.7	52.9	51.2	41.3	31.6	21.9	
	57	55.8	2.8	57.2	55.8	55.8	53.6	43.4	33.1	54.2	3.1	54.7	54.2	54.2	51.5	41.4	31.4	
2000	72	62.2	2.8	52.8	42.8	32.8	22.8	-	-	59.3	3.2	52.2	42.0	31.9	21.7	-	-	
	67	60.3	2.8	58.5	52.6	45.0	34.5	24.0	-	57.1	3.2	57.0	50.3	43.5	33.0	22.5	-	
	62	59.4	2.8	58.5	58.3	57.2	46.2	35.2	24.3	56.9	3.2	57.0	56.0	55.1	44.2	33.4	22.6	
	57	58.5	2.8	58.5	58.5	58.5	57.9	46.5	35.0	56.7	3.2	57.0	56.7	55.5	44.4	33.2	-	
95°F																		
1000	77	55.5	3.4	28.3	23.2	18.1	-	-	-	51.2	4.0	27.3	22.1	16.9	-	-	-	
	72	50.4	3.5	34.5	29.0	23.5	18.0	-	-	46.7	4.0	33.2	27.6	22.1	16.6	-	-	
	67	45.2	3.5	40.7	34.8	28.9	23.4	17.8	-	42.1	4.0	39.0	33.2	27.4	21.9	16.4	-	
	62	44.4	3.5	43.6	39.0	34.3	28.7	23.1	17.5	41.6	3.9	41.1	36.9	32.7	27.1	21.6	16.1	
1200	77	56.2	3.5	32.5	25.5	18.5	-	-	-	51.7	4.0	31.3	24.2	17.0	-	-	-	
	72	51.6	3.5	37.9	31.4	25.0	18.5	-	-	47.7	4.0	36.3	29.9	23.5	17.0	-	-	
	67	47.0	3.5	43.3	37.4	31.5	25.0	18.4	-	43.7	4.0	41.3	35.6	29.9	23.4	16.9	-	
	62	46.4	3.5	45.8	41.9	38.0	31.4	24.8	18.2	43.4	3.9	43.0	39.7	36.4	29.8	23.2	16.7	
	57	45.8	3.5	45.8	45.8	44.6	37.9	31.2	24.5	43.1	3.9	43.1	43.1	42.8	36.2	29.5	22.9	
1400	77	56.8	3.5	36.7	27.8	18.8	-	-	-	52.3	4.0	35.4	26.2	17.1	-	-	-	
	72	52.8	3.5	41.3	33.9	26.5	19.0	-	-	48.8	4.0	39.4	32.1	24.8	17.4	-	-	
	67	48.7	3.5	45.9	40.0	34.1	26.6	19.1	-	45.4	4.0	43.5	38.0	32.4	24.9	17.5	-	
	62	48.4	3.5	47.9	44.8	41.8	34.1	26.5	18.9	45.2	4.0	44.9	42.5	40.1	32.5	24.9	17.3	
	57	48.1	3.5	48.1	48.1	48.1	41.7	34.0	26.3	45.0	3.9	45.0	45.0	45.0	40.0	32.2	24.5	
1600	77	57.5	3.5	40.9	30.1	19.2	-	-	-	52.8	4.0	39.4	28.3	17.3	-	-	-	
	72	54.0	3.5	44.8	36.4	28.0	19.6	-	-	49.9	4.0	42.6	34.3	26.1	17.8	-	-	
	67	50.4	3.5	48.6	42.7	36.7	28.2	19.7	-	47.0	4.0	45.8	40.3	34.9	26.5	18.0	-	
	62	50.4	3.5	50.1	47.8	45.5	36.9	28.2	19.6	47.0	4.0	46.8	45.2	43.7	35.1	26.5	17.8	
	57	50.4	3.5	50.4	50.4	45.5	36.8	28.0	19.6	46.9	4.0	46.9	46.9	43.8	34.9	26.1	-	
1800	72	55.1	3.5	48.2	38.8	29.5	20.1	-	-	51.0	4.0	45.7	36.6	27.4	18.2	-	-	
	67	52.7	3.5	52.7	45.3	39.3	29.8	20.3	-	48.8	4.0	48.0	42.7	37.4	28.0	18.6	-	
	62	52.7	3.5	52.7	50.7	49.2	39.6	29.9	20.3	48.8	4.0	48.6	48.0	47.4	37.8	28.1	18.4	
	57	52.7	3.5	52.7	52.7	52.7	49.3	39.5	29.7	48.8	4.0	48.8	48.8	47.5	37.6	27.7	-	
	72	56.3	3.5	51.6	41.3	30.9	20.6	-	-	52.0	4.0	48.9	38.8	28.7	18.6	-	-	
2000	67	55.0	3.5	55.0	47.9	42.0	31.5	21.0	-	50.8	4.0	50.3	45.1	39.9	29.5	19.1	-	
	62	55.0	3.5	55.0	53.7	53.0	42.3	31.6	21.0	50.8	4.0	50.5	50.5	40.4	29.7	19.0	-	
	57	55.0	3.5	55.0	55.0	55.0	53.1	42.3	31.5	50.8	4.0	50.8	50.8	50.8	40.3	29.3	-	

XYE05 (4.0 Ton) (Continued)

Air on Evaporator Coil		Temperature of Air on Condenser Coil															
		Total Capacity ¹ (MBh)	Total Input (kW) ²	Sensible Capacity (MBh)						Total Capacity ¹ (MBh)	Total Input (kW) ²	Sensible Capacity (MBh)					
				Return Dry Bulb (°F)									Return Dry Bulb (°F)				
		115°F														125°F	
1000	77	46.9	4.5	26.2	20.9	15.7	-	-	-	42.6	5.0	25.2	19.8	14.4	-	-	-
	72	42.9	4.4	31.8	26.3	20.8	15.3	-	-	39.2	4.9	30.5	25.0	19.4	13.9	-	-
	67	38.9	4.4	37.4	31.7	25.9	20.4	14.9	-	36.1	4.9	35.8	30.1	24.4	19.0	13.5	-
	62	38.9	4.4	38.6	34.8	31.1	25.6	20.1	14.6	36.1	4.9	36.1	32.8	29.4	24.0	18.6	13.2
1200	77	47.3	4.5	30.1	22.8	15.5	-	-	-	42.8	5.0	28.9	21.5	14.1	-	-	-
	72	43.9	4.5	34.7	28.3	21.9	15.5	-	-	40.0	4.9	33.1	26.7	20.4	14.1	-	-
	67	40.5	4.4	39.3	33.8	28.3	21.9	15.4	-	37.6	4.9	37.2	32.0	26.7	20.3	13.9	-
	62	40.4	4.4	40.2	37.5	34.7	28.2	21.7	15.1	37.6	4.9	37.4	35.2	33.0	26.6	20.1	13.6
	57	40.3	4.4	40.3	40.3	34.5	27.9	21.3	-	37.6	4.9	37.6	37.6	32.8	26.2	19.7	-
1400	77	47.7	4.5	34.0	24.7	15.4	-	-	-	43.1	5.0	32.6	23.2	13.7	-	-	-
	72	44.8	4.5	37.6	30.3	23.1	15.8	-	-	40.9	4.9	35.7	28.5	21.4	14.2	-	-
	67	42.0	4.4	41.1	35.9	30.7	23.3	15.9	-	38.8	4.9	38.7	33.8	29.0	21.7	14.3	-
	62	42.0	4.4	41.8	40.1	38.3	30.8	23.2	15.6	38.8	4.9	38.8	37.7	36.6	29.1	21.5	14.0
	57	41.9	4.4	41.9	41.9	41.9	38.2	30.5	22.8	38.8	4.9	38.8	38.8	36.5	28.8	21.0	-
1600	77	48.0	4.5	37.9	26.6	15.3	-	-	-	43.3	5.0	36.4	24.9	13.4	-	-	-
	72	45.8	4.5	40.4	32.3	24.2	16.1	-	-	41.7	5.0	38.3	30.3	22.3	14.4	-	-
	67	43.6	4.5	43.0	38.0	33.1	24.7	16.4	-	40.2	4.9	40.2	35.7	31.3	23.0	14.7	-
	62	43.5	4.4	43.4	42.7	42.0	33.4	24.7	16.1	40.1	4.9	40.2	40.1	31.6	23.0	14.4	-
	57	43.5	4.4	43.5	43.5	43.5	42.0	33.1	24.2	40.0	4.9	40.2	40.1	40.0	31.3	22.3	-
1800	72	46.8	4.5	43.3	34.3	25.3	16.4	-	-	42.6	5.0	40.8	32.1	23.3	14.5	-	-
	67	45.1	4.5	44.8	40.2	35.5	26.2	16.8	-	41.6	4.9	41.6	37.6	33.6	24.3	15.1	-
	62	45.1	4.4	45.0	45.0	45.0	36.0	26.3	16.6	41.4	4.9	41.6	41.4	41.4	34.2	24.5	14.8
	57	45.0	4.4	45.0	45.0	45.0	35.7	25.7	41.2	41.2	4.9	41.6	41.4	41.4	41.2	33.8	23.7
2000	72	47.7	4.5	46.2	36.3	26.5	16.7	-	-	43.4	5.0	43.4	33.8	24.3	14.7	-	-
	67	46.7	4.5	46.6	42.3	37.9	27.6	17.3	-	43.1	5.0	43.4	39.5	35.9	25.7	15.5	-
	62	46.6	4.5	46.6	46.6	46.6	46.6	38.6	27.8	42.7	4.9	43.4	42.7	42.7	36.7	25.9	15.2
	57	46.6	4.5	46.6	46.6	46.6	46.6	38.3	27.2	42.4	4.9	43.4	42.7	42.7	42.4	36.3	25.0

1. These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate Blower Performance Table for the kW of the supply air blower motor.

2. These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

XYE06 (5.0 Ton)

Air on Evaporator Coil		Temperature of Air on Condenser Coil																
		Total Capacity ¹ (MBh)	Total Input (kW) ²	Sensible Capacity (MBh)						Total Capacity ¹ (MBh)	Total Input (kW) ²	Sensible Capacity (MBh)						
				Return Dry Bulb (°F)									Return Dry Bulb (°F)					
75°F																		
1250	77	78.6	3.5	37.8	32.2	26.6	-	-	-	74.1	4.0	36.2	29.9	23.6	-	-	-	
	72	71.8	3.4	46.7	40.1	33.5	26.8	-	-	67.6	3.9	45.3	38.2	31.1	24.0	-	-	
	67	64.9	3.4	55.7	48.0	40.4	33.4	26.8	-	61.1	3.8	54.5	46.6	38.6	31.4	24.3	-	
	62	62.4	3.4	54.9	51.1	47.3	37.4	33.4	26.4	59.3	3.8	55.2	50.6	46.1	37.4	31.6	24.4	
1500	77	79.7	3.5	43.5	35.2	26.9	-	-	-	74.9	4.0	42.0	33.0	24.0	-	-	-	
	72	73.8	3.5	51.6	43.5	35.4	27.2	-	-	69.2	3.9	49.8	41.4	33.0	24.5	-	-	
	67	67.9	3.4	59.7	51.8	43.8	35.4	27.3	-	63.6	3.8	57.6	49.8	42.0	33.4	24.9	-	
	62	65.8	3.4	59.7	56.0	52.3	41.6	35.6	27.2	62.0	3.8	58.5	54.7	51.0	41.2	33.7	25.1	
	57	63.7	3.4	59.7	59.7	52.3	43.8	35.3	-	60.5	3.8	59.3	59.3	51.3	42.5	33.8	-	
1750	77	80.7	3.5	49.3	38.2	27.2	-	-	-	75.7	4.0	47.8	36.0	24.3	-	-	-	
	72	75.8	3.5	56.5	46.9	37.2	27.6	-	-	70.9	3.9	54.3	44.6	34.8	25.1	-	-	
	67	70.8	3.4	63.8	55.5	47.3	37.4	27.9	-	66.0	3.8	60.8	53.1	45.3	35.4	25.6	-	
	62	69.2	3.4	64.5	60.9	57.3	45.8	37.7	28.0	64.7	3.8	61.8	58.8	55.9	45.0	35.8	25.8	
	57	67.5	3.4	65.2	65.2	65.2	57.5	47.6	37.8	63.3	3.8	62.7	62.7	56.2	46.1	35.9	-	
2000	77	81.7	3.5	55.0	41.3	27.5	-	-	-	76.5	4.0	53.6	39.1	24.6	-	-	-	
	72	77.8	3.5	61.4	50.3	39.1	28.0	-	-	72.5	3.9	58.8	47.7	36.6	25.6	-	-	
	67	73.8	3.4	67.9	59.3	50.7	39.5	28.4	-	68.5	3.9	64.0	56.3	48.7	37.4	26.2	-	
	62	72.5	3.4	69.3	65.8	62.3	50.0	39.9	28.8	67.3	3.9	65.1	62.9	60.8	48.8	37.9	26.5	
	57	71.3	3.4	70.7	70.7	62.7	51.5	40.3	-	66.1	3.8	66.1	66.1	61.2	49.6	38.0	-	
2250	72	79.7	3.5	66.3	53.7	41.0	28.4	-	-	74.2	3.9	63.3	50.9	38.5	26.1	-	-	
	67	76.7	3.5	71.9	63.0	54.1	41.5	28.9	-	71.0	3.9	67.1	59.6	52.1	39.4	26.8	-	
	62	75.9	3.4	74.1	70.7	67.3	54.1	42.1	29.5	70.0	3.9	68.4	67.0	65.6	52.5	40.0	27.2	
	57	75.1	3.4	75.1	75.1	75.1	67.9	55.3	42.8	69.0	3.9	69.0	69.0	66.2	53.2	40.1	-	
2500	72	81.7	3.5	71.2	57.0	42.9	28.7	-	-	75.8	3.9	67.7	54.0	40.3	26.6	-	-	
	67	79.7	3.5	76.0	66.8	57.6	43.5	29.4	-	73.4	3.9	70.3	62.8	55.4	41.4	27.5	-	
	62	79.3	3.5	78.9	75.6	72.3	58.3	44.3	30.3	72.6	3.9	71.7	71.1	70.5	56.3	42.1	27.9	
	57	78.9	3.5	78.9	78.9	78.9	73.1	59.2	45.3	71.8	3.9	71.8	71.8	71.2	56.7	42.2	-	
95°F		95°F																
		105°F																
1250	77	69.5	4.5	34.5	27.6	20.7	-	-	-	63.2	5.1	34.2	27.1	20.0	-	-	-	
	72	63.4	4.4	43.9	36.4	28.8	21.2	-	-	58.3	5.0	42.1	34.7	27.4	20.0	-	-	
	67	57.2	4.2	53.3	45.1	36.9	29.3	21.8	-	53.4	4.9	50.0	42.4	34.8	27.5	20.2	-	
	62	56.3	4.2	55.4	50.2	45.0	37.4	29.9	22.4	52.7	4.8	51.9	47.0	42.1	34.9	27.7	20.5	
1500	77	70.1	4.5	40.4	30.7	21.0	-	-	-	64.1	5.0	39.5	29.7	19.8	-	-	-	
	72	64.7	4.4	48.0	39.3	30.6	21.9	-	-	59.8	5.0	45.9	37.4	28.9	20.4	-	-	
	67	59.2	4.2	55.6	47.9	40.2	31.3	22.5	-	55.5	4.9	52.3	45.1	38.0	29.4	20.8	-	
	62	58.2	4.2	57.2	53.5	49.7	40.8	31.9	23.0	54.8	4.8	53.9	50.5	47.1	38.4	29.7	20.9	
	57	57.2	4.2	57.2	57.2	57.2	50.3	41.3	32.2	54.0	4.8	54.0	54.0	47.4	38.5	29.7	-	
1750	77	70.7	4.4	46.3	33.8	21.3	-	-	-	65.0	5.0	44.9	32.3	19.7	-	-	-	
	72	66.0	4.4	52.1	42.2	32.4	22.5	-	-	61.3	5.0	49.7	40.1	30.5	20.9	-	-	
	67	61.2	4.3	57.8	50.6	43.4	33.4	23.3	-	57.6	4.9	54.5	47.9	41.3	31.4	21.4	-	
	62	60.2	4.2	59.0	56.8	54.5	44.2	33.9	23.6	56.8	4.9	55.9	54.0	52.1	41.8	31.6	21.3	
	57	59.1	4.2	59.1	59.1	59.1	55.0	44.5	34.0	56.0	4.8	56.0	56.0	52.3	41.7	31.2	-	
2000	77	71.3	4.4	52.2	36.9	21.6	-	-	-	65.8	5.0	50.2	34.9	19.5	-	-	-	
	72	67.3	4.3	56.1	45.1	34.2	23.2	-	-	62.7	5.0	53.5	42.8	32.0	21.3	-	-	
	67	63.2	4.3	60.0	53.4	46.7	35.4	24.0	-	59.7	4.9	56.8	50.7	44.5	33.3	22.0	-	
	62	62.1	4.3	60.9	60.0	59.2	47.6	35.9	24.2	58.9	4.9	57.8	57.5	57.1	45.3	33.5	21.7	
	57	61.0	4.3	61.0	61.0	61.0	59.8	47.7	35.7	58.1	4.9	58.1	58.1	57.3	45.0	32.7	-	
2250	72	68.6	4.3	60.2	48.1	35.9	23.8	-	-	64.2	5.0	57.3	45.4	33.6	21.7	-	-	
	67	65.2	4.3	62.3	56.1	50.0	37.4	24.8	-	61.7	4.9	59.0	53.4	47.8	35.2	22.7	-	
	62	64.1	4.3	62.7	62.7	62.7	50.9	37.9	24.8	60.9	4.9	59.8	59.8	48.7	35.4	22.1	-	
	57	62.9	4.3	62.9	62.9	62.9	51.0	37.5	24.0	60.1	4.9	60.1	60.1	60.1	48.2	34.2	-	
2500	72	69.9	4.3	64.3	51.0	37.7	24.5	-	-	65.7	4.9	61.1	48.1	35.1	22.2	-	-	
	67	67.2	4.3	64.5	58.9	53.2	39.4	25.5	-	63.8	4.9	61.3	56.2	51.1	37.2	23.3	-	
	62	66.0	4.3	64.5	64.5	54.3	39.9	25.4	-	63.0	4.9	61.8	61.8	52.2	37.4	22.6	-	
	57	64.8	4.3	64.5	64.5	64.5	64.5	54.2	39.2	62.1	4.9	62.1	62.1	51.5	35.7	-	-	

XYE06 (5.0 Ton) (Continued)

Air on Evaporator Coil		Temperature of Air on Condenser Coil															
		Total Capacity ¹ (MBh)	Total Input (kW) ²	Sensible Capacity (MBh)						Total Capacity ¹ (MBh)	Total Input (kW) ²	Sensible Capacity (MBh)					
				Return Dry Bulb (°F)									Return Dry Bulb (°F)				
		115°F														125°F	
1250	77	56.9	5.7	33.9	26.6	19.3	-	-	-	50.6	6.2	33.6	26.1	18.6	-	-	-
	72	53.3	5.6	40.3	33.1	26.0	18.8	-	-	48.2	6.2	38.5	31.5	24.6	17.6	-	-
	67	49.7	5.5	46.7	39.7	32.6	25.6	18.6	-	45.9	6.1	43.4	37.0	30.5	23.7	17.0	-
	62	49.2	5.4	48.5	43.9	39.3	32.4	25.6	18.7	45.7	6.1	45.0	40.7	36.4	29.9	23.4	16.9
1500	77	58.0	5.6	38.7	28.7	18.7	-	-	-	52.0	6.2	37.8	27.6	17.5	-	-	-
	72	54.9	5.6	43.8	35.5	27.3	19.0	-	-	50.0	6.2	41.7	33.7	25.6	17.6	-	-
	67	51.8	5.5	49.0	42.4	35.9	27.5	19.1	-	48.1	6.1	45.7	39.7	33.7	25.5	17.3	-
	62	51.3	5.5	50.6	47.5	44.5	35.9	27.4	18.9	47.9	6.1	47.3	44.6	41.9	33.5	25.2	16.8
	57	50.9	5.4	50.9	50.9	44.4	35.8	27.1	-	47.7	6.1	47.7	47.7	47.7	41.5	33.0	24.5
1750	77	59.2	5.6	43.4	30.7	18.0	-	-	-	53.4	6.2	42.0	29.2	16.4	-	-	-
	72	56.6	5.6	47.3	38.0	28.6	19.2	-	-	51.8	6.2	45.0	35.8	26.7	17.6	-	-
	67	54.0	5.5	51.2	45.2	39.1	29.3	19.6	-	50.3	6.1	47.9	42.5	37.0	27.3	17.7	-
	62	53.5	5.5	52.7	51.2	49.7	39.5	29.3	19.1	50.2	6.1	49.5	48.4	47.3	37.1	27.0	16.8
	57	53.0	5.5	53.0	53.0	53.0	49.6	39.0	28.4	50.0	6.1	50.0	50.0	46.9	36.2	25.6	-
2000	77	60.3	5.6	48.2	32.8	17.4	-	-	-	54.8	6.2	46.2	30.7	15.3	-	-	-
	72	58.2	5.6	50.8	40.4	29.9	19.4	-	-	53.7	6.2	48.2	38.0	27.8	17.6	-	-
	67	56.1	5.5	53.5	47.9	42.4	31.2	20.0	-	52.5	6.1	50.2	45.2	40.2	29.1	18.1	-
	62	55.6	5.5	54.8	54.8	54.8	43.0	31.1	19.3	52.4	6.1	51.8	51.8	40.7	28.8	16.8	-
	57	55.2	5.5	55.2	55.2	55.2	54.8	42.2	29.7	52.3	6.1	52.3	52.3	52.3	39.5	26.6	-
2250	72	59.8	5.6	54.4	42.8	31.2	19.6	-	-	55.5	6.2	51.4	40.1	28.8	17.6	-	-
	67	58.3	5.5	55.7	50.7	45.6	33.1	20.5	-	54.8	6.2	52.5	48.0	43.5	31.0	18.4	-
	62	57.8	5.5	57.0	57.0	57.0	46.5	33.0	19.5	54.7	6.1	54.1	54.1	44.4	30.6	16.8	-
	57	57.3	5.5	57.3	57.3	57.3	45.5	31.0	-	54.5	6.1	54.5	54.5	54.5	42.7	27.7	-
2500	72	61.5	5.6	57.9	45.2	32.5	19.8	-	-	57.3	6.2	54.7	42.3	29.9	17.5	-	-
	67	60.4	5.6	58.0	53.4	48.9	35.0	21.0	-	57.0	6.2	54.7	50.7	46.7	32.8	18.8	-
	62	59.9	5.6	59.1	59.1	59.1	50.1	34.9	19.7	56.9	6.2	56.3	56.3	48.0	32.4	16.8	-
	57	59.5	5.6	59.5	59.5	59.5	59.5	48.7	32.2	56.8	6.2	56.8	56.8	56.8	46.0	28.8	-

1. These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate Blower Performance Table for the kW of the supply air blower motor.

2. These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

XYE07 (6.0 Ton)

Air on Evaporator Coil		Temperature of Air on Condenser Coil															
		Total Capacity ¹ (MBh)	Total Input (kW) ²	Sensible Capacity (MBh)						Total Capacity ¹ (MBh)	Total Input (kW) ²	Sensible Capacity (MBh)					
				Return Dry Bulb (°F)									Return Dry Bulb (°F)				
		75°F														85°F	
1500	77	82.3	4.3	36.3	29.0	22.7	-	-	-	81.3	4.8	36.6	30.2	23.8	-	-	-
	72	79.0	4.2	48.0	41.6	35.3	28.9	-	-	76.2	4.7	47.7	41.3	34.9	28.5	-	-
	67	75.7	4.2	59.6	54.2	47.8	41.5	35.1	-	71.1	4.7	58.7	52.3	45.9	39.5	33.1	-
	62	68.8	4.1	68.8	68.1	56.8	50.5	44.1	37.8	65.3	4.7	65.3	65.0	54.9	48.5	42.1	35.7
1800	77	85.3	4.3	39.5	32.2	24.9	-	-	-	84.0	4.8	40.8	33.4	26.0	-	-	-
	72	81.8	4.2	53.3	46.0	38.6	31.3	-	-	78.8	4.7	52.8	45.5	38.1	30.7	-	-
	67	78.4	4.1	67.1	59.7	52.4	45.0	37.7	-	73.5	4.7	64.9	57.5	50.1	42.7	35.3	-
	62	71.2	4.1	71.2	70.8	62.2	54.9	47.5	40.2	67.5	4.6	67.5	67.3	59.9	52.5	45.1	37.7
	57	73.4	4.1	73.4	71.8	64.0	56.6	49.3	41.9	69.2	4.6	69.2	68.4	61.0	53.6	46.3	38.9
2100	77	88.2	4.3	42.8	35.4	27.0	-	-	-	86.7	4.8	45.0	36.6	28.2	-	-	-
	72	84.7	4.2	58.6	50.3	42.0	33.6	-	-	81.3	4.7	58.0	49.7	41.3	32.9	-	-
	67	81.1	4.1	74.5	65.3	56.9	48.6	40.3	-	75.9	4.7	71.1	62.7	54.3	46.0	37.6	-
	62	73.7	4.1	73.7	73.5	67.6	59.3	51.0	42.6	69.7	4.6	69.7	69.6	64.9	56.6	48.2	39.8
	57	75.9	4.1	75.9	75.1	69.5	61.2	52.9	44.5	71.5	4.6	71.5	71.1	66.2	57.8	49.4	41.0
2400	77	91.2	4.3	46.0	38.5	29.2	-	-	-	89.5	4.8	49.1	39.7	30.4	-	-	-
	72	87.5	4.2	64.0	54.7	45.3	36.0	-	-	83.9	4.7	63.2	53.8	44.5	35.1	-	-
	67	83.8	4.1	81.9	70.8	61.5	52.1	42.8	-	78.3	4.6	77.3	68.0	58.6	49.2	39.8	-
	62	76.2	4.1	76.2	76.2	73.0	63.7	54.4	45.1	71.9	4.6	71.9	71.9	70.0	60.6	51.2	41.8
	57	78.5	4.0	78.5	78.5	75.1	65.7	56.4	47.1	73.7	4.6	73.7	73.7	71.3	61.9	52.5	43.1
2700	72	88.4	4.2	67.3	57.4	47.5	37.6	-	-	85.1	4.7	67.5	57.3	47.2	37.1	-	-
	67	84.7	4.1	83.7	74.4	64.5	54.6	44.7	-	79.4	4.6	79.0	72.3	62.2	52.0	41.9	-
	62	76.9	4.1	76.9	76.9	75.4	65.5	55.6	45.7	73.0	4.6	73.0	73.0	72.0	61.9	51.8	41.6
	57	79.3	4.0	79.3	79.3	77.6	67.7	57.8	47.9	74.8	4.6	74.8	74.8	73.6	63.5	53.3	43.2
3000	72	89.2	4.1	70.7	60.2	49.7	39.3	-	-	86.4	4.7	71.7	60.8	49.9	39.1	-	-
	67	85.5	4.1	85.5	78.0	67.5	57.1	46.6	-	80.6	4.6	80.6	76.6	65.8	54.9	44.0	-
	62	77.7	4.0	77.7	77.7	77.7	67.2	56.8	46.3	74.0	4.6	74.0	74.0	63.2	52.3	41.4	-
	57	80.1	4.0	80.1	80.1	80.1	69.6	59.1	48.7	75.9	4.5	75.9	75.9	65.0	54.2	43.3	-
		95°F														105°F	
1500	77	80.3	5.3	36.9	31.3	24.9	-	-	-	74.5	5.9	32.7	29.0	22.6	-	-	-
	72	73.4	5.3	47.3	40.9	34.5	28.0	-	-	68.2	5.9	44.9	38.5	32.2	25.8	-	-
	67	66.5	5.2	57.8	50.4	44.0	37.6	31.1	-	61.8	5.9	57.1	48.1	41.8	35.4	29.1	-
	62	61.9	5.2	61.9	61.9	52.9	46.5	40.0	33.6	58.5	5.9	58.5	58.3	48.8	42.4	36.1	29.7
1800	77	82.8	5.3	42.0	34.6	27.1	-	-	-	76.7	5.9	39.5	32.1	24.7	-	-	-
	72	75.7	5.3	52.4	44.9	37.5	30.0	-	-	70.2	5.9	50.0	42.6	35.2	27.8	-	-
	67	68.6	5.2	62.8	55.3	47.9	40.4	33.0	-	63.7	5.9	60.5	53.1	45.7	38.3	30.9	-
	62	63.8	5.2	63.8	63.8	57.6	50.2	42.7	35.3	60.2	5.8	60.2	60.1	53.3	45.9	38.5	31.1
	57	65.1	5.1	65.1	65.1	58.1	50.7	43.2	35.8	60.9	5.8	60.9	60.7	53.6	46.2	38.8	31.4
2100	77	85.3	5.3	47.1	37.8	29.3	-	-	-	78.9	5.9	46.4	35.3	26.8	-	-	-
	72	78.0	5.2	57.5	49.0	40.5	32.1	-	-	72.2	5.9	55.1	46.7	38.2	29.8	-	-
	67	70.7	5.2	67.8	60.2	51.8	43.3	34.9	-	65.5	5.8	63.9	58.1	49.6	41.1	32.7	-
	62	65.8	5.2	65.8	65.8	62.3	53.8	45.4	36.9	62.0	5.8	62.0	61.9	57.9	49.4	41.0	32.5
	57	67.0	5.1	67.0	67.0	62.8	54.4	45.9	37.5	62.6	5.8	62.6	62.6	58.2	49.7	41.2	32.8
2400	77	87.8	5.3	52.3	41.0	31.5	-	-	-	81.1	5.9	53.2	38.5	28.9	-	-	-
	72	80.3	5.2	62.5	53.0	43.6	34.1	-	-	74.2	5.8	60.3	50.8	41.2	31.7	-	-
	67	72.8	5.2	72.8	65.1	55.7	46.2	36.7	-	67.3	5.8	67.3	63.0	53.5	44.0	34.5	-
	62	67.7	5.1	67.7	67.7	66.9	57.5	48.0	38.5	63.7	5.8	63.7	62.4	52.9	43.4	33.9	-
	57	69.0	5.1	69.0	69.0	67.5	58.1	48.6	39.1	64.4	5.8	64.4	64.4	62.7	53.2	43.7	34.2
2700	72	81.9	5.2	67.6	57.2	46.9	36.5	-	-	75.4	5.8	65.0	54.6	44.2	33.8	-	-
	67	74.2	5.2	74.2	70.2	59.8	49.5	39.1	-	68.4	5.8	68.4	66.1	57.4	47.0	36.6	-
	62	69.1	5.1	69.1	69.1	68.7	58.3	47.9	37.6	64.7	5.8	64.7	64.7	60.0	53.6	43.2	32.8
	57	70.4	5.1	70.4	70.4	69.7	59.3	48.9	38.5	65.4	5.7	65.4	65.4	64.5	54.1	43.7	33.3
	72	83.5	5.2	72.7	61.4	50.1	38.8	-	-	76.5	5.8	69.7	58.4	47.2	35.9	-	-
3000	67	75.7	5.1	75.7	75.3	64.0	52.7	41.5	-	69.4	5.8	69.4	69.2	61.2	49.9	38.6	-
	62	70.4	5.1	70.4	70.4	69.1	59.1	47.9	36.6	65.6	5.8	65.6	65.6	54.3	43.1	31.8	-
	57	71.8	5.1	71.8	71.8	71.8	60.5	49.2	37.9	66.3	5.7	66.3	66.3	55.1	43.8	32.5	-

XYE07 (6.0 Ton) (Continued)

Air on Evaporator Coil		Temperature of Air on Condenser Coil															
		Total Capacity ¹ (MBh)	Total Input (kW) ²	Sensible Capacity (MBh)						Total Capacity ¹ (MBh)	Total Input (kW) ²	Sensible Capacity (MBh)					
				Return Dry Bulb (°F)									Return Dry Bulb (°F)				
		115°F														125°F	
1500	77	68.7	6.6	28.5	26.6	20.3	-	-	-	62.9	7.2	27.7	23.0	18.0	-	-	-
	72	62.9	6.5	42.5	36.2	29.9	23.7	-	-	57.7	7.2	40.0	33.8	27.7	21.5	-	-
	67	57.1	6.5	56.4	45.8	39.6	33.3	27.0	-	52.4	7.2	52.4	43.5	37.3	31.1	25.0	-
	62	55.1	6.5	55.1	54.8	44.6	38.3	32.1	25.8	51.7	7.2	51.7	51.2	40.4	34.3	28.1	21.9
1800	77	70.7	6.5	37.1	29.7	22.3	-	-	-	64.6	7.2	36.8	27.3	19.9	-	-	-
	72	64.7	6.5	47.7	40.3	32.9	25.5	-	-	59.2	7.1	45.3	37.9	30.6	23.3	-	-
	67	58.7	6.5	58.2	50.9	43.5	36.1	28.8	-	53.8	7.1	53.8	48.6	41.3	34.0	26.6	-
	62	56.6	6.5	56.6	56.4	49.0	41.7	34.3	26.9	53.0	7.1	53.0	52.7	44.8	37.4	30.1	22.8
2100	77	72.6	6.5	45.6	32.8	24.4	-	-	-	66.3	7.1	45.9	31.5	21.9	-	-	-
	72	66.4	6.5	52.8	44.4	35.9	27.4	-	-	60.7	7.1	50.5	42.1	33.6	25.1	-	-
	67	60.3	6.5	60.1	55.9	47.4	39.0	30.5	-	55.1	7.1	55.1	53.8	45.3	36.8	28.3	-
	62	58.2	6.5	58.2	58.1	53.5	45.0	36.6	28.1	54.4	7.1	54.4	54.2	49.1	40.6	32.2	23.7
2400	77	74.5	6.5	54.1	36.0	26.4	-	-	-	67.9	7.1	55.1	35.8	23.8	-	-	-
	72	68.2	6.5	58.0	48.5	38.9	29.3	-	-	62.2	7.1	55.8	46.2	36.5	26.9	-	-
	67	61.9	6.4	61.9	61.0	51.4	41.8	32.3	-	56.5	7.1	56.5	56.5	49.3	39.6	30.0	-
	62	59.7	6.4	59.7	59.7	58.0	48.4	38.8	29.2	55.8	7.1	55.8	55.8	53.5	43.8	34.2	24.6
2700	77	68.9	6.4	62.4	52.0	41.5	31.1	-	-	62.3	7.1	59.8	49.3	38.9	28.4	-	-
	67	62.5	6.4	62.5	62.0	54.9	44.5	34.0	-	56.6	7.1	56.6	56.6	52.4	42.0	31.5	-
	62	60.3	6.4	60.3	60.3	59.4	49.0	38.5	28.1	55.9	7.1	55.9	55.9	54.8	44.3	33.8	23.4
	57	60.4	6.4	60.4	59.4	49.0	38.6	28.1	55.3	7.1	55.3	55.3	54.3	43.9	33.4	22.9	
3000	72	69.5	6.4	66.8	55.5	44.2	32.9	-	-	62.5	7.1	62.5	52.5	41.2	29.9	-	-
	67	63.1	6.4	63.1	63.1	58.4	47.1	35.8	-	56.8	7.1	56.8	56.8	55.6	44.3	33.0	-
	62	60.9	6.4	60.9	60.9	60.9	49.6	38.3	27.0	56.1	7.1	56.1	56.1	56.1	44.8	33.5	22.1
	57	60.9	6.4	60.9	60.9	60.9	49.6	38.3	27.0	55.5	7.1	55.5	55.5	55.5	44.2	32.9	21.6

1. These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate Blower Performance Table for the kW of the supply air blower motor.
2. These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

XYE08 (7.5 Ton)

Air on Evaporator Coil		Temperature of Air on Condenser Coil															
		Total Capacity ¹ (MBh)	Total Input (kW) ²	Sensible Capacity (MBh)						Total Capacity ¹ (MBh)	Total Input (kW) ²	Sensible Capacity (MBh)					
				Return Dry Bulb (°F)									Return Dry Bulb (°F)				
		75°F														85°F	
1875	77	113.5	5.2	46.7	38.6	32.4	-	-	-	109.9	5.9	46.2	38.7	31.2	-	-	-
	72	104.3	5.1	58.6	52.4	46.2	40.0	-	-	99.9	5.8	59.2	51.7	44.2	36.7	-	-
	67	95.0	5.0	70.5	66.2	60.0	53.8	47.6	-	89.9	5.7	72.3	64.8	57.3	49.7	42.2	-
	62	85.3	5.0	85.3	72.1	65.9	59.7	53.5	53.5	81.8	5.7	81.8	68.9	61.4	53.8	46.3	
2250	77	118.7	5.2	52.7	44.2	35.6	-	-	-	114.1	5.9	53.0	43.6	34.2	-	-	-
	72	109.0	5.1	67.9	59.3	50.7	42.1	-	-	103.7	5.8	67.3	57.9	48.5	39.1	-	-
	67	99.3	5.0	83.0	74.4	65.8	57.2	48.6	-	93.3	5.7	81.6	72.2	62.8	53.4	44.0	-
	62	89.1	5.0	89.1	89.1	79.1	70.5	61.9	53.3	84.9	5.7	84.9	75.5	66.1	56.8	47.4	
	57	86.1	5.0	86.1	86.1	79.8	71.2	62.6	54.0	83.3	5.7	83.3	75.9	66.5	57.1	47.8	
2625	77	123.9	5.2	58.8	49.7	38.7	-	-	-	118.2	5.9	59.8	48.5	37.2	-	-	-
	72	113.7	5.1	77.1	66.1	55.2	44.2	-	-	107.5	5.8	75.3	64.1	52.8	41.5	-	-
	67	103.6	5.0	95.4	82.6	71.6	60.6	49.6	-	96.7	5.7	90.9	79.6	68.4	57.1	45.8	-
	62	93.0	5.0	93.0	93.0	86.0	75.0	64.1	53.1	88.0	5.7	88.0	88.0	82.2	70.9	59.7	48.4
	57	89.9	5.0	89.9	89.9	86.8	75.8	64.9	53.9	86.3	5.7	86.3	86.3	82.6	71.4	60.1	48.8
3000	77	129.0	5.2	64.9	55.2	41.8	-	-	-	122.4	5.9	66.6	53.4	40.3	-	-	-
	72	118.5	5.1	86.4	73.0	59.6	46.2	-	-	111.3	5.8	83.4	70.2	57.1	43.9	-	-
	67	107.9	5.0	107.9	90.8	77.4	64.0	50.6	-	100.1	5.7	100.1	87.1	73.9	60.7	47.6	-
	62	96.9	5.0	96.9	96.9	93.0	79.6	66.2	52.9	91.1	5.7	91.1	88.9	75.7	62.6	49.4	
	57	93.6	5.0	93.6	93.6	93.6	80.5	67.1	53.7	89.3	5.7	89.3	89.3	76.2	63.0	49.9	
3375	72	120.7	5.1	88.9	76.0	63.1	50.2	-	-	113.3	5.8	88.1	74.4	60.8	47.1	-	-
	67	109.9	5.0	109.9	95.2	81.9	69.0	56.1	-	102.0	5.7	102.0	92.4	78.7	65.0	51.4	-
	62	98.7	5.0	98.7	98.7	96.8	83.9	71.0	58.1	92.8	5.7	92.8	92.8	91.7	78.0	64.3	50.7
	57	95.4	5.0	95.4	95.4	95.4	82.6	69.7	56.8	91.0	5.7	91.0	91.0	77.3	63.7	50.0	
3750	72	122.9	5.2	91.4	79.0	66.6	54.2	-	-	115.4	5.8	92.8	78.6	64.5	50.3	-	-
	67	111.9	5.1	111.9	99.5	86.4	74.0	61.6	-	103.8	5.8	103.8	97.7	83.5	69.3	55.2	-
	62	100.5	5.1	100.5	100.5	100.5	88.1	75.7	63.3	94.4	5.7	94.4	94.4	80.3	66.1	52.0	
	57	97.1	5.1	97.1	97.1	97.1	84.7	72.3	59.9	92.7	5.7	92.7	92.7	78.5	64.3	50.2	
	95°F														105°F		
1875	77	106.3	6.5	45.7	38.8	30.0	-	-	-	94.5	7.3	39.8	35.0	26.8	-	-	-
	72	95.6	6.4	59.9	51.1	42.3	33.4	-	-	85.3	7.3	55.2	47.1	38.9	30.7	-	-
	67	84.8	6.4	74.1	63.4	54.6	45.7	36.9	-	76.1	7.2	70.7	59.2	51.0	42.8	34.7	-
	62	78.3	6.3	78.3	78.3	65.7	56.9	48.0	39.2	71.2	7.1	71.2	71.2	60.0	51.9	43.7	35.5
2250	77	109.4	6.5	53.2	43.1	32.9	-	-	-	98.0	7.3	48.6	39.1	29.6	-	-	-
	72	98.4	6.5	66.7	56.5	46.3	36.1	-	-	88.4	7.3	61.9	52.4	42.9	33.5	-	-
	67	87.3	6.4	80.2	70.0	59.8	49.6	39.4	-	78.9	7.2	75.3	65.8	56.3	46.8	37.3	-
	62	80.6	6.3	80.6	80.6	72.0	61.8	51.6	41.4	73.8	7.2	73.8	73.8	66.3	56.8	47.3	37.8
	57	80.4	6.3	80.4	80.4	72.1	61.9	51.7	41.5	72.8	7.2	72.8	72.8	65.5	56.0	46.5	37.0
2625	77	112.6	6.5	60.8	47.3	35.8	-	-	-	101.4	7.4	57.4	43.2	32.4	-	-	-
	72	101.2	6.5	73.5	62.0	50.4	38.9	-	-	91.5	7.3	68.6	57.8	47.0	36.2	-	-
	67	89.8	6.4	86.3	76.7	65.1	53.5	42.0	-	81.6	7.3	79.8	72.4	61.6	50.8	40.0	-
	62	82.9	6.3	82.9	82.9	78.4	66.8	55.3	43.7	76.4	7.2	76.4	76.4	72.5	61.7	50.9	40.1
	57	82.7	6.4	82.7	82.7	78.4	66.9	55.3	43.8	75.3	7.2	75.3	75.3	71.6	60.8	50.0	39.2
3000	77	115.7	6.5	68.4	51.6	38.7	-	-	-	104.8	7.4	66.1	47.3	35.2	-	-	-
	72	104.0	6.5	80.3	67.4	54.5	41.6	-	-	94.6	7.3	75.3	63.1	51.0	38.9	-	-
	67	92.3	6.4	92.3	83.3	70.4	57.4	44.5	-	84.4	7.3	84.4	79.0	66.9	54.8	42.6	-
	62	85.2	6.3	85.2	85.2	84.7	71.8	58.9	46.0	79.0	7.2	79.0	79.0	78.7	66.6	54.5	42.3
	57	85.0	6.4	85.0	85.0	84.8	71.9	59.0	46.0	77.9	7.2	77.9	77.9	77.7	65.6	53.5	41.4
3375	72	106.0	6.5	87.3	72.9	58.5	44.0	-	-	96.0	7.3	81.5	68.1	54.7	41.4	-	-
	67	94.1	6.4	94.1	89.5	75.5	61.0	46.6	-	85.7	7.3	85.7	83.0	71.7	58.4	45.0	-
	62	86.8	6.3	86.8	86.8	86.6	72.1	57.7	43.3	80.1	7.2	80.1	80.1	66.7	53.3	39.9	
	57	86.6	6.3	86.6	86.6	86.5	72.1	57.7	43.2	79.0	7.2	79.0	79.0	65.6	52.2	38.9	
	57	88.2	6.3	88.2	88.2	88.2	72.3	56.4	40.5	80.2	7.2	80.2	80.2	65.6	51.0	36.4	
3750	72	107.9	6.4	94.2	78.3	62.4	46.5	-	-	97.5	7.3	87.6	73.0	58.4	43.8	-	-
	67	95.8	6.4	95.8	95.8	80.6	64.6	48.7	-	87.0	7.3	87.0	87.0	76.6	62.0	47.4	-
	62	88.4	6.3	88.4	88.4	88.4	72.5	56.6	40.7	81.3	7.2	81.3	81.3	66.7	52.1	37.5	
	57	88.2	6.3	88.2	88.2	88.2	72.3	56.4	40.5	80.2	7.2	80.2	80.2	65.6	51.0	36.4	

XYE08 (7.5 Ton) (Continued)

Air on Evaporator Coil		Temperature of Air on Condenser Coil															
		Total Capacity ¹ (MBh)	Total Input (kW) ²	Sensible Capacity (MBh)						Total Capacity ¹ (MBh)	Total Input (kW) ²	Sensible Capacity (MBh)					
				Return Dry Bulb (°F)									Return Dry Bulb (°F)				
		115°F														125°F	
1875	77	82.8	8.1	33.9	31.2	23.7	-	-	-	71.0	9.0	33.1	26.4	20.6	-	-	-
	72	75.1	8.1	50.6	43.1	35.6	28.1	-	-	64.9	8.9	45.9	39.1	32.2	25.4	-	-
	67	67.4	8.1	67.2	54.9	47.4	39.9	32.4	-	58.7	8.9	58.7	50.7	43.9	37.0	30.2	-
	62	64.1	8.0	64.1	54.4	46.9	39.4	31.9	-	57.0	8.8	57.0	57.0	48.7	41.9	35.1	28.2
2250	77	86.5	8.2	43.9	35.1	26.3	-	-	-	75.0	9.0	42.6	31.2	23.1	-	-	-
	72	78.5	8.1	57.1	48.3	39.6	30.8	-	-	68.5	9.0	52.3	44.2	36.2	28.1	-	-
	67	70.4	8.1	70.3	61.5	52.8	44.0	35.2	-	62.0	8.9	62.0	57.3	49.2	41.2	33.1	-
	62	66.9	8.0	66.9	66.9	60.5	51.7	42.9	34.1	60.1	8.9	60.1	60.1	54.7	46.6	38.6	30.5
	57	65.1	8.0	65.1	65.1	58.8	50.0	41.3	32.5	57.4	8.9	57.4	57.4	52.2	44.1	36.1	28.0
2625	77	90.2	8.2	53.9	39.1	29.0	-	-	-	79.0	9.0	52.1	35.9	25.6	-	-	-
	72	81.8	8.2	63.6	53.6	43.5	33.5	-	-	72.1	9.0	58.7	49.4	40.1	30.8	-	-
	67	73.5	8.1	73.4	68.1	58.1	48.0	38.0	-	65.3	9.0	65.3	63.9	54.6	45.3	36.0	-
	62	69.8	8.1	69.8	69.8	66.6	56.5	46.5	36.4	63.2	8.9	63.2	63.2	60.7	51.4	42.1	32.8
	57	67.9	8.0	67.9	64.8	54.7	44.6	34.6	-	60.5	8.9	60.5	60.5	57.9	48.6	39.3	30.0
3000	77	93.9	8.2	63.9	43.0	31.7	-	-	-	83.0	9.1	61.7	40.6	28.2	-	-	-
	72	85.2	8.2	70.2	58.9	47.5	36.2	-	-	75.7	9.0	65.1	54.6	44.0	33.5	-	-
	67	76.5	8.1	76.5	74.7	63.4	52.1	40.7	-	68.5	9.0	68.5	68.5	59.9	49.4	38.8	-
	62	72.7	8.1	72.7	72.7	72.7	61.3	50.0	38.7	66.4	9.0	66.4	66.4	56.1	45.6	35.1	-
	57	70.7	8.1	70.7	70.7	59.4	48.0	36.7	-	63.5	8.9	63.5	63.5	53.1	42.6	32.0	-
3375	72	86.1	8.2	75.6	63.3	51.0	38.7	-	-	76.2	9.1	69.8	58.5	47.3	36.0	-	-
	67	77.3	8.2	77.3	76.4	68.0	55.7	43.4	-	68.9	9.0	68.9	68.9	64.3	53.1	41.8	-
	62	73.5	8.1	73.5	73.5	61.2	48.8	36.5	-	66.8	9.0	66.8	66.8	66.8	55.7	44.4	33.1
	57	71.4	8.1	71.4	71.4	59.1	46.8	34.5	-	63.9	9.0	63.9	63.9	52.7	41.4	30.2	-
3750	72	87.0	8.2	81.1	67.8	54.5	41.2	-	-	76.6	9.1	74.5	62.5	50.5	38.5	-	-
	67	78.1	8.2	78.1	78.1	72.7	59.4	46.1	-	69.3	9.0	69.3	69.3	68.7	56.7	44.8	-
	62	74.3	8.1	74.3	74.3	74.3	61.0	47.7	34.4	67.2	9.0	67.2	67.2	55.2	43.2	31.2	-
	57	72.2	8.1	72.2	72.2	72.2	58.9	45.6	32.3	64.2	9.0	64.2	64.2	52.2	40.3	28.3	-

- These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate Blower Performance Table for the kW of the supply air blower motor.
- These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

XYE09 (8.5 Ton)

Air on Evaporator Coil		Temperature of Air on Condenser Coil															
		Total Capacity ¹ (MBh)	Total Input (kW) ²	Sensible Capacity (MBh)						Total Capacity ¹ (MBh)	Total Input (kW) ²	Sensible Capacity (MBh)					
				Return Dry Bulb (°F)									Return Dry Bulb (°F)				
		75°F														85°F	
2125	77	131.1	5.8	57.6	48.1	39.3	-	-	-	122.6	6.6	54.6	45.8	37.0	-	-	-
	72	119.4	5.7	70.5	61.7	52.9	44.1	-	-	111.9	6.5	68.1	59.4	50.6	41.8	-	-
	67	107.8	5.5	83.5	75.4	66.5	57.7	48.9	-	101.1	6.4	81.7	72.9	64.1	55.3	46.6	-
	62	99.7	5.5	99.7	94.3	80.6	71.8	63.0	54.2	93.6	6.4	93.6	91.0	77.5	68.7	59.9	51.2
2550	77	135.4	5.8	63.5	53.2	42.9	-	-	-	126.6	6.6	60.9	50.7	40.4	-	-	-
	72	123.4	5.7	78.4	68.1	57.9	47.6	-	-	115.5	6.5	75.7	65.5	55.2	45.0	-	-
	67	111.4	5.6	93.3	83.1	72.8	62.5	52.2	-	104.4	6.4	90.5	80.3	70.0	59.8	49.6	-
	62	103.0	5.5	103.0	99.4	88.2	77.9	67.6	57.4	96.7	6.4	96.7	94.9	84.6	74.4	64.2	53.9
	57	101.3	5.5	101.3	90.9	80.7	70.4	60.1	96.4	6.3	96.4	96.4	86.4	76.1	65.9	55.7	
2975	77	139.7	5.9	69.4	58.3	46.6	-	-	-	130.6	6.7	67.2	55.5	43.8	-	-	-
	72	127.3	5.7	86.3	74.5	62.8	51.1	-	-	119.1	6.6	83.3	71.6	59.9	48.2	-	-
	67	114.9	5.6	103.1	90.7	79.0	67.3	55.6	-	107.6	6.5	99.3	87.6	75.9	64.2	52.6	-
	62	106.3	5.6	106.3	104.5	95.7	84.0	72.3	60.6	99.7	6.4	99.7	98.8	91.8	80.1	68.4	56.7
	57	104.5	5.5	104.5	104.5	98.7	87.0	75.3	63.6	99.4	6.4	99.4	99.4	93.6	82.0	70.3	58.6
3400	77	144.0	5.9	75.4	63.5	50.3	-	-	-	134.5	6.7	73.5	60.4	47.3	-	-	-
	72	131.2	5.8	94.1	80.9	67.8	54.6	-	-	122.7	6.6	90.8	77.7	64.5	51.4	-	-
	67	118.5	5.6	112.9	98.4	85.2	72.1	58.9	-	110.9	6.5	108.1	95.0	81.8	68.7	55.6	-
	62	109.6	5.6	109.6	103.3	90.1	76.9	63.8	60.6	102.7	6.4	102.7	102.7	98.9	85.8	72.7	59.5
	57	107.8	5.6	107.8	106.5	93.3	80.2	67.0	60.6	102.5	6.4	102.5	100.9	87.8	74.7	61.5	
3825	72	133.7	5.8	101.0	86.6	72.3	57.9	-	-	124.7	6.6	97.7	83.4	69.0	54.7	-	-
	67	120.7	5.7	117.9	105.2	90.9	76.5	62.2	-	112.7	6.5	111.3	101.9	87.5	73.2	58.9	-
	62	111.6	5.6	111.6	111.6	108.5	94.2	79.8	65.5	104.4	6.5	104.4	104.4	102.5	88.2	73.8	59.5
	57	109.8	5.6	109.8	109.8	109.2	94.9	80.5	66.2	104.1	6.4	104.1	104.1	103.3	89.0	74.7	60.4
	72	136.2	5.8	107.8	92.3	76.7	61.2	-	-	126.6	6.6	104.5	89.0	73.5	58.1	-	-
4250	72	123.0	5.7	123.0	112.0	96.5	81.0	65.5	-	114.4	6.5	114.4	108.7	93.2	77.8	62.3	-
	67	113.7	5.7	113.7	113.7	113.7	98.2	82.7	67.2	106.0	6.5	106.0	106.0	106.0	90.5	75.0	59.6
	62	111.9	5.6	111.9	111.9	111.9	96.4	80.8	65.3	105.7	6.4	105.7	105.7	105.7	90.2	74.8	59.3
	57	111.9	5.6	111.9	111.9	111.9	96.4	80.8	65.3	105.7	6.4	105.7	105.7	105.7	90.2	74.8	59.3
		95°F														105°F	
2125	77	114.2	7.4	51.6	43.5	34.8	-	-	-	102.8	8.4	44.4	38.9	30.2	-	-	-
	72	104.3	7.3	65.7	57.0	48.2	39.5	-	-	94.8	8.4	61.4	52.7	44.1	35.4	-	-
	67	94.4	7.3	79.8	70.4	61.7	53.0	44.2	-	86.8	8.3	78.4	66.6	58.0	49.3	40.6	-
	62	87.6	7.2	87.6	87.6	74.4	65.6	56.9	48.2	81.7	8.2	81.7	81.7	67.9	59.3	50.6	41.9
2550	77	117.8	7.4	58.3	48.1	37.9	-	-	-	106.3	8.4	53.6	43.4	33.2	-	-	-
	72	107.6	7.4	73.0	62.8	52.6	42.4	-	-	98.0	8.4	68.9	58.7	48.5	38.3	-	-
	67	97.4	7.3	87.7	77.5	67.3	57.1	46.9	-	89.8	8.3	84.2	74.0	63.8	53.6	43.5	-
	62	90.4	7.2	90.4	90.4	81.1	70.9	60.7	50.5	84.5	8.2	84.5	84.5	74.8	64.6	54.4	44.2
	57	91.5	7.2	91.5	91.5	81.8	71.6	61.4	51.2	85.0	8.2	85.0	85.0	75.1	64.9	54.8	44.6
2975	77	121.5	7.4	65.0	52.7	41.1	-	-	-	109.9	8.4	62.8	47.9	36.2	-	-	-
	72	110.9	7.4	80.3	68.6	57.0	45.3	-	-	101.3	8.4	76.4	64.7	53.0	41.3	-	-
	67	100.3	7.3	95.5	84.5	72.9	61.2	49.6	-	92.8	8.3	90.0	81.4	69.7	58.0	46.3	-
	62	93.1	7.2	93.1	93.1	87.8	76.2	64.5	52.9	87.4	8.2	87.4	87.3	81.6	69.9	58.2	46.5
	57	94.4	7.2	94.4	94.4	88.5	76.9	65.3	53.6	87.8	8.2	87.8	87.8	82.0	70.3	58.6	46.9
3400	77	125.1	7.4	71.7	57.3	44.2	-	-	-	113.4	8.5	72.0	52.5	39.2	-	-	-
	72	114.2	7.4	87.5	74.4	61.3	48.2	-	-	104.6	8.4	83.9	70.6	57.4	44.2	-	-
	67	103.3	7.3	103.3	91.5	78.4	65.3	52.2	-	95.8	8.4	95.8	88.8	75.6	62.3	49.1	-
	62	95.9	7.3	95.9	95.9	94.6	81.5	68.4	55.3	90.2	8.2	90.2	90.2	88.5	75.2	62.0	48.8
	57	97.2	7.2	97.2	97.2	95.3	82.2	69.1	56.0	90.7	8.2	90.7	90.7	88.9	75.6	62.4	49.2
3825	72	115.6	7.4	94.4	80.1	65.8	51.6	-	-	105.6	8.4	90.0	75.7	61.5	47.2	-	-
	67	104.6	7.4	104.6	98.5	84.2	69.9	55.7	-	96.6	8.4	96.6	93.0	80.9	66.6	52.4	-
	62	97.1	7.3	97.1	97.1	96.4	82.1	67.9	53.6	91.0	8.3	91.0	91.0	90.2	75.9	61.6	47.4
	57	98.4	7.2	98.4	98.4	97.4	83.2	68.9	54.6	91.5	8.2	91.5	91.5	90.6	76.3	62.1	47.8
4250	72	117.0	7.4	101.2	85.8	70.4	54.9	-	-	106.5	8.4	96.1	80.8	65.5	50.2	-	-
	67	105.9	7.4	105.9	105.4	90.0	74.5	59.1	-	97.5	8.4	97.5	97.3	86.2	71.0	55.7	-
	62	98.2	7.3	98.2	98.2	98.2	82.8	67.4	51.9	91.8	8.3	91.8	91.8	76.6	61.3	46.0	
	57	99.5	7.3	99.5	99.5	99.5	84.1	68.7	53.2	92.3	8.3	92.3	92.3	92.3	77.1	61.8	46.5

XYE09 (8.5 Ton) (Continued)

Air on Evaporator Coil		Temperature of Air on Condenser Coil															
		Total Capacity ¹ (MBh)	Total Input (kW) ²	Sensible Capacity (MBh)						Total Capacity ¹ (MBh)	Total Input (kW) ²	Sensible Capacity (MBh)					
				Return Dry Bulb (°F)								Return Dry Bulb (°F)					
115°F																	
2125	77	91.3	9.4	37.2	34.2	25.6	-	-	-	79.9	10.4	34.1	28.2	21.0	-	-	-
	72	85.2	9.4	57.1	48.5	39.9	31.3	-	-	75.7	10.4	52.8	44.3	35.8	27.2	-	-
	67	79.2	9.3	77.1	62.9	54.3	45.7	37.1	-	71.6	10.3	71.6	59.1	50.5	42.0	33.5	-
	62	75.8	9.2	75.8	75.7	61.5	52.9	44.3	35.7	70.0	10.2	70.0	69.8	55.1	46.5	38.0	29.5
2550	77	94.8	9.4	48.9	38.7	28.5	-	-	-	83.3	10.5	46.9	33.9	23.7	-	-	-
	72	88.5	9.4	64.8	54.6	44.4	34.3	-	-	78.9	10.4	60.7	50.5	40.4	30.2	-	-
	67	82.2	9.3	80.8	70.6	60.4	50.2	40.0	-	74.6	10.4	74.6	67.1	57.0	46.8	36.6	-
	62	78.7	9.2	78.7	78.6	68.5	58.3	48.1	37.9	72.9	10.2	72.9	72.8	62.1	51.9	41.8	31.6
	57	78.4	9.2	78.4	78.4	68.5	58.3	48.1	37.9	71.9	10.2	71.9	71.9	61.9	51.7	41.5	31.3
2975	77	98.3	9.5	60.5	43.1	31.4	-	-	-	86.7	10.5	59.7	39.7	26.5	-	-	-
	72	91.7	9.4	72.5	60.7	49.0	37.2	-	-	82.1	10.4	68.6	56.8	44.9	33.1	-	-
	67	85.2	9.4	84.5	78.3	66.5	54.8	43.0	-	77.6	10.4	77.6	75.2	63.4	51.5	39.7	-
	62	81.6	9.2	81.6	81.6	75.4	63.6	51.9	40.1	75.8	10.2	75.8	75.8	69.2	57.4	45.5	33.7
	57	81.3	9.2	81.3	81.3	75.5	63.7	51.9	40.1	74.8	10.2	74.8	74.8	68.9	57.1	45.2	33.4
3400	77	101.8	9.5	72.2	47.6	34.3	-	-	-	90.1	10.5	72.4	45.4	29.3	-	-	-
	72	95.0	9.4	80.2	66.8	53.5	40.1	-	-	85.4	10.4	76.5	63.0	49.5	36.0	-	-
	67	88.2	9.4	88.2	86.0	72.7	59.3	46.0	-	80.6	10.4	80.6	80.6	69.8	56.3	42.8	-
	62	84.5	9.2	84.5	84.5	82.4	69.0	55.7	42.3	78.8	10.2	78.8	78.8	76.3	62.8	49.3	35.8
	57	84.2	9.2	84.2	84.2	82.4	69.1	55.7	42.3	77.7	10.2	77.7	77.7	76.0	62.5	49.0	35.5
3825	72	95.5	9.4	85.6	71.3	57.1	42.8	-	-	85.5	10.4	81.2	66.9	52.7	38.5	-	-
	67	88.7	9.4	88.7	87.6	77.6	63.3	49.1	-	80.7	10.4	80.7	80.7	74.3	60.0	45.8	-
	62	85.0	9.2	85.0	85.0	83.9	69.7	55.4	41.2	78.9	10.2	78.9	78.9	77.7	63.4	49.2	35.0
	57	84.7	9.2	84.7	84.7	83.8	69.5	55.3	41.0	77.8	10.3	77.8	77.8	76.9	62.7	48.5	34.2
4250	72	96.0	9.4	90.9	75.8	60.7	45.6	-	-	85.6	10.4	85.6	70.8	55.9	40.9	-	-
	67	89.2	9.4	89.2	89.2	82.5	67.4	52.2	-	80.9	10.4	80.9	80.9	78.8	63.8	48.8	-
	62	85.4	9.2	85.4	85.4	85.4	70.3	55.2	40.1	79.0	10.2	79.0	79.0	64.1	49.1	34.1	
	57	85.1	9.3	85.1	85.1	85.1	70.0	54.9	39.8	77.9	10.3	77.9	77.9	63.0	48.0	33.0	

1. These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate Blower Performance Table for the kW of the supply air blower motor.

2. These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

XXEA7 (6.0 Ton)

Air on Evaporator Coil		Temperature of Air on Condenser Coil															
		Total Capacity ¹ (MBh)	Total Input (kW) ²	Sensible Capacity (MBh)						Total Capacity ¹ (MBh)	Total Input (kW) ²	Sensible Capacity (MBh)					
				Return Dry Bulb (°F)								Return Dry Bulb (°F)					
75°F																85°F	
1500	77	87.8	4.2	42.7	35.7	28.9	-	-	-	83.4	4.9	35.9	30.7	24.0	-	-	-
	72	81.3	4.1	50.8	44.0	37.2	30.4	-	-	76.8	4.8	46.9	40.3	33.6	27.0	-	-
	67	74.7	4.0	59.0	52.4	45.6	38.8	32.0	-	70.2	4.7	58.0	49.9	43.2	36.6	29.9	-
	62	67.1	3.9	67.1	65.8	54.1	47.3	40.5	33.7	64.3	4.6	64.3	62.5	50.9	44.3	37.6	31.0
1800	77	90.5	4.3	47.9	40.1	32.3	-	-	-	85.8	4.9	42.5	34.7	27.0	-	-	-
	72	83.8	4.2	57.2	49.4	41.7	33.9	-	-	79.0	4.8	53.3	45.5	37.8	30.1	-	-
	67	77.0	4.1	66.6	58.8	51.0	43.2	35.4	-	72.2	4.7	64.1	56.3	48.6	40.9	33.1	-
	62	69.2	3.9	69.2	68.3	60.5	52.7	44.9	37.1	66.2	4.6	66.2	65.0	57.2	49.5	41.8	34.0
	57	69.9	4.0	69.9	68.9	61.1	53.3	45.5	37.7	66.5	4.6	66.5	65.3	57.5	49.8	42.1	34.3
2100	77	93.2	4.4	53.2	44.6	35.8	-	-	-	88.2	4.9	49.0	38.8	30.0	-	-	-
	72	86.3	4.3	63.6	54.9	46.1	37.3	-	-	81.2	4.8	59.6	50.8	42.0	33.1	-	-
	67	79.4	4.2	74.1	65.1	56.4	47.6	38.8	-	74.2	4.8	70.2	62.8	54.0	45.1	36.3	-
	62	71.3	4.0	71.3	70.8	66.9	58.2	49.4	40.6	68.0	4.6	68.0	67.4	63.5	54.7	45.9	37.1
	57	72.0	4.0	72.0	71.5	67.6	58.8	50.0	41.3	68.4	4.7	68.4	67.7	63.9	55.0	46.2	37.4
2400	77	96.0	4.4	58.4	49.0	39.3	-	-	-	90.6	5.0	55.6	42.8	32.9	-	-	-
	72	88.8	4.3	70.0	60.3	50.5	40.8	-	-	83.4	4.9	65.9	56.0	46.1	36.2	-	-
	67	81.7	4.2	81.7	71.5	61.8	52.0	42.2	-	76.2	4.8	76.2	69.2	59.3	49.4	39.5	-
	62	73.3	4.1	73.3	73.3	73.3	63.6	53.8	44.1	69.8	4.7	69.8	69.8	59.9	50.0	40.1	
	57	74.1	4.1	74.1	74.1	64.3	54.6	44.8	-	70.2	4.7	70.2	70.2	60.3	50.4	40.5	
2700	72	90.8	4.3	74.7	63.7	52.8	41.8	-	-	84.5	4.9	70.5	59.4	48.3	37.2	-	-
	67	83.5	4.2	83.5	77.4	64.5	53.5	42.5	-	77.2	4.8	77.2	73.2	62.1	51.0	39.9	-
	62	75.0	4.1	75.0	75.0	75.0	64.1	53.1	42.1	70.8	4.7	70.8	70.8	59.7	48.6	37.5	
	57	75.8	4.1	75.8	75.8	75.8	64.8	53.8	42.8	71.1	4.7	71.1	71.1	60.0	48.9	37.8	
3000	72	92.9	4.4	79.4	67.2	55.0	42.8	-	-	85.6	5.0	75.1	62.8	50.5	38.2	-	-
	67	85.4	4.3	85.4	83.3	67.2	55.0	42.8	-	78.2	4.9	78.2	77.2	64.9	52.6	40.3	-
	62	76.7	4.1	76.7	76.7	76.7	64.5	52.3	40.1	71.7	4.8	71.7	71.7	59.4	47.1	34.8	
	57	77.5	4.1	77.5	77.5	77.5	65.3	53.1	40.9	72.0	4.8	72.0	72.0	59.7	47.4	35.2	
95°F																105°F	
1500	77	79.1	5.5	29.1	25.7	19.2	-	-	-	72.9	6.2	27.2	24.6	18.3	-	-	-
	72	72.4	5.4	43.0	36.5	30.0	23.5	-	-	66.8	6.1	41.8	35.3	28.8	22.3	-	-
	67	65.7	5.3	57.0	47.4	40.9	34.4	27.9	-	60.7	6.0	56.4	45.9	39.2	32.7	26.2	-
	62	61.6	5.2	61.6	59.3	47.8	41.3	34.8	28.3	57.7	6.0	57.7	56.6	45.3	38.8	32.3	25.8
1800	77	81.1	5.5	37.0	29.3	21.6	-	-	-	74.7	6.2	36.1	28.3	20.6	-	-	-
	72	74.2	5.4	49.3	41.6	33.9	26.3	-	-	68.4	6.1	47.7	40.0	32.3	24.6	-	-
	67	67.4	5.3	61.6	53.9	46.2	38.6	30.9	-	62.2	6.0	59.3	51.7	44.0	36.3	28.6	-
	62	63.2	5.3	63.2	61.6	54.0	46.3	38.6	30.9	59.1	6.0	59.1	58.3	50.8	43.1	35.4	27.7
	57	63.2	5.3	63.2	61.6	54.0	46.3	38.6	30.9	59.0	6.0	59.0	58.1	50.4	42.7	35.0	27.3
2100	77	83.1	5.5	44.9	33.0	24.1	-	-	-	76.4	6.3	45.0	31.9	22.8	-	-	-
	72	76.1	5.4	55.6	46.7	37.8	29.0	-	-	70.0	6.2	53.6	44.7	35.8	26.9	-	-
	67	69.1	5.4	66.2	60.4	51.5	42.7	33.8	-	63.6	6.1	62.2	57.4	48.7	39.8	30.9	-
	62	64.8	5.3	64.8	64.0	60.2	51.3	42.4	33.6	60.5	6.0	60.5	60.1	56.3	47.4	38.5	29.6
	57	64.7	5.3	64.7	64.0	60.1	51.3	42.4	33.5	60.3	6.0	60.3	59.9	55.9	47.0	38.1	29.2
2400	77	85.2	5.6	52.8	36.6	26.6	-	-	-	78.2	6.3	53.8	35.6	25.0	-	-	-
	72	78.0	5.5	61.8	51.8	41.7	31.7	-	-	71.6	6.2	59.5	49.4	39.3	29.2	-	-
	67	70.8	5.4	70.8	66.9	56.8	46.8	36.7	-	65.1	6.1	65.1	63.1	53.5	43.4	33.3	-
	62	66.3	5.3	66.3	66.3	66.3	56.3	46.3	36.2	61.8	6.0	61.8	61.8	51.8	41.7	31.6	
	57	66.3	5.3	66.3	66.3	66.3	56.3	46.2	36.2	61.7	6.0	61.7	61.7	51.2	41.1	31.1	
2700	72	78.1	5.5	66.2	55.0	43.8	32.6	-	-	71.7	6.2	63.7	52.8	41.5	30.2	-	-
	67	70.9	5.4	70.9	69.0	59.7	48.5	37.3	-	65.1	6.1	65.1	64.2	56.6	45.2	33.9	-
	62	66.5	5.4	66.5	66.5	66.5	55.3	44.0	32.8	61.9	6.1	61.9	61.9	50.5	39.2	27.9	
	57	66.5	5.4	66.5	66.5	66.5	55.2	44.0	32.8	61.7	6.1	61.7	61.7	50.2	38.9	27.5	
	72	78.3	5.6	70.7	58.3	45.9	33.6	-	-	71.7	6.3	67.9	56.3	43.7	31.2	-	-
3000	67	71.0	5.5	71.0	71.0	62.6	50.2	37.8	-	65.2	6.2	65.2	65.2	59.6	47.0	34.4	-
	62	66.6	5.4	66.6	66.6	66.6	54.2	41.8	29.5	61.9	6.2	61.9	61.9	49.3	36.7	24.2	
	57	66.6	5.4	66.6	66.6	66.6	54.2	41.8	29.5	61.8	6.1	61.8	61.8	49.2	36.6	24.0	

XXEA7 (6.0 Ton) (Continued)

Air on Evaporator Coil		Temperature of Air on Condenser Coil																
		Total Capacity ¹ (MBh)	Total Input (kW) ²	Sensible Capacity (MBh)						Total Capacity ¹ (MBh)	Total Input (kW) ²	Sensible Capacity (MBh)						
				Return Dry Bulb (°F)									Return Dry Bulb (°F)					
115°F																		
1500	77	66.8	7.0	25.3	23.6	17.5	-	-	-	60.7	7.7	27.7	21.5	16.7	-	-	-	
	72	61.3	6.9	40.5	34.0	27.5	21.0	-	-	55.8	7.6	39.2	32.7	26.2	19.7	-	-	
	67	55.8	6.7	55.8	44.4	37.5	30.9	24.4	-	50.8	7.5	50.8	42.9	35.7	29.2	22.7	-	
	62	53.8	6.7	53.8	53.8	42.8	36.3	29.8	23.3	49.9	7.4	49.9	49.9	40.3	33.8	27.3	20.7	
1800	77	68.3	7.0	35.1	27.2	19.5	-	-	-	61.9	7.7	37.1	26.2	18.4	-	-	-	
	72	62.6	6.9	46.0	38.3	30.6	22.9	-	-	56.8	7.6	44.4	36.7	28.9	21.2	-	-	
	67	57.0	6.8	57.0	49.4	41.7	34.0	26.3	-	51.8	7.5	51.8	47.2	39.4	31.7	23.9	-	
	62	55.0	6.7	55.0	55.0	47.6	39.9	32.2	24.5	50.9	7.4	50.9	50.9	44.5	36.7	29.0	21.3	
	57	54.7	6.7	54.7	54.5	46.8	39.1	31.4	23.6	50.5	7.4	50.5	50.5	43.2	35.5	27.8	20.0	
2100	77	69.8	7.0	45.0	30.9	21.5	-	-	-	63.1	7.7	46.5	30.8	20.2	-	-	-	
	72	64.0	6.9	51.6	42.6	33.7	24.8	-	-	57.9	7.6	49.6	40.6	31.7	22.7	-	-	
	67	58.2	6.8	58.2	54.4	45.9	37.0	28.1	-	52.7	7.5	52.7	51.4	43.2	34.2	25.2	-	
	62	56.2	6.7	56.2	56.2	52.5	43.6	34.6	25.7	51.9	7.4	51.9	51.9	48.7	39.7	30.7	21.8	
	57	55.9	6.7	55.9	55.8	51.6	42.6	33.7	24.8	51.5	7.3	51.5	51.5	47.3	38.3	29.4	20.4	
2400	77	71.2	7.0	54.8	34.6	23.5	-	-	-	64.2	7.7	55.8	35.5	21.9	-	-	-	
	72	65.3	6.9	57.1	47.0	36.8	26.7	-	-	59.0	7.6	54.8	44.6	34.4	24.2	-	-	
	67	59.4	6.8	59.4	59.4	50.2	40.1	29.9	-	53.7	7.5	53.7	53.7	46.9	36.7	26.5	-	
	62	57.3	6.7	57.3	57.3	57.3	47.2	37.1	26.9	52.8	7.4	52.8	52.8	42.7	32.5	22.3	-	
	57	57.1	6.7	57.1	57.1	56.3	46.2	36.1	25.9	52.5	7.3	52.5	52.5	51.4	41.2	31.0	20.8	
2700	72	65.2	7.0	61.1	50.7	39.2	27.7	-	-	58.8	7.7	58.6	48.5	36.9	25.3	-	-	
	67	59.3	6.9	59.3	59.3	53.4	41.9	30.5	-	53.6	7.6	53.6	53.6	50.2	38.7	27.1	-	
	62	57.3	6.8	57.3	57.3	57.3	45.8	34.4	22.9	52.7	7.5	52.7	52.7	41.1	29.5	17.9	-	
	57	57.0	6.8	57.0	57.0	56.7	45.2	33.7	22.3	52.3	7.5	52.3	52.3	51.8	40.2	28.6	17.0	
3000	72	65.2	7.1	65.2	54.3	41.5	28.8	-	-	58.6	7.8	58.6	52.4	39.4	26.3	-	-	
	67	59.3	6.9	59.3	59.3	56.6	43.8	31.0	-	53.4	7.7	53.4	53.4	53.4	40.6	27.6	-	
	62	57.2	6.9	57.2	57.2	57.2	44.4	31.7	18.9	52.6	7.6	52.6	52.6	52.6	39.6	26.6	13.6	
	57	57.0	6.8	57.0	57.0	57.0	44.2	31.4	18.6	52.2	7.6	52.2	52.2	52.2	39.2	26.2	13.2	

1. These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate Blower Performance Table for the kW of the supply air blower motor.

2. These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

XXE08 (7.5 Ton)

Air on Evaporator Coil		Temperature of Air on Condenser Coil																
		Total Capacity ¹ (MBh)	Total Input (kW) ²	Sensible Capacity (MBh)						Total Capacity ¹ (MBh)	Total Input (kW) ²	Sensible Capacity (MBh)						
				Return Dry Bulb (°F)									Return Dry Bulb (°F)					
75°F																85°F		
1875	77	120.0	5.6	56.2	46.4	37.6	-	-	-	113.6	6.3	51.7	42.9	34.1	-	-	-	
	72	110.4	5.5	67.3	58.5	49.6	40.8	-	-	104.2	6.2	64.1	55.3	46.5	37.7	-	-	
	67	100.9	5.3	78.4	70.5	61.7	52.9	44.1	-	94.9	6.1	76.5	67.7	58.9	50.1	41.3	-	
	62	93.8	5.3	93.8	93.8	87.2	76.8	67.9	59.1	87.4	6.1	87.4	83.9	70.8	62.0	53.2	44.4	
2250	77	123.4	5.6	61.2	51.0	40.9	-	-	-	116.8	6.3	57.5	47.4	37.3	-	-	-	
	72	113.6	5.5	74.3	64.2	54.0	43.9	-	-	107.2	6.3	71.1	60.9	50.8	40.7	-	-	
	67	103.8	5.4	87.5	77.3	67.2	57.0	46.8	-	97.5	6.2	84.6	74.5	64.4	54.2	44.1	-	
	62	96.5	5.3	96.5	96.5	93.2	83.1	72.9	62.7	89.8	6.1	89.8	87.5	77.4	67.2	57.1	47.0	
	57	97.0	5.3	97.0	93.6	83.4	73.3	63.1	53.0	91.2	6.1	91.2	88.6	78.4	68.3	58.2	48.1	
2625	77	126.9	5.6	66.3	55.7	44.2	-	-	-	120.0	6.4	63.4	51.9	40.4	-	-	-	
	72	116.8	5.5	81.4	69.9	58.4	46.9	-	-	110.1	6.3	78.0	66.6	55.1	43.7	-	-	
	67	106.7	5.4	96.6	84.1	72.6	61.1	49.6	-	100.2	6.2	92.7	81.3	69.8	58.4	46.9	-	
	62	99.2	5.3	99.2	99.2	99.2	89.4	77.9	66.4	92.3	6.1	92.3	91.1	83.9	72.5	61.0	49.5	
	57	99.7	5.3	99.7	98.0	90.2	78.7	67.2	55.7	93.7	6.1	93.7	92.4	85.1	73.6	62.2	50.7	
3000	77	130.3	5.7	71.3	60.4	47.5	-	-	-	123.2	6.4	69.2	56.4	43.6	-	-	-	
	72	120.0	5.6	88.5	75.6	62.8	49.9	-	-	113.0	6.3	85.0	72.2	59.4	46.6	-	-	
	67	109.6	5.4	105.7	90.9	78.0	65.2	52.3	-	102.8	6.2	100.9	88.1	75.3	62.5	49.7	-	
	62	101.9	5.4	101.9	101.9	101.9	95.7	82.8	70.0	94.7	6.2	94.7	94.7	90.5	77.7	64.9	52.1	
	57	102.4	5.4	102.4	102.4	97.0	84.1	71.3	58.4	96.1	6.1	96.1	91.7	78.9	66.1	53.3	-	
3375	72	122.7	5.6	95.9	81.7	67.5	53.3	-	-	115.2	6.3	91.8	77.8	63.7	49.6	-	-	
	67	112.1	5.4	110.1	98.1	83.9	69.7	55.6	-	104.9	6.2	103.9	94.7	80.7	66.6	52.5	-	
	62	104.2	5.4	104.2	104.2	104.2	97.5	83.3	69.1	96.6	6.2	96.6	96.6	94.5	80.4	66.3	52.3	
	57	104.7	5.4	104.7	104.7	102.0	87.8	73.6	59.4	98.1	6.1	98.1	95.9	81.8	67.7	53.6	-	
3750	72	125.4	5.6	103.3	87.8	72.3	56.7	-	-	117.5	6.3	98.7	83.3	68.0	52.6	-	-	
	67	114.5	5.4	114.5	105.3	89.8	74.3	58.8	-	106.9	6.2	106.9	101.4	86.1	70.7	55.4	-	
	62	106.5	5.4	106.5	106.5	106.5	99.3	83.8	68.3	98.5	6.2	98.5	98.5	83.2	67.8	52.5	-	
	57	107.0	5.4	107.0	107.0	107.0	91.5	76.0	60.5	100.0	6.1	100.0	100.0	84.6	69.3	53.9	-	
	95°F																105°F	
1875	77	107.3	7.1	47.2	39.4	30.7	-	-	-	99.5	8.1	42.3	36.9	28.2	-	-	-	
	72	98.0	7.0	60.9	52.1	43.4	34.6	-	-	90.9	8.0	58.0	49.4	40.7	32.1	-	-	
	67	88.8	7.0	74.6	64.9	56.1	47.3	38.6	-	82.3	7.9	73.8	61.9	53.2	44.5	35.9	-	
	62	81.0	6.9	78.7	64.8	56.0	47.3	38.5	29.8	77.0	7.9	75.8	67.8	56.5	47.9	39.2	30.6	
2250	77	110.2	7.1	53.8	43.8	33.7	-	-	-	102.0	8.1	51.1	41.1	31.1	-	-	-	
	72	100.7	7.0	67.8	57.7	47.6	37.5	-	-	93.1	8.0	64.8	54.9	44.9	34.9	-	-	
	67	91.2	7.0	81.7	71.6	61.6	51.5	41.4	-	84.3	7.9	78.6	68.6	58.6	48.6	38.7	-	
	62	83.1	6.9	81.6	71.6	61.5	51.4	41.3	31.2	78.8	7.9	78.1	72.3	62.3	52.3	42.3	32.4	
	57	85.4	6.9	85.4	83.5	73.4	63.3	53.3	43.2	80.2	7.9	80.2	78.2	68.2	58.2	48.2	38.2	
2625	77	113.1	7.1	60.5	48.1	36.7	-	-	-	104.4	8.1	59.9	45.3	34.0	-	-	-	
	72	103.3	7.0	74.7	63.3	51.8	40.4	-	-	95.3	8.0	71.7	60.3	49.0	37.7	-	-	
	67	93.6	7.0	88.9	78.4	67.0	55.6	44.2	-	86.3	7.9	83.5	75.4	64.1	52.7	41.4	-	
	62	85.3	6.9	84.6	78.3	66.9	55.5	44.1	32.7	80.7	7.9	80.3	76.9	68.1	56.8	45.5	34.1	
	57	87.6	6.9	87.6	86.7	79.9	68.5	57.1	45.7	82.1	7.9	82.1	81.1	74.5	63.2	51.8	40.5	
3000	77	116.0	7.1	67.1	52.4	39.7	-	-	-	106.8	8.1	68.7	49.5	36.8	-	-	-	
	72	106.0	7.1	81.6	68.8	56.1	43.3	-	-	97.6	8.0	78.5	65.8	53.2	40.5	-	-	
	67	96.0	7.0	96.0	85.2	72.5	59.8	47.0	-	88.3	7.9	88.3	82.2	69.5	56.8	44.2	-	
	62	87.5	7.0	87.5	85.1	72.4	59.7	46.9	34.2	82.6	7.9	82.6	81.4	73.9	61.2	48.6	35.9	
	57	89.9	6.9	89.9	86.4	73.7	61.0	48.2	34.0	84.0	7.9	84.0	80.8	68.1	55.5	42.8	-	
3375	72	107.8	7.1	87.8	73.8	59.9	45.9	-	-	99.3	8.0	84.4	70.6	56.7	42.9	-	-	
	67	97.7	7.0	97.7	91.4	77.4	63.5	49.5	-	89.9	8.0	89.9	86.3	74.1	60.3	46.4	-	
	62	89.0	7.0	89.0	87.8	77.3	63.3	49.4	35.4	84.0	7.9	84.0	83.4	77.6	63.8	49.9	36.1	
	57	91.4	6.9	91.4	89.7	75.7	61.8	47.8	35.5	85.5	7.9	85.5	83.9	70.0	56.1	42.3	-	
	72	109.6	7.1	94.0	78.9	63.7	48.5	-	-	101.0	8.1	90.4	75.3	60.3	45.2	-	-	
3750	67	99.3	7.0	99.3	97.5	82.3	67.1	52.0	-	91.4	8.0	91.4	90.5	78.8	63.7	48.7	-	
	62	90.5	7.0	90.5	90.5	82.2	67.0	51.9	36.7	85.5	7.9	85.5	85.5	81.3	66.3	51.2	36.2	
	57	92.9	6.9	92.9	92.9	92.9	77.8	62.6	47.4	86.9	7.9	86.9	86.9	71.9	56.8	41.8	-	

XXE08 (7.5 Ton) (Continued)

Air on Evaporator Coil		Temperature of Air on Condenser Coil																
		Total Capacity ¹ (MBh)	Total Input (kW) ²	Sensible Capacity (MBh)						Total Capacity ¹ (MBh)	Total Input (kW) ²	Sensible Capacity (MBh)						
				Return Dry Bulb (°F)									Return Dry Bulb (°F)					
115°F																125°F		
1875	77	91.8	9.2	37.3	34.3	25.7	-	-	-	84.0	10.2	35.3	30.2	23.3	-	-	-	
	72	83.8	9.1	55.1	46.6	38.0	29.5	-	-	76.6	10.1	52.3	43.8	35.3	26.9	-	-	
	67	75.7	8.9	72.9	58.9	50.3	41.7	33.2	-	69.2	9.9	69.2	55.9	47.4	39.0	30.5	-	
	62	73.0	8.9	73.0	70.8	57.0	48.5	39.9	31.4	69.0	9.9	69.0	69.0	57.6	49.1	40.6	32.2	
2250	77	93.7	9.2	48.3	38.4	28.5	-	-	-	85.5	10.2	47.5	35.7	25.9	-	-	-	
	72	85.5	9.0	61.9	52.0	42.1	32.2	-	-	78.0	10.0	59.0	49.2	39.3	29.5	-	-	
	67	77.4	8.9	75.5	65.6	55.7	45.8	35.9	-	70.4	9.9	70.4	62.6	52.8	43.0	33.2	-	
	62	74.5	8.9	74.5	73.1	63.2	53.3	43.4	33.5	70.2	9.9	70.2	70.2	64.0	54.2	44.4	34.6	
2625	77	95.7	9.1	59.3	42.5	31.3	-	-	-	87.0	10.2	59.7	41.3	28.6	-	-	-	
	72	87.3	9.0	68.7	57.4	46.2	34.9	-	-	79.3	10.0	65.7	54.5	43.4	32.2	-	-	
	67	79.0	8.9	78.0	72.3	61.1	49.9	38.6	-	71.7	9.9	71.7	69.3	58.1	47.0	35.8	-	
	62	76.1	8.9	76.1	75.4	69.3	58.0	46.8	35.6	71.5	9.8	71.5	71.5	70.5	59.3	48.1	37.0	
3000	77	97.6	9.1	70.3	46.6	34.0	-	-	-	88.5	10.1	71.9	46.9	31.2	-	-	-	
	72	89.1	9.0	75.4	62.9	50.3	37.7	-	-	80.7	10.0	72.4	59.9	47.4	34.8	-	-	
	67	80.6	8.9	80.6	79.1	66.5	53.9	41.3	-	72.9	9.8	72.9	72.9	63.5	51.0	38.5	-	
	62	77.7	8.9	77.7	77.7	75.4	62.8	50.2	37.6	72.7	9.8	72.7	72.7	72.7	64.4	51.9	39.4	
3375	72	90.7	9.0	81.1	67.3	53.6	39.8	-	-	82.2	10.0	77.7	64.1	50.4	36.8	-	-	
	67	82.0	8.9	82.0	81.3	70.9	57.1	43.4	-	74.2	9.9	74.2	74.2	67.6	53.9	40.3	-	
	62	79.1	8.9	79.1	79.1	77.9	64.2	50.4	36.7	74.1	9.8	74.1	74.1	64.6	50.9	37.3	-	
	57	79.5	8.9	79.5	79.5	78.0	64.3	50.5	36.8	73.6	9.9	73.6	73.6	72.2	58.5	44.9	31.2	
3750	72	92.3	9.1	86.7	71.8	56.9	42.0	-	-	83.7	10.1	83.0	68.2	53.5	38.7	-	-	
	67	83.5	8.9	83.5	83.5	75.2	60.3	45.4	-	75.6	9.9	75.6	75.6	71.7	56.9	42.1	-	
	62	80.4	8.9	80.4	80.4	80.4	65.5	50.6	35.7	75.4	9.9	75.4	75.4	75.4	64.8	50.0	35.2	
	57	80.9	8.9	80.9	80.9	80.9	66.0	51.1	36.2	74.9	9.9	74.9	74.9	74.9	60.1	45.3	30.5	

1. These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate Blower Performance Table for the kW of the supply air blower motor.

2. These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

XXE09 (8.5 Ton)

Air on Evaporator Coil		Temperature of Air on Condenser Coil															
		Total Capacity ¹ (MBh)	Total Input (kW) ²	Sensible Capacity (MBh)						Total Capacity ¹ (MBh)	Total Input (kW) ²	Sensible Capacity (MBh)					
				Return Dry Bulb (°F)									Return Dry Bulb (°F)				
		75°F														85°F	
2125	77	133.7	5.9	60.4	49.9	40.4	-	-	-	122.4	6.7	56.1	46.5	36.9	-	-	-
	72	122.6	5.8	72.9	63.5	54.0	44.6	-	-	113.0	6.6	70.1	60.5	50.9	41.3	-	-
	67	111.5	5.7	85.4	77.1	67.6	58.1	48.7	-	103.6	6.6	84.1	74.5	64.9	55.3	45.8	-
	62	102.4	5.7	102.4	91.5	79.4	69.9	60.5	51.0	94.6	6.5	94.6	89.1	75.8	66.2	56.7	47.1
2550	77	137.0	5.9	65.7	54.9	44.0	-	-	-	126.1	6.8	62.3	51.3	40.3	-	-	-
	72	125.7	5.8	80.5	69.7	58.8	48.0	-	-	116.4	6.7	77.6	66.6	55.6	44.6	-	-
	67	114.3	5.8	95.3	84.5	73.6	62.8	51.9	-	106.7	6.6	92.9	81.9	70.9	59.9	48.8	-
	62	105.0	5.7	105.0	97.7	86.5	75.6	64.8	53.9	97.4	6.6	97.4	93.8	82.8	71.8	60.7	49.7
	57	103.4	5.7	103.4	101.5	90.6	79.7	68.9	58.0	98.1	6.5	98.1	97.0	86.0	75.0	63.9	52.9
2975	77	140.4	6.0	71.1	59.9	47.6	-	-	-	129.7	6.8	68.5	56.1	43.7	-	-	-
	72	128.8	5.9	88.1	75.9	63.6	51.4	-	-	119.8	6.7	85.1	72.7	60.2	47.8	-	-
	67	117.1	5.8	105.2	91.9	79.6	67.4	55.1	-	109.8	6.6	101.7	89.3	76.8	64.4	51.9	-
	62	107.6	5.8	107.6	103.9	93.5	81.3	69.0	56.8	100.2	6.6	100.2	98.4	89.7	77.3	64.8	52.4
	57	105.9	5.7	105.9	104.9	98.0	85.8	73.5	61.2	101.0	6.6	101.0	100.4	93.2	80.7	68.3	55.8
3400	77	143.8	6.0	76.4	64.9	51.2	-	-	-	133.4	6.8	74.8	60.9	47.0	-	-	-
	72	131.8	5.9	95.8	82.1	68.4	54.8	-	-	123.1	6.8	92.6	78.8	64.9	51.0	-	-
	67	119.9	5.9	115.1	99.3	85.7	72.0	58.3	-	112.9	6.7	110.5	96.6	82.8	68.9	55.0	-
	62	110.1	5.8	110.1	110.1	100.6	87.0	73.3	59.6	103.0	6.6	103.0	96.6	82.8	68.9	55.0	-
	57	108.4	5.8	108.4	108.4	105.4	91.8	78.1	64.5	103.8	6.6	103.8	100.4	86.5	72.6	58.8	-
3825	72	132.2	5.9	100.7	86.2	71.7	57.2	-	-	125.1	6.8	98.3	83.5	68.6	53.7	-	-
	67	120.2	5.9	117.8	104.2	89.7	75.2	60.7	-	114.7	6.7	113.5	102.3	87.5	72.6	57.7	-
	62	110.4	5.8	110.4	110.4	105.7	91.2	76.7	62.1	104.7	6.6	104.7	104.7	101.5	86.6	71.7	56.8
	57	108.6	5.8	108.6	108.6	107.1	92.6	78.1	63.6	105.5	6.6	105.5	105.5	103.8	88.9	74.0	59.1
4250	72	132.6	6.0	105.7	90.3	75.0	59.6	-	-	127.1	6.8	104.0	88.2	72.3	56.4	-	-
	67	120.5	5.9	120.5	109.1	93.7	78.4	63.0	-	116.5	6.7	116.5	108.0	92.2	76.3	60.4	-
	62	110.7	5.8	110.7	110.7	110.7	95.4	80.0	64.6	106.3	6.6	106.3	106.3	106.3	90.4	74.6	58.7
	57	108.9	5.8	108.9	108.9	108.9	93.5	78.1	62.8	107.1	6.6	107.1	107.1	91.2	75.4	59.5	-
		95°F														105°F	
2125	77	111.2	7.6	51.7	43.1	33.4	-	-	-	101.6	8.5	46.7	40.0	30.3	-	-	-
	72	103.5	7.5	67.2	57.5	47.8	38.1	-	-	94.6	8.5	63.8	54.1	44.4	34.7	-	-
	67	95.8	7.4	82.7	71.9	62.2	52.5	42.8	-	87.5	8.4	81.0	68.2	58.5	48.7	39.0	-
	62	86.8	7.4	86.8	86.8	72.2	62.5	52.8	43.2	79.1	8.3	79.1	79.1	66.6	56.9	47.1	37.4
2550	77	115.1	7.6	58.9	47.7	36.5	-	-	-	105.7	8.6	56.1	44.7	33.4	-	-	-
	72	107.1	7.5	74.6	63.5	52.3	41.2	-	-	98.4	8.5	71.4	60.2	48.9	37.7	-	-
	67	99.1	7.5	90.4	79.3	68.1	56.9	45.8	-	91.1	8.4	86.7	75.7	64.4	53.2	41.9	-
	62	89.8	7.4	89.8	79.0	67.9	56.7	45.6	47.8	82.3	8.4	82.3	82.3	73.4	62.2	50.9	39.7
	57	92.9	7.4	92.9	92.5	81.3	70.2	59.0	47.8	84.8	8.4	84.8	84.6	74.8	63.6	52.3	41.1
2975	77	119.1	7.6	66.0	52.3	39.7	-	-	-	109.8	8.6	65.6	49.3	36.5	-	-	-
	72	110.8	7.5	82.1	69.5	56.8	44.2	-	-	102.2	8.5	79.0	66.3	53.5	40.7	-	-
	67	102.5	7.5	98.2	86.6	74.0	61.3	48.7	-	94.6	8.5	92.5	83.2	70.4	57.7	44.9	-
	62	92.9	7.4	92.9	92.9	85.9	73.2	60.6	48.0	85.5	8.4	85.5	85.5	80.2	67.5	54.7	41.9
	57	96.1	7.4	96.1	95.9	88.3	75.7	63.1	50.4	88.1	8.4	88.1	88.0	81.8	69.0	56.2	43.4
3400	77	123.0	7.6	73.2	56.9	42.8	-	-	-	113.9	8.6	75.1	53.9	39.6	-	-	-
	72	114.4	7.6	89.5	75.4	61.3	47.2	-	-	106.1	8.6	86.6	72.3	58.0	43.7	-	-
	67	105.9	7.5	105.9	93.9	79.8	65.7	51.6	-	98.2	8.5	98.2	90.7	76.4	62.1	47.8	-
	62	95.9	7.5	95.9	95.9	92.7	78.6	64.5	50.4	88.7	8.4	88.7	88.7	87.1	72.7	58.4	44.1
	57	99.2	7.4	99.2	99.2	95.3	81.2	67.1	53.0	91.4	8.4	91.4	88.7	74.4	60.1	45.8	-
3825	72	118.0	7.6	96.0	80.7	65.5	50.2	-	-	106.8	8.6	92.1	76.8	61.4	46.1	-	-
	67	109.2	7.5	109.2	100.5	85.2	69.9	54.7	-	98.9	8.5	98.9	93.8	80.9	65.6	50.3	-
	62	98.9	7.5	98.9	98.9	97.3	82.0	66.8	51.5	89.3	8.4	89.3	88.5	73.2	57.8	42.5	-
	57	102.3	7.5	102.3	100.4	85.1	69.9	54.6	52.0	92.0	8.4	92.0	90.7	75.4	60.0	44.7	-
4250	72	121.6	7.6	102.4	86.0	69.6	53.2	-	-	107.5	8.6	97.5	81.2	64.8	48.5	-	-
	67	112.5	7.5	112.5	107.0	90.6	74.2	57.7	-	99.5	8.5	99.5	96.8	85.4	69.1	52.7	-
	62	101.9	7.5	101.9	101.9	101.9	85.5	69.1	52.7	89.9	8.5	89.9	89.9	89.9	73.6	57.2	40.9
	57	105.4	7.5	105.4	105.4	105.4	89.0	72.6	56.2	92.7	8.4	92.7	92.7	92.7	76.3	60.0	43.6

XXE09 (8.5 Ton) (Continued)

Air on Evaporator Coil		Temperature of Air on Condenser Coil																
		Total Capacity ¹ (MBh)	Total Input (kW) ²	Sensible Capacity (MBh)						Total Capacity ¹ (MBh)	Total Input (kW) ²	Sensible Capacity (MBh)						
				Return Dry Bulb (°F)									Return Dry Bulb (°F)					
115°F																		
2125	77	91.9	9.5	41.6	37.0	27.2	-	-	-	82.3	10.5	43.1	33.2	24.2	-	-	-	
	72	85.6	9.4	60.5	50.7	41.0	31.2	-	-	76.7	10.4	57.1	47.3	37.5	27.7	-	-	
	67	79.3	9.3	79.3	64.4	54.7	44.9	35.1	-	71.1	10.3	71.1	60.7	50.9	41.1	31.3	-	
	62	71.4	9.3	71.4	71.4	61.0	51.2	41.4	31.7	63.7	10.2	63.7	63.7	55.3	45.5	35.7	25.9	
2550	77	96.3	9.5	53.4	41.6	30.3	-	-	-	86.8	10.5	55.1	38.6	27.2	-	-	-	
	72	89.6	9.5	68.2	56.9	45.5	34.2	-	-	80.9	10.4	65.0	53.6	42.1	30.7	-	-	
	67	83.0	9.4	83.0	72.1	60.8	49.4	38.1	-	75.0	10.3	75.0	68.6	57.1	45.7	34.2	-	
	62	74.7	9.3	74.7	74.7	67.8	56.4	45.1	33.7	67.2	10.2	67.2	67.2	62.2	50.7	39.3	27.8	
	57	76.6	9.3	76.6	76.6	68.3	57.0	45.6	34.3	68.5	10.3	68.5	68.5	61.8	50.4	38.9	27.5	
2975	77	100.6	9.6	65.2	46.3	33.3	-	-	-	91.3	10.6	67.0	44.0	30.2	-	-	-	
	72	93.7	9.5	76.0	63.1	50.1	37.2	-	-	85.1	10.5	72.9	59.9	46.8	33.7	-	-	
	67	86.8	9.4	86.8	79.8	66.9	54.0	41.0	-	78.9	10.4	78.9	76.5	63.4	50.3	37.2	-	
	62	78.1	9.3	78.1	78.1	74.6	61.7	48.7	35.8	70.7	10.3	70.7	70.7	69.0	55.9	42.8	29.7	
	57	80.1	9.3	80.1	80.1	75.2	62.3	49.3	36.4	72.1	10.3	72.1	72.1	68.6	55.6	42.5	29.4	
3400	77	104.9	9.6	77.0	50.9	36.4	-	-	-	95.8	10.6	78.9	49.5	33.2	-	-	-	
	72	97.7	9.5	83.7	69.2	54.7	40.2	-	-	89.3	10.5	80.9	66.1	51.4	36.7	-	-	
	67	90.5	9.5	90.5	87.5	73.0	58.5	44.0	-	82.8	10.4	82.8	82.8	69.6	54.9	40.1	-	
	62	81.4	9.4	81.4	81.4	81.4	66.9	52.4	37.9	74.2	10.3	74.2	74.2	61.1	46.4	31.6		
	57	83.5	9.4	83.5	83.5	82.1	67.6	53.0	38.5	75.7	10.4	75.7	75.7	60.7	46.0	31.3		
3825	72	95.6	9.6	88.2	72.8	57.4	42.0	-	-	84.4	10.5	84.4	68.9	53.4	37.9	-	-	
	67	88.5	9.5	88.5	87.1	76.6	61.2	45.8	-	78.2	10.5	78.2	78.2	72.4	56.9	41.4	-	
	62	79.7	9.4	79.7	79.7	79.7	64.3	48.9	33.5	70.1	10.4	70.1	70.1	55.4	39.9	24.4		
	57	81.7	9.4	81.7	81.7	81.0	65.6	50.2	34.8	71.4	10.4	71.4	71.4	55.8	40.3	24.9		
4250	72	93.5	9.6	92.7	76.4	60.1	43.8	-	-	79.4	10.6	79.4	71.6	55.4	39.2	-	-	
	67	86.6	9.5	86.6	86.6	80.3	64.0	47.7	-	73.6	10.5	73.6	73.6	58.9	42.6	-		
	62	77.9	9.4	77.9	77.9	77.9	61.6	45.3	29.0	65.9	10.4	65.9	65.9	49.7	33.5	17.2		
	57	79.9	9.4	79.9	79.9	79.9	63.6	47.3	31.0	67.1	10.4	67.1	67.1	50.9	34.7	18.4		

1. These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate Blower Performance Table for the kW of the supply air blower motor.

2. These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

XXE12 (10 Ton)

Air on Evaporator Coil		Temperature of Air on Condenser Coil															
		Total Capacity ¹ (MBh)	Total Input (kW) ²	Sensible Capacity (MBh)						Total Capacity ¹ (MBh)	Total Input (kW) ²	Sensible Capacity (MBh)					
				Return Dry Bulb (°F)								Return Dry Bulb (°F)					
		75°F														85°F	
2500	77	156.2	7.1	61.6	50.8	40.3	-	-	-	144.8	8.1	60.9	50.6	40.4	-	-	-
	72	142.8	7.0	81.0	70.5	60.0	49.5	-	-	132.8	8.0	78.5	68.2	58.0	47.7	-	-
	67	129.3	6.9	100.3	90.2	79.7	69.2	58.7	-	120.8	7.9	96.1	85.8	75.5	65.3	55.0	-
	62	115.8	6.8	115.8	106.9	93.0	82.5	72.0	61.5	109.2	7.8	109.2	103.7	88.5	78.3	68.0	57.7
3000	77	160.5	7.2	67.8	55.8	43.7	-	-	-	148.8	8.1	67.7	55.9	44.1	-	-	-
	72	146.7	7.1	89.2	77.2	65.1	53.1	-	-	136.4	8.0	86.9	75.1	63.3	51.5	-	-
	67	132.9	6.9	110.6	98.5	86.5	74.5	62.5	-	124.1	7.9	106.2	94.3	82.5	70.7	58.9	-
	62	119.0	6.8	119.0	113.0	101.0	89.0	77.0	64.9	112.2	7.8	112.2	108.6	96.7	84.9	73.1	61.3
	57	117.1	6.7	117.1	106.6	94.6	82.6	70.6	61.7	111.7	7.7	111.7	100.6	88.8	77.0	65.2	
3500	77	164.7	7.2	74.0	60.7	47.2	-	-	-	152.8	8.2	74.5	61.2	47.8	-	-	-
	72	150.6	7.1	97.4	83.8	70.3	56.7	-	-	140.1	8.1	95.4	82.0	68.7	55.3	-	-
	67	136.4	7.0	120.8	106.9	93.4	79.8	66.3	-	127.4	7.9	116.2	102.9	89.5	76.2	62.8	-
	62	122.1	6.9	122.1	119.2	109.0	95.5	81.9	68.4	115.2	7.8	115.2	113.4	104.9	91.6	78.2	64.9
	57	120.2	6.8	120.2	120.2	115.1	101.6	88.0	74.5	114.7	7.8	114.7	109.1	95.8	82.4	69.1	
4000	77	169.0	7.3	80.2	65.7	50.6	-	-	-	156.7	8.2	81.4	66.5	51.6	-	-	-
	72	154.5	7.2	105.6	90.5	75.4	60.4	-	-	143.8	8.1	103.8	88.9	74.0	59.1	-	-
	67	140.0	7.1	131.0	115.3	100.3	85.2	70.1	-	130.8	8.0	126.3	111.4	96.5	81.6	66.7	-
	62	125.3	6.9	125.3	125.3	117.0	102.0	86.9	71.8	118.2	7.9	118.2	118.2	113.1	98.2	83.3	68.4
	57	123.4	6.8	123.4	123.4	123.4	108.5	93.4	78.4	117.7	7.8	117.7	117.7	102.8	87.9	73.0	
4500	72	156.5	7.1	112.2	96.1	80.0	63.8	-	-	145.4	8.1	110.7	94.7	78.8	62.8	-	-
	67	141.8	7.0	137.3	122.4	106.3	90.1	74.0	-	132.3	8.0	130.1	118.6	102.7	86.7	70.7	-
	62	126.9	6.9	126.9	126.9	122.8	106.7	90.5	74.4	119.6	7.8	119.6	119.6	117.0	101.1	85.1	69.1
	57	125.0	6.8	125.0	125.0	125.0	109.0	92.8	76.7	119.0	7.8	119.0	119.0	103.1	87.1	71.1	
	72	158.5	7.1	118.8	101.6	84.5	67.3	-	-	147.1	8.0	117.6	100.5	83.5	66.4	-	-
5000	67	143.6	6.9	143.6	129.5	112.3	95.1	77.9	-	133.8	7.9	133.8	125.9	108.8	91.8	74.7	-
	62	128.6	6.8	128.6	128.6	128.6	111.4	94.2	77.0	121.0	7.8	121.0	121.0	103.9	86.9	69.8	
	57	126.6	6.7	126.6	126.6	126.6	109.4	92.2	75.1	120.4	7.8	120.4	120.4	103.4	86.3	69.3	
		95°F														105°F	
2500	77	133.4	9.1	60.2	50.5	40.4	-	-	-	118.3	10.2	53.4	46.0	36.0	-	-	-
	72	122.8	9.0	76.0	66.0	55.9	45.9	-	-	110.0	10.1	71.7	61.7	51.7	41.7	-	-
	67	112.2	8.8	91.8	81.5	71.4	61.4	51.3	-	101.8	10.0	90.1	77.5	67.5	57.5	47.5	-
	62	102.6	8.7	102.6	100.6	84.1	74.1	64.0	53.9	94.1	9.9	94.1	93.1	78.5	68.5	58.5	48.5
3000	77	137.1	9.1	67.7	56.1	44.5	-	-	-	122.3	10.2	62.7	51.2	39.7	-	-	-
	72	126.2	9.0	84.7	73.1	61.5	49.9	-	-	113.8	10.1	80.1	68.6	57.1	45.6	-	-
	67	115.3	8.9	101.8	90.1	78.5	66.9	55.3	-	105.3	10.0	97.5	86.0	74.5	63.0	51.4	-
	62	105.4	8.8	105.4	104.1	92.5	80.9	69.3	57.7	97.3	10.0	97.3	96.6	86.6	75.1	63.6	52.1
	57	106.2	8.7	106.2	106.2	94.6	83.0	71.4	59.8	95.6	9.9	95.6	95.6	85.8	74.3	62.8	51.2
3500	77	140.8	9.1	75.1	61.6	48.5	-	-	-	126.4	10.2	72.1	56.4	43.4	-	-	-
	72	129.6	9.0	93.4	80.2	67.1	53.9	-	-	117.6	10.1	88.5	75.4	62.4	49.4	-	-
	67	118.4	8.9	111.7	98.8	85.6	72.5	59.3	-	108.8	10.0	104.9	94.5	81.5	68.4	55.4	-
	62	108.2	8.8	108.2	107.6	100.8	87.7	74.5	61.4	100.5	10.0	100.5	100.2	94.7	81.7	68.7	55.7
	57	109.1	8.8	109.1	109.1	103.2	90.0	76.9	63.7	98.8	9.9	98.8	98.8	93.8	80.8	67.8	54.8
4000	77	144.5	9.1	82.5	67.2	52.5	-	-	-	130.4	10.2	81.4	61.6	47.1	-	-	-
	72	133.0	9.0	102.1	87.3	72.6	57.9	-	-	121.3	10.1	96.8	82.3	67.8	53.3	-	-
	67	121.6	8.9	121.6	107.5	92.7	78.0	63.3	-	112.3	10.1	112.3	103.0	88.5	73.9	59.4	-
	62	111.1	8.8	111.1	111.1	109.2	94.5	79.8	65.1	103.8	10.0	103.8	102.8	88.3	73.8	59.3	
	57	112.0	8.8	112.0	111.7	97.0	82.3	67.6	60.2	90.2	9.9	102.0	101.9	87.3	72.8	58.3	
4500	72	134.4	9.0	109.2	93.4	77.6	61.7	-	-	122.3	10.1	103.9	88.3	72.6	57.0	-	-
	67	122.8	8.9	122.8	114.9	99.0	83.2	67.4	-	113.2	10.0	113.2	108.1	94.8	79.1	63.5	-
	62	112.2	8.8	112.2	112.2	111.3	95.5	79.7	63.8	104.6	10.0	104.6	104.1	88.5	72.8	57.2	
	57	113.1	8.8	113.1	113.1	113.0	97.2	81.4	65.5	102.8	9.9	102.8	102.7	87.1	71.4	55.8	
	72	135.8	9.0	116.3	99.4	82.5	65.6	-	-	123.3	10.1	111.0	94.2	77.4	60.7	-	-
5000	67	124.1	8.9	124.1	122.3	105.3	88.4	71.5	-	114.1	10.0	114.1	113.2	101.1	84.3	67.5	-
	62	113.4	8.8	113.4	113.4	113.4	96.5	79.5	62.6	105.4	9.9	105.4	105.4	88.7	71.9	55.1	
	57	114.3	8.8	114.3	114.3	114.3	97.3	80.4	63.5	103.6	9.9	103.6	103.6	86.8	70.0	53.3	

XXE12 (10 Ton) (Continued)

Air on Evaporator Coil		Temperature of Air on Condenser Coil															
		Total Capacity ¹ (MBh)	Total Input (kW) ²	Sensible Capacity (MBh)						Total Capacity ¹ (MBh)	Total Input (kW) ²	Sensible Capacity (MBh)					
				Return Dry Bulb (°F)									Return Dry Bulb (°F)				
		115°F															
2500	77	103.2	11.4	46.5	41.4	31.5	-	-	-	88.1	12.5	45.2	36.8	27.0	-	-	-
	72	97.3	11.3	67.4	57.4	47.5	37.6	-	-	84.5	12.5	63.1	53.2	43.3	33.4	-	-
	67	91.4	11.2	88.3	73.5	63.5	53.6	43.6	-	81.0	12.4	81.0	69.4	59.5	49.7	39.8	-
	62	85.6	11.2	85.6	85.6	72.8	62.9	52.9	43.0	77.1	12.4	77.1	77.1	67.2	57.3	47.4	37.5
3000	77	107.6	11.4	57.7	46.3	34.9	-	-	-	92.8	12.5	56.5	41.4	30.1	-	-	-
	72	101.4	11.3	75.5	64.1	52.6	41.2	-	-	89.0	12.4	70.8	59.5	48.2	36.9	-	-
	67	95.2	11.2	93.2	81.8	70.4	59.0	47.6	-	85.2	12.4	85.2	77.6	66.3	55.0	43.7	-
	62	89.2	11.1	89.2	89.2	80.7	69.3	57.9	46.5	81.1	12.3	81.1	81.1	74.8	63.5	52.2	40.9
	57	85.0	11.1	85.0	85.0	76.9	65.5	54.1	42.7	74.5	12.2	74.5	74.5	68.1	56.8	45.5	34.1
3500	77	111.9	11.4	69.0	51.2	38.3	-	-	-	97.5	12.5	67.8	46.1	33.2	-	-	-
	72	105.5	11.3	83.5	70.7	57.8	44.9	-	-	93.5	12.4	78.6	65.9	53.2	40.4	-	-
	67	99.1	11.2	98.1	90.1	77.3	64.4	51.5	-	89.5	12.4	89.5	85.8	73.1	60.4	47.6	-
	62	92.8	11.1	92.8	92.8	88.6	75.7	62.8	50.0	85.1	12.3	85.1	85.1	82.5	69.7	57.0	44.3
	57	88.5	11.0	88.5	88.5	84.4	71.6	58.7	45.8	78.2	12.2	78.2	78.2	75.1	62.4	49.6	36.9
4000	77	116.3	11.3	80.3	56.1	41.7	-	-	-	102.2	12.4	79.1	50.8	36.3	-	-	-
	72	109.7	11.3	91.6	77.3	62.9	48.6	-	-	98.0	12.4	86.4	72.3	58.1	43.9	-	-
	67	103.0	11.2	103.0	98.5	84.2	69.8	55.5	-	93.7	12.4	93.7	93.7	79.9	65.7	51.5	-
	62	96.5	11.1	96.5	96.5	96.5	82.1	67.8	53.5	89.2	12.3	89.2	89.2	89.2	76.0	61.8	47.6
	57	92.0	11.0	92.0	92.0	92.0	77.6	63.3	48.9	82.0	12.2	82.0	82.0	82.0	67.9	53.8	39.6
4500	72	110.2	11.2	98.7	83.2	67.7	52.2	-	-	98.2	12.3	93.4	78.1	62.7	47.4	-	-
	67	103.5	11.2	103.5	101.3	90.5	75.0	59.5	-	93.9	12.3	93.9	93.9	86.2	70.9	55.6	-
	62	97.0	11.1	97.0	97.0	97.0	81.5	66.0	50.5	89.4	12.2	89.4	89.4	89.4	74.5	59.2	43.9
	57	92.5	11.0	92.5	92.5	92.5	77.0	61.5	46.0	82.1	12.1	82.1	82.1	66.9	51.5	36.2	
5000	72	110.8	11.2	105.7	89.0	72.4	55.8	-	-	98.3	12.3	98.3	83.9	67.4	50.9	-	-
	67	104.1	11.1	104.1	104.1	96.8	80.2	63.5	-	94.1	12.2	94.1	94.1	92.5	76.1	59.6	-
	62	97.5	11.1	97.5	97.5	97.5	80.9	64.2	47.6	89.6	12.2	89.6	89.6	89.6	73.1	56.6	40.1
	57	92.9	11.0	92.9	92.9	92.9	76.3	59.7	43.0	82.3	12.1	82.3	82.3	82.3	65.8	49.3	32.8

1. These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate Blower Performance Table for the kW of the supply air blower motor.

2. These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

XQE04 (3 Ton)

Air on Evaporator Coil		Temperature of Air on Condenser Coil																
		Total Capacity ¹ (MBh)	Total Input (kW) ²	Sensible Capacity (MBh)						Total Capacity ¹ (MBh)	Total Input (kW) ²	Sensible Capacity (MBh)						
				Return Dry Bulb (°F)									Return Dry Bulb (°F)					
75°F																85°F		
750	77	49.1	2.0	23.0	18.6	15.0	-	-	-	45.0	2.4	20.4	16.9	13.3	-	-	-	
	72	44.8	2.0	27.2	23.6	20.0	16.4	-	-	41.3	2.4	25.4	21.9	18.3	14.7	-	-	
	67	40.5	2.0	31.5	28.6	25.0	21.4	17.8	-	37.6	2.4	30.4	26.9	23.3	19.7	16.2	-	
	62	36.9	2.0	36.9	35.4	29.9	26.3	22.7	19.1	34.2	2.4	34.2	33.5	28.0	24.4	20.8	17.3	
900	77	50.0	2.1	24.5	20.3	16.2	-	-	-	46.0	2.4	22.8	18.6	14.4	-	-	-	
	72	45.7	2.1	29.8	25.7	21.5	17.3	-	-	42.2	2.4	28.2	24.0	19.9	15.7	-	-	
	67	41.3	2.1	35.2	31.0	26.9	22.7	18.5	-	38.4	2.4	33.6	29.4	25.3	21.1	17.0	-	
	62	37.6	2.1	37.6	36.7	32.2	28.0	23.9	19.7	35.0	2.4	35.0	34.5	30.3	26.2	22.0	17.9	
	57	37.1	2.0	37.1	33.2	29.1	24.9	20.7	-	34.8	2.3	34.8	30.9	26.8	22.6	18.5	-	
1050	77	51.0	2.1	26.0	22.0	17.3	-	-	-	47.0	2.4	25.1	20.3	15.6	-	-	-	
	72	46.5	2.1	32.5	27.8	23.0	18.3	-	-	43.1	2.4	30.9	26.2	21.4	16.7	-	-	
	67	42.1	2.1	38.9	33.5	28.7	24.0	19.3	-	39.3	2.4	36.8	32.0	27.3	22.5	17.8	-	
	62	38.4	2.1	38.4	37.9	34.4	29.7	25.0	20.3	35.7	2.4	35.7	35.5	32.7	28.0	23.2	18.5	
	57	37.8	2.1	37.8	37.8	35.6	30.9	26.1	21.4	35.6	2.3	35.6	35.6	33.4	28.6	23.9	19.1	
1200	77	51.9	2.1	27.6	23.8	18.5	-	-	-	48.0	2.4	27.4	22.1	16.7	-	-	-	
	72	47.4	2.1	35.1	29.8	24.5	19.3	-	-	44.0	2.4	33.7	28.4	23.0	17.6	-	-	
	67	42.9	2.1	42.7	35.9	30.6	25.3	20.0	-	40.1	2.4	40.0	34.6	29.3	23.9	18.5	-	
	62	39.1	2.1	39.1	39.1	36.7	31.4	26.1	20.8	36.5	2.4	36.5	36.5	35.1	29.8	24.4	19.0	
	57	38.5	2.1	38.5	38.5	37.9	32.6	27.3	22.1	36.3	2.3	36.3	36.3	35.8	30.5	25.1	19.7	
1350	72	47.6	2.1	37.4	31.5	25.6	19.7	-	-	44.1	2.4	35.8	29.8	23.9	17.9	-	-	
	67	43.1	2.1	43.0	37.8	32.0	26.1	20.2	-	40.2	2.4	40.1	36.3	30.4	24.4	18.5	-	
	62	39.2	2.1	39.2	39.2	38.1	32.2	26.3	20.4	36.6	2.4	36.6	36.6	35.9	29.9	24.0	18.0	
	57	38.7	2.1	38.7	38.7	38.4	32.5	26.6	20.7	36.4	2.4	36.4	36.4	36.2	30.2	24.2	18.3	
1500	72	47.8	2.1	39.6	33.1	26.7	20.2	-	-	44.3	2.4	37.8	31.3	24.7	18.2	-	-	
	67	43.2	2.1	43.2	39.8	33.3	26.8	20.3	-	40.3	2.4	40.3	38.0	31.5	24.9	18.4	-	
	62	39.4	2.1	39.4	39.4	39.4	32.9	26.5	20.0	36.7	2.4	36.7	36.7	30.1	23.6	17.0	-	
	57	38.8	2.1	38.8	38.8	38.8	32.4	25.9	19.4	36.5	2.4	36.5	36.5	36.5	30.0	23.4	16.9	
95°F																105°F		
750	77	41.0	2.8	17.9	15.1	11.6	-	-	-	38.3	3.1	15.7	13.9	10.4	-	-	-	
	72	37.8	2.7	23.6	20.1	16.6	13.1	-	-	35.1	3.1	22.3	18.8	15.3	11.8	-	-	
	67	34.7	2.7	29.4	25.1	21.6	18.1	14.6	-	32.0	3.0	29.0	23.7	20.2	16.7	13.2	-	
	62	31.6	2.7	31.6	31.6	26.0	22.5	19.0	15.5	29.6	3.1	29.6	29.6	23.9	20.3	16.8	13.3	
900	77	42.0	2.7	21.0	16.9	12.7	-	-	-	39.1	3.1	19.8	15.6	11.4	-	-	-	
	72	38.8	2.7	26.5	22.4	18.2	14.1	-	-	35.9	3.1	25.2	21.0	16.9	12.7	-	-	
	67	35.6	2.7	32.0	27.9	23.7	19.6	15.4	-	32.7	3.0	30.6	26.5	22.3	18.1	13.9	-	
	62	32.4	2.7	32.4	32.4	28.5	24.4	20.2	16.1	30.2	3.0	30.2	30.2	26.3	22.1	18.0	13.8	
	57	32.6	2.7	32.6	32.6	28.7	24.5	20.4	16.2	30.4	3.0	30.4	30.4	26.3	22.2	18.0	13.8	
1050	77	43.0	2.7	24.2	18.6	13.8	-	-	-	39.9	3.1	23.9	17.3	12.5	-	-	-	
	72	39.7	2.7	29.4	24.6	19.8	15.0	-	-	36.6	3.0	28.1	23.3	18.4	13.6	-	-	
	67	36.4	2.6	34.7	30.6	25.8	21.0	16.2	-	33.3	3.0	32.3	29.2	24.4	19.5	14.7	-	
	62	33.1	2.7	33.1	33.1	31.0	26.2	21.4	16.6	30.8	3.0	30.8	30.8	28.8	23.9	19.1	14.3	
	57	33.4	2.6	33.4	33.4	31.2	26.4	21.6	16.8	31.0	3.0	31.0	28.8	24.0	19.1	14.3	-	
1200	77	44.1	2.7	27.3	20.4	15.0	-	-	-	40.7	3.0	27.9	19.0	13.5	-	-	-	
	72	40.7	2.7	32.3	26.9	21.4	16.0	-	-	37.3	3.0	31.0	25.5	20.0	14.5	-	-	
	67	37.3	2.6	37.3	33.3	27.9	22.5	17.0	-	34.0	3.0	34.0	31.9	26.4	20.9	15.5	-	
	62	33.9	2.6	33.9	33.9	33.5	28.1	22.7	17.2	31.5	3.0	31.5	31.5	31.2	25.7	20.2	14.7	
	57	34.2	2.6	34.2	34.2	33.7	28.3	22.8	17.4	31.6	3.0	31.6	31.6	31.2	25.7	20.3	14.8	
1350	72	40.7	2.7	34.2	28.1	22.1	16.1	-	-	37.5	3.0	32.9	26.8	20.7	14.6	-	-	
	67	37.3	2.6	37.3	34.8	28.8	22.7	16.7	-	34.2	3.0	34.2	32.9	27.4	21.3	15.2	-	
	62	33.9	2.7	33.9	33.9	33.7	27.7	21.7	15.7	31.6	3.0	31.6	31.6	31.5	25.4	19.3	13.2	
	57	34.2	2.6	34.2	34.2	33.9	27.9	21.9	15.9	31.7	3.0	31.7	31.7	31.6	25.5	19.4	13.3	
	72	40.7	2.7	36.0	29.4	22.8	16.1	-	-	37.7	3.1	34.9	28.2	21.4	14.7	-	-	
1500	67	37.3	2.7	37.3	36.2	29.6	23.0	16.4	-	34.3	3.0	34.3	33.8	28.4	21.7	15.0	-	
	62	34.0	2.7	34.0	34.0	34.0	27.3	20.7	14.1	31.7	3.0	31.7	31.7	31.7	25.0	18.3	11.6	
	57	34.2	2.7	34.2	34.2	34.2	27.5	20.9	14.3	31.9	3.0	31.9	31.9	31.9	25.2	18.5	11.8	

XQE04 (3 Ton) (Continued)

Air on Evaporator Coil		Temperature of Air on Condenser Coil															
		Total Capacity ¹ (MBh)	Total Input (kW) ²	Sensible Capacity (MBh)						Total Capacity ¹ (MBh)	Total Input (kW) ²	Sensible Capacity (MBh)					
				Return Dry Bulb (°F)									Return Dry Bulb (°F)				
		115°F														125°F	
750	77	35.6	3.4	13.5	12.6	9.1	-	-	-	32.9	3.8	12.9	10.6	7.9	-	-	-
	72	32.4	3.4	21.0	17.5	14.0	10.4	-	-	29.7	3.8	19.7	16.2	12.6	9.1	-	-
	67	29.3	3.4	28.5	22.3	18.8	15.3	11.7	-	26.6	3.8	26.6	20.9	17.4	13.8	10.3	-
	62	27.6	3.4	27.6	27.6	21.7	18.2	14.7	11.1	25.7	3.8	25.7	25.7	19.6	16.1	12.5	9.0
900	77	36.1	3.4	18.5	14.3	10.1	-	-	-	33.2	3.8	18.3	13.0	8.8	-	-	-
	72	33.0	3.4	23.9	19.7	15.5	11.3	-	-	30.0	3.8	22.6	18.3	14.1	9.9	-	-
	67	29.8	3.4	29.3	25.1	20.9	16.7	12.5	-	26.8	3.8	26.8	23.7	19.4	15.2	11.0	-
	62	28.1	3.4	28.1	28.1	24.1	19.9	15.7	11.5	25.9	3.8	25.9	25.9	21.9	17.7	13.5	9.2
1050	77	36.7	3.4	23.5	16.0	11.1	-	-	-	33.6	3.7	23.7	15.5	9.7	-	-	-
	72	33.5	3.4	26.8	21.9	17.0	12.1	-	-	30.4	3.7	25.4	20.5	15.6	10.7	-	-
	67	30.2	3.4	30.0	27.8	22.9	18.0	13.2	-	27.1	3.7	27.1	26.4	21.5	16.5	11.6	-
	62	28.5	3.4	28.5	28.5	26.5	21.6	16.7	11.9	26.2	3.7	26.2	26.2	24.2	19.3	14.4	9.5
1200	77	37.3	3.4	28.6	17.7	12.1	-	-	-	33.9	3.7	29.2	18.0	10.7	-	-	-
	72	34.0	3.4	29.6	24.1	18.5	13.0	-	-	30.7	3.7	28.3	22.7	17.1	11.5	-	-
	67	30.7	3.3	30.7	30.5	25.0	19.4	13.9	-	27.4	3.7	27.4	27.4	23.5	17.9	12.3	-
	62	29.0	3.3	29.0	29.0	28.9	23.3	17.8	12.2	26.5	3.7	26.5	26.5	26.5	20.9	15.3	9.7
1350	77	34.3	3.4	31.7	25.5	19.3	13.2	-	-	31.2	3.7	30.4	24.2	17.9	11.7	-	-
	67	31.0	3.4	31.0	30.9	26.0	19.9	13.7	-	27.9	3.7	27.9	27.9	24.7	18.4	12.2	-
	62	29.3	3.4	29.3	29.3	29.2	23.0	16.9	10.7	26.9	3.7	26.9	26.9	26.9	20.7	14.4	8.2
	57	29.3	3.3	29.3	29.3	29.2	23.0	16.8	10.7	26.9	3.7	26.9	26.9	26.8	20.6	14.3	8.1
1500	72	34.7	3.4	33.7	26.9	20.1	13.3	-	-	31.6	3.7	31.6	25.7	18.8	11.9	-	-
	67	31.3	3.4	31.3	31.3	27.1	20.3	13.5	-	28.3	3.7	28.3	28.3	25.8	19.0	12.1	-
	62	29.5	3.4	29.5	29.5	29.5	22.7	15.9	9.2	27.3	3.7	27.3	27.3	27.3	20.4	13.6	6.7
	57	29.6	3.4	29.6	29.6	29.6	22.8	16.0	9.2	27.3	3.7	27.3	27.3	27.3	20.5	13.6	6.7

1. These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate Blower Performance Table for the kW of the supply air blower motor.

2. These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

XQE05 (4 Ton)

Air on Evaporator Coil		Temperature of Air on Condenser Coil																	
		Total Capacity ¹ (MBh)	Total Input (kW) ²	Sensible Capacity (MBh)						Total Capacity ¹ (MBh)	Total Input (kW) ²	Sensible Capacity (MBh)							
				Return Dry Bulb (°F)									Return Dry Bulb (°F)						
75°F																			
1000	77	63.6	2.8	30.9	26.6	22.3	-	-	-	60.1	3.1	29.2	24.9	20.7	-	-	-	-	
	72	58.2	2.8	37.5	32.2	27.0	21.8	-	-	54.9	3.1	36.1	30.9	25.6	20.4	-	-	-	
	67	52.8	2.7	44.1	37.9	31.7	26.4	21.1	-	49.7	3.1	43.1	36.8	30.5	25.2	19.9	-	-	
	62	48.9	2.7	44.1	40.2	36.4	30.7	25.6	20.2	46.6	3.1	44.1	39.8	35.5	29.9	24.6	19.2	-	
1200	77	64.6	2.8	34.6	28.4	22.3	-	-	-	60.8	3.1	33.2	27.0	20.8	-	-	-	-	
	72	59.9	2.8	41.1	34.8	28.5	22.1	-	-	56.4	3.1	39.7	33.4	27.1	20.7	-	-	-	
	67	55.2	2.7	47.6	41.1	34.6	28.2	21.8	-	52.0	3.1	46.3	39.8	33.3	26.9	20.5	-	-	
	62	52.0	2.7	47.6	44.2	40.8	34.0	27.8	21.2	49.6	3.1	47.1	43.3	39.6	32.9	26.6	20.1	-	
	57	48.9	2.7	47.6	47.3	46.9	40.3	33.7	27.1	47.1	3.1	47.1	46.8	45.8	39.2	32.7	26.1	-	
1400	77	65.6	2.8	38.3	30.3	22.3	-	-	-	61.6	3.1	37.2	29.1	21.0	-	-	-	-	
	72	61.6	2.8	44.7	37.3	29.9	22.5	-	-	58.0	3.1	43.3	35.9	28.5	21.1	-	-	-	
	67	57.5	2.8	51.1	44.3	37.5	30.0	22.5	-	54.4	3.1	49.4	42.7	36.1	28.6	21.1	-	-	
	62	55.2	2.8	51.1	48.1	45.1	37.3	29.9	22.3	52.6	3.1	50.0	46.8	43.7	36.0	28.5	21.0	-	
	57	52.8	2.7	51.1	51.1	45.0	37.3	29.6	-	50.7	3.1	50.6	50.6	43.6	35.9	28.3	-	-	
1600	77	66.6	2.8	42.0	32.1	22.3	-	-	-	62.4	3.2	41.2	31.2	21.1	-	-	-	-	
	72	63.2	2.8	48.3	39.8	31.4	22.9	-	-	59.6	3.1	46.9	38.4	30.0	21.5	-	-	-	
	67	59.8	2.8	54.7	47.5	40.4	31.9	23.2	-	56.8	3.1	52.6	45.7	38.9	30.3	21.8	-	-	
	62	58.3	2.8	54.7	52.1	49.5	40.6	32.0	23.3	55.6	3.1	53.0	50.4	47.8	39.1	30.5	21.9	-	
	57	56.7	2.7	54.7	54.7	49.7	40.9	32.0	-	54.3	3.1	53.4	53.4	47.9	39.2	30.5	-	-	
1800	72	64.9	2.8	51.9	42.4	32.8	23.3	-	-	61.2	3.2	50.5	41.0	31.4	21.9	-	-	-	
	67	62.2	2.8	58.2	50.8	43.4	33.7	23.9	-	59.2	3.1	55.7	48.7	41.6	32.0	22.4	-	-	
	62	61.4	2.8	58.2	56.0	53.9	44.0	34.2	24.3	58.6	3.1	55.9	53.9	51.9	42.1	32.4	22.7	-	
	57	60.6	2.8	58.2	58.2	58.2	54.4	44.4	34.4	58.0	3.1	56.1	56.1	52.3	42.5	32.7	-	-	
2000	72	66.5	2.8	55.6	44.9	34.3	23.6	-	-	62.7	3.2	54.1	43.5	32.9	22.3	-	-	-	
	67	64.5	2.8	61.7	54.0	46.3	35.5	24.7	-	61.6	3.1	58.8	51.6	44.4	33.7	23.1	-	-	
	62	64.5	2.8	61.7	60.0	58.2	47.3	36.3	25.4	61.6	3.1	58.8	57.4	56.0	45.2	34.4	23.6	-	
	57	64.5	2.8	61.8	61.8	61.8	59.1	48.0	36.9	61.6	3.1	58.8	58.8	58.8	56.6	45.7	34.9	-	
95°F																			
1000	77	56.5	3.4	27.5	23.3	19.1	-	-	-	50.9	4.0	26.5	22.1	17.7	-	-	-	-	
	72	51.5	3.4	34.8	29.5	24.2	18.9	-	-	47.5	4.0	33.4	28.0	22.7	17.4	-	-	-	
	67	46.5	3.4	42.1	35.8	29.4	24.0	18.7	-	44.2	3.9	40.3	34.0	27.7	22.4	17.1	-	-	
	62	44.2	3.4	44.2	39.3	34.5	29.1	23.6	18.2	42.7	3.9	41.8	37.3	32.8	27.4	22.1	16.7	-	
1200	77	57.1	3.5	31.8	25.6	19.4	-	-	-	51.8	4.0	30.7	24.2	17.7	-	-	-	-	
	72	53.0	3.4	38.4	32.0	25.7	19.3	-	-	49.0	4.0	36.7	30.3	24.0	17.7	-	-	-	
	67	48.9	3.4	44.9	38.5	32.0	25.6	19.2	-	46.3	3.9	42.7	36.5	30.3	23.9	17.6	-	-	
	62	47.1	3.4	45.2	42.4	38.3	31.9	25.4	18.9	45.1	3.9	43.8	40.2	36.6	30.2	23.8	17.4	-	
	57	45.2	3.4	45.2	45.2	44.7	38.1	31.6	25.1	43.9	3.9	43.9	43.9	42.9	36.4	30.0	23.5	-	
1400	77	57.6	3.5	36.1	27.9	19.6	-	-	-	52.6	4.0	34.9	26.3	17.8	-	-	-	-	
	72	54.5	3.5	41.9	34.5	27.1	19.7	-	-	50.5	4.0	40.0	32.6	25.3	18.0	-	-	-	
	67	51.4	3.4	47.7	41.2	34.7	27.2	19.8	-	48.5	4.0	45.0	39.0	32.9	25.5	18.1	-	-	
	62	50.0	3.4	48.6	45.5	42.2	34.7	27.2	19.7	47.5	3.9	45.9	43.2	40.4	33.0	25.5	18.0	-	
	57	48.6	3.4	48.6	48.6	48.6	42.1	34.6	27.0	46.6	3.9	46.6	46.6	46.6	40.5	32.9	25.3	-	
1600	77	58.1	3.5	40.5	30.2	19.9	-	-	-	53.5	4.0	39.1	28.5	17.8	-	-	-	-	
	72	56.0	3.5	45.5	37.0	28.6	20.1	-	-	52.0	4.0	43.3	34.9	26.6	18.3	-	-	-	
	67	53.8	3.5	50.5	43.9	37.3	28.8	20.3	-	50.6	4.0	47.4	41.4	35.5	27.0	18.6	-	-	
	62	52.9	3.5	51.2	48.6	46.0	37.5	28.9	20.4	50.0	4.0	48.0	46.1	44.3	35.7	27.2	18.6	-	
	57	52.0	3.5	52.0	52.0	52.0	46.1	37.5	29.0	49.3	4.0	48.5	48.5	44.5	35.8	27.1	-	-	
1800	72	57.4	3.5	49.0	39.5	30.0	20.5	-	-	53.5	4.0	46.6	37.3	27.9	18.6	-	-	-	
	67	56.2	3.5	53.2	46.6	39.9	30.4	20.9	-	52.7	4.0	49.8	43.9	38.0	28.6	19.1	-	-	
	62	55.8	3.5	53.6	51.7	49.8	40.3	30.7	21.1	52.4	4.0	50.1	49.1	48.1	38.5	28.9	19.3	-	
	57	55.3	3.5	54.0	54.0	54.0	50.1	40.5	30.9	52.0	4.0	50.3	50.3	48.5	38.7	28.9	-	-	
2000	72	58.9	3.5	52.6	42.0	31.488	20.9	-	-	55.0	4.0	49.9	39.6	29.2	18.9	-	-	-	
	67	58.7	3.5	56.0	49.3	42.6	32.0	21.4	-	54.9	4.0	52.0	46.4	40.6	30.1	19.6	-	-	
	62	58.7	3.5	56.0	54.8	53.7	43.1	32.5	21.8	54.8	4.0	52.0	52.0	41.3	30.6	19.9	-	-	
	57	58.7	3.5	56.0	56.0	56.0	54.1	43.5	32.8	54.8	4.0	52.0	52.0	52.0	41.6	30.7	-	-	

XQE05 (4 Ton) (Continued)

Air on Evaporator Coil		Temperature of Air on Condenser Coil															
		Total Capacity ¹ (MBh)	Total Input (kW) ²	Sensible Capacity (MBh)						Total Capacity ¹ (MBh)	Total Input (kW) ²	Sensible Capacity (MBh)					
				Return Dry Bulb (°F)									Return Dry Bulb (°F)				
		115°F														125°F	
1000	77	45.3	4.5	25.4	20.9	16.3	-	-	-	39.6	5.1	24.4	19.6	14.9	-	-	-
	72	43.6	4.5	31.9	26.6	21.2	15.8	-	-	39.6	5.0	30.5	25.1	19.7	14.3	-	-
	67	41.9	4.5	38.4	32.3	26.1	20.8	15.5	-	39.6	5.0	36.5	30.5	24.5	19.2	13.9	-
	62	41.2	4.4	39.4	35.2	31.0	25.8	20.5	15.3	39.6	5.0	37.0	33.2	29.3	24.1	18.9	13.8
1200	77	46.4	4.5	29.5	22.8	16.1	-	-	-	41.1	5.1	28.4	21.4	14.4	-	-	-
	72	45.1	4.5	35.0	28.7	22.4	16.0	-	-	41.1	5.0	33.3	27.0	20.7	14.4	-	-
	67	43.7	4.5	40.4	34.5	28.6	22.3	15.9	-	41.1	5.0	38.1	32.5	26.9	20.6	14.3	-
	62	43.1	4.4	41.2	38.0	34.9	28.5	22.2	15.8	41.1	5.0	38.5	35.8	33.1	26.8	20.5	14.2
	57	42.5	4.4	42.0	41.6	41.1	34.8	28.4	22.0	41.1	4.9	38.9	38.9	33.1	26.7	20.4	
1400	77	47.6	4.5	33.6	24.8	15.9	-	-	-	42.6	5.0	32.4	23.2	14.0	-	-	-
	72	46.6	4.5	38.0	30.8	23.5	16.2	-	-	42.6	5.0	36.1	28.9	21.7	14.5	-	-
	67	45.6	4.5	42.4	36.8	31.1	23.8	16.4	-	42.6	5.0	39.8	34.6	29.3	22.0	14.7	-
	62	45.1	4.5	43.0	40.8	38.7	31.3	23.8	16.3	42.6	5.0	40.0	38.5	37.0	29.6	22.1	14.7
	57	44.6	4.4	43.5	43.5	43.5	38.8	31.2	23.6	42.6	5.0	40.2	40.2	37.1	29.5	22.0	
1600	77	48.8	4.5	37.7	26.7	15.7	-	-	-	44.1	5.0	36.4	25.0	13.6	-	-	-
	72	48.1	4.5	41.1	32.9	24.7	16.5	-	-	44.1	5.0	38.9	30.8	22.7	14.6	-	-
	67	47.4	4.5	44.4	39.0	33.6	25.2	16.8	-	44.1	5.0	41.4	36.6	31.8	23.4	15.1	-
	62	47.0	4.5	44.7	43.7	42.6	34.0	25.4	16.9	44.1	5.0	41.5	41.2	40.9	32.3	23.7	15.1
	57	46.7	4.5	45.1	45.1	45.1	42.8	34.0	25.3	44.1	5.0	41.6	41.6	41.1	32.3	23.5	
1800	72	49.6	4.5	44.1	35.0	25.8	16.7	-	-	45.7	5.0	41.7	32.7	23.7	14.7	-	-
	67	49.2	4.5	46.4	41.3	36.1	26.7	17.3	-	45.7	5.0	43.0	38.6	34.2	24.9	15.5	-
	62	49.0	4.5	46.5	46.5	46.4	36.8	27.1	17.4	45.6	5.0	43.0	43.0	35.0	25.3	15.6	
	57	48.8	4.5	46.6	46.6	46.6	46.6	36.9	27.0	45.5	5.0	43.0	43.0	43.0	35.1	25.0	
2000	72	51.1	4.5	47.2	37.1	27.0	16.9	-	-	47.3	5.0	44.5	34.6	24.7	14.8	-	-
	67	51.1	4.5	48.3	43.5	38.6	28.2	17.8	-	47.3	5.0	44.6	40.6	36.6	26.3	15.9	-
	62	51.0	4.5	48.3	48.3	48.3	48.3	39.5	28.7	47.1	5.0	44.7	44.7	37.7	26.9	16.0	
	57	50.9	4.5	48.3	48.3	48.3	39.7	28.6	47.0	5.0	44.7	44.7	44.7	44.7	37.8	26.5	

1. These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate Blower Performance Table for the kW of the supply air blower motor.

2. These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

XQE06 (5 Ton)

Air on Evaporator Coil		Temperature of Air on Condenser Coil															
		Total Capacity ¹ (MBh)	Total Input (kW) ²	Sensible Capacity (MBh)						Total Capacity ¹ (MBh)	Total Input (kW) ²	Sensible Capacity (MBh)					
				Return Dry Bulb (°F)									Return Dry Bulb (°F)				
		75°F														85°F	
1250	77	78.3	3.6	38.6	34.0	29.5	-	-	-	73.5	3.9	36.7	31.6	26.5	-	-	-
	72	70.9	3.5	46.7	40.5	34.3	28.1	-	-	66.9	3.9	44.9	38.5	32.0	25.5	-	-
	67	63.6	3.4	54.8	46.9	39.0	33.5	27.2	-	60.2	3.8	53.2	45.3	37.5	31.4	25.0	-
	62	59.0	3.4	54.3	49.0	43.8	36.5	32.6	27.1	58.0	3.8	54.8	48.9	43.0	36.1	30.9	24.9
1500	77	79.4	3.5	43.4	36.3	29.3	-	-	-	74.3	3.9	41.7	34.1	26.5	-	-	-
	72	73.0	3.5	51.2	43.6	36.0	28.4	-	-	68.7	3.9	49.4	41.6	33.7	25.9	-	-
	67	66.6	3.4	59.0	50.9	42.7	35.6	27.7	-	63.0	3.8	57.1	49.1	41.0	33.4	25.5	-
	62	62.8	3.4	59.0	54.2	49.5	40.7	34.7	27.2	61.1	3.8	58.6	53.5	48.3	39.9	32.9	25.2
	57	59.0	3.3	59.0	57.6	56.2	48.9	41.6	34.3	59.3	3.9	59.3	57.9	55.6	47.9	40.3	32.6
1750	77	80.6	3.5	48.1	38.6	29.0	-	-	-	75.1	3.9	46.8	36.6	26.4	-	-	-
	72	75.1	3.5	55.7	46.7	37.7	28.8	-	-	70.5	3.9	53.9	44.7	35.5	26.3	-	-
	67	69.5	3.4	63.2	54.8	46.5	37.6	28.2	-	65.8	3.9	61.1	52.8	44.6	35.4	25.9	-
	62	66.6	3.4	63.7	59.5	55.2	44.9	36.7	27.4	64.3	3.9	62.4	58.0	53.7	43.7	34.8	25.4
	57	63.7	3.4	63.6	63.0	62.3	54.5	45.1	35.7	62.8	3.9	62.8	62.7	61.9	53.2	43.7	34.2
2000	77	81.8	3.5	52.9	40.8	28.8	-	-	-	75.9	3.9	51.8	39.1	26.4	-	-	-
	72	77.1	3.5	60.2	49.8	39.5	29.1	-	-	72.3	3.9	58.4	47.8	37.2	26.6	-	-
	67	72.5	3.5	67.4	58.8	50.2	39.6	28.7	-	68.7	3.9	65.1	56.6	48.1	37.3	26.4	-
	62	70.4	3.4	68.5	64.7	60.9	49.1	38.7	27.6	67.5	3.9	66.2	62.6	59.0	47.5	36.8	25.6
	57	68.3	3.4	68.3	68.3	68.3	60.2	48.7	37.2	66.4	3.9	66.4	66.4	58.5	47.1	35.7	-
2250	72	79.2	3.5	64.7	52.9	41.2	29.5	-	-	74.1	3.9	62.9	51.0	39.0	27.0	-	-
	67	75.5	3.5	71.7	62.8	53.9	41.7	29.2	-	71.5	3.9	69.0	60.3	51.7	39.3	26.9	-
	62	74.2	3.5	73.2	69.9	66.6	53.3	40.7	27.8	70.7	3.9	70.1	67.2	64.3	51.4	38.7	25.9
	57	72.9	3.5	72.9	72.9	72.9	65.8	52.2	38.7	69.9	3.9	69.9	69.9	63.8	50.5	37.3	-
2500	72	81.3	3.5	69.2	56.1	43.0	29.8	-	-	75.9	3.9	67.5	54.1	40.8	27.4	-	-
	67	78.5	3.5	75.9	66.7	57.6	43.7	29.7	-	74.3	3.9	73.0	64.1	55.2	41.3	27.4	-
	62	78.0	3.5	78.0	75.2	72.3	57.5	42.8	28.0	73.9	3.9	73.9	71.8	69.7	55.2	40.7	26.1
	57	77.5	3.5	77.5	77.5	77.5	71.4	55.8	40.2	73.4	3.9	73.4	73.4	69.1	53.9	38.8	-
		95°F														105°F	
1250	77	68.8	4.3	34.8	29.2	23.5	-	-	-	63.2	4.9	34.2	28.0	21.9	-	-	-
	72	62.8	4.3	43.2	36.4	29.7	23.0	-	-	58.3	4.9	41.6	34.8	28.0	21.2	-	-
	67	56.8	4.2	51.6	43.7	35.9	29.3	22.7	-	53.3	4.8	49.0	41.5	34.1	27.4	20.8	-
	62	56.9	4.3	55.4	48.8	42.1	35.7	29.2	22.8	53.3	4.9	52.2	46.2	40.1	33.7	27.2	20.7
1500	77	69.3	4.3	40.1	31.9	23.7	-	-	-	63.7	4.9	38.9	30.2	21.5	-	-	-
	72	64.4	4.3	47.7	39.6	31.5	23.4	-	-	59.7	4.9	45.6	37.5	29.4	21.4	-	-
	67	59.5	4.2	55.3	47.3	39.3	31.2	23.2	-	55.7	4.9	52.2	44.8	37.3	29.2	21.2	-
	62	59.5	4.3	58.3	52.7	47.1	39.1	31.1	23.1	55.7	4.9	54.8	50.0	45.2	37.1	29.0	20.9
	57	59.5	4.4	59.5	58.1	54.9	47.0	39.0	31.0	55.7	5.0	55.7	55.2	53.1	45.0	36.9	28.8
1750	77	69.7	4.3	45.4	34.6	23.8	-	-	-	64.2	4.9	43.7	32.4	21.2	-	-	-
	72	65.9	4.3	52.2	42.7	33.2	23.8	-	-	61.1	4.9	49.6	40.2	30.9	21.5	-	-
	67	62.1	4.3	59.0	50.8	42.7	33.1	23.6	-	58.0	4.9	55.5	48.0	40.6	31.0	21.5	-
	62	62.0	4.3	61.1	56.6	52.1	42.5	32.9	23.4	58.0	4.9	57.4	53.8	50.3	40.6	30.9	21.1
	57	62.0	4.4	62.0	62.0	61.5	51.9	42.3	32.6	57.9	5.0	57.9	57.9	50.1	40.2	30.3	-
2000	77	70.1	4.3	50.8	37.4	24.0	-	-	-	64.7	4.9	48.5	34.7	20.8	-	-	-
	72	67.4	4.3	56.7	45.9	35.0	24.2	-	-	62.6	4.9	53.6	43.0	32.3	21.7	-	-
	67	64.8	4.3	62.7	54.4	46.1	35.1	24.1	-	60.4	4.9	58.7	51.3	43.8	32.9	21.9	-
	62	64.6	4.3	64.0	60.5	57.1	46.0	34.8	23.7	60.3	4.9	59.9	57.6	55.3	44.0	32.7	21.4
	57	64.4	4.4	64.4	64.4	64.4	56.8	45.5	34.3	60.2	5.0	60.2	60.2	55.2	43.5	31.8	-
2250	72	69.0	4.3	61.2	49.0	36.8	24.6	-	-	64.0	4.9	57.6	45.7	33.8	21.9	-	-
	67	67.4	4.3	66.4	57.9	49.4	37.0	24.5	-	62.8	4.9	62.0	54.5	47.1	34.7	22.2	-
	62	67.2	4.3	66.9	64.5	62.1	49.4	36.7	24.0	62.6	5.0	62.5	61.5	60.4	47.5	34.5	21.6
	57	66.9	4.4	66.9	66.9	66.9	61.8	48.8	35.9	62.4	5.0	62.4	62.4	60.3	46.8	33.4	-
2500	72	70.5	4.4	65.7	52.1	38.6	25.0	-	-	65.5	5.0	61.6	48.4	35.2	22.0	-	-
	67	70.1	4.4	70.1	61.5	52.8	38.9	25.0	-	65.2	5.0	65.2	57.8	50.4	36.5	22.6	-
	62	69.7	4.4	69.7	68.4	67.1	52.8	38.5	24.3	64.9	5.0	64.9	64.9	50.9	36.4	21.8	-
	57	69.4	4.3	69.4	69.4	69.4	66.7	52.1	37.5	64.7	5.0	64.7	64.7	64.7	50.1	34.9	-

XQE06 (5 Ton) (Continued)

Air on Evaporator Coil		Temperature of Air on Condenser Coil															
		Total Capacity ¹ (MBh)	Total Input (kW) ²	Sensible Capacity (MBh)						Total Capacity ¹ (MBh)	Total Input (kW) ²	Sensible Capacity (MBh)					
				Return Dry Bulb (°F)									Return Dry Bulb (°F)				
		115°F														125°F	
1250	77	57.6	5.5	33.5	26.9	20.3	-	-	-	52.0	6.1	32.8	25.8	18.7	-	-	-
	72	53.7	5.5	39.9	33.1	26.3	19.4	-	-	49.1	6.1	38.3	31.4	24.5	17.6	-	-
	67	49.7	5.5	46.4	39.3	32.2	25.5	18.8	-	46.2	6.1	43.8	37.1	30.3	23.6	16.9	-
	62	49.8	5.5	49.1	43.6	38.2	31.6	25.1	18.6	46.2	6.1	45.9	41.1	36.2	29.6	23.1	16.5
1500	77	58.2	5.5	37.7	28.6	19.4	-	-	-	52.7	6.1	36.5	26.9	17.3	-	-	-
	72	55.0	5.5	43.5	35.4	27.4	19.4	-	-	50.3	6.1	41.3	33.3	25.3	17.3	-	-
	67	51.8	5.5	49.2	42.3	35.3	27.2	19.1	-	48.0	6.1	46.2	39.8	33.4	25.2	17.1	-
	62	51.8	5.5	51.3	47.3	43.3	35.1	26.9	18.8	48.0	6.1	47.9	44.6	41.4	33.1	24.9	16.6
	57	51.8	5.6	51.8	51.8	51.3	43.0	34.8	26.5	48.0	6.2	48.0	48.0	41.0	32.6	24.2	
1750	77	58.8	5.5	42.0	30.3	18.6	-	-	-	53.3	6.1	40.2	28.1	15.9	-	-	-
	72	56.4	5.5	47.0	37.7	28.5	19.3	-	-	51.6	6.1	44.4	35.3	26.2	17.1	-	-
	67	54.0	5.5	52.0	45.2	38.5	28.9	19.4	-	49.9	6.1	48.5	42.4	36.4	26.8	17.3	-
	62	53.9	5.5	53.6	51.0	48.5	38.6	28.8	18.9	49.9	6.1	49.8	48.2	46.6	36.6	26.7	16.7
	57	53.9	5.6	53.9	53.9	53.9	48.3	38.1	27.9	49.9	6.2	49.9	49.9	46.4	36.0	25.6	
2000	77	59.4	5.5	46.2	31.9	17.7	-	-	-	54.0	6.1	43.9	29.2	14.5	-	-	-
	72	57.7	5.5	50.5	40.1	29.7	19.2	-	-	52.9	6.1	47.4	37.2	27.0	16.8	-	-
	67	56.1	5.5	54.8	48.2	41.6	30.7	19.7	-	51.7	6.1	50.8	45.1	39.4	28.5	17.5	-
	62	56.0	5.6	55.9	54.7	53.6	42.1	30.6	19.1	51.7	6.2	51.7	51.7	40.2	28.5	16.8	
	57	55.9	5.6	55.9	55.9	55.9	53.5	41.5	29.4	51.7	6.2	51.7	51.7	51.7	39.4	27.0	
2250	72	59.1	5.6	54.0	42.4	30.8	19.2	-	-	54.1	6.2	50.4	39.1	27.8	16.5	-	-
	67	58.2	5.6	57.6	51.2	44.8	32.4	20.0	-	53.5	6.2	53.2	47.8	42.4	30.1	17.7	-
	62	58.1	5.6	58.1	58.1	58.1	45.6	32.4	19.2	53.5	6.2	53.5	53.5	43.7	30.2	16.8	
	57	58.0	5.6	58.0	58.0	58.0	58.0	44.8	30.8	53.5	6.2	53.5	53.5	53.5	42.8	28.3	
2500	72	60.4	5.6	57.5	44.7	31.9	19.1	-	-	55.4	6.2	53.4	41.0	28.6	16.2	-	-
	67	60.3	5.6	60.3	54.1	47.9	34.1	20.3	-	55.4	6.2	55.4	50.5	45.5	31.7	17.9	-
	62	60.2	5.6	60.2	60.2	60.2	49.1	34.2	19.4	55.4	6.2	55.4	55.4	47.2	32.0	16.9	
	57	60.0	5.6	60.0	60.0	60.0	60.0	48.1	32.3	55.4	6.2	55.4	55.4	55.4	46.2	29.7	

1. These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate Blower Performance Table for the kW of the supply air blower motor.

2. These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

XYE04-09, XXEA7-12, XQE04-06 Heating Capacities**XYE04 Heating Capacities**

Size (Tons)	Model	Air Over Evaporator Coil		Capacity & kw	Outdoor Temperature (°F @ 72% RH)							
		CFM	DB		-10	0	10	20	30	40	50	60
04 (3)	XYE	900	55	MBH	2.5	8.1	13.7	19.3	24.8	30.4	36.0	41.6
				kW	2.2	2.3	2.4	2.6	2.7	2.9	3.0	3.1
			70	MBH	2.5	7.9	13.3	18.7	24.0	29.4	34.8	40.2
				kW	2.7	2.8	3.0	3.1	3.3	3.4	3.5	3.7
			80	MBH	2.5	7.8	13.0	18.3	23.5	28.7	34.0	39.2
				kW	3.0	3.2	3.4	3.6	3.7	3.9	4.1	4.3
		1200	55	MBH	3.1	8.7	14.4	20.0	25.6	31.2	36.8	42.4
				kW	2.3	2.4	2.4	2.5	2.6	2.6	2.7	2.8
			70	MBH	3.0	8.4	13.8	19.3	24.7	30.1	35.5	40.9
				kW	2.4	2.5	2.7	2.8	2.9	3.0	3.1	3.2
			80	MBH	2.5	7.8	13.2	18.5	23.8	29.2	34.5	39.9
				kW	2.8	2.9	3.0	3.1	3.3	3.4	3.5	3.6
		1500	55	MBH	4.2	9.7	15.3	20.9	26.4	32.0	37.6	43.1
				kW	2.1	2.2	2.3	2.4	2.4	2.5	2.6	2.7
			70	MBH	3.5	9.0	14.4	19.8	25.2	30.6	36.1	41.5
				kW	2.4	2.5	2.6	2.7	2.8	2.9	3.0	3.1
			80	MBH	2.5	7.9	13.3	18.7	24.1	29.5	34.9	40.3
				kW	2.8	2.9	3.0	3.1	3.2	3.3	3.4	3.5

XYE05 Heating Capacities

Size (Tons)	Model	Air Over Evaporator Coil		Capacity & kw	Outdoor Temperature (°F @ 72% RH)							
		CFM	DB		-10	0	10	20	30	40	50	60
05 (4)	XYE	1200	55	MBH	5.1	12.6	20.0	27.5	35.0	42.4	49.9	57.4
				kW	2.5	2.7	2.9	3.1	3.3	3.5	3.6	3.8
			70	MBH	5.5	12.5	19.5	26.5	33.5	40.5	47.5	54.5
				kW	2.9	3.1	3.3	3.5	3.7	4.0	4.2	4.4
			80	MBH	4.4	11.4	18.4	25.4	32.5	39.5	46.5	53.5
				kW	3.2	3.4	3.7	3.9	4.1	4.3	4.6	4.8
		1600	55	MBH	4.0	12.0	20.0	28.0	36.0	44.0	52.0	60.0
				kW	2.4	2.6	2.8	2.9	3.1	3.3	3.4	3.6
			70	MBH	4.3	11.8	19.4	26.9	34.4	42.0	49.5	57.1
				kW	2.9	3.0	3.2	3.4	3.6	3.8	3.9	4.1
			80	MBH	4.0	11.3	18.5	25.8	33.1	40.4	47.7	55.0
				kW	3.1	3.3	3.5	3.7	3.9	4.1	4.3	4.5
		2000	55	MBH	4.4	12.4	20.4	28.4	36.4	44.3	52.3	60.3
				kW	3.0	3.1	3.2	3.3	3.4	3.5	3.6	3.7
			70	MBH	4.9	12.4	19.9	27.4	34.9	42.4	49.9	57.4
				kW	3.4	3.5	3.6	3.8	3.9	4.0	4.1	4.2
			80	MBH	4.5	11.8	19.0	26.3	33.5	40.8	48.0	55.3
				kW	3.7	3.8	3.9	4.0	4.2	4.3	4.4	4.6

XYE06 Heating Capacities

Size (Tons)	Model	Air Over Evaporator Coil		Capacity & kw	Outdoor Temperature (°F @ 72% RH)							
		CFM	DB		-10	0	10	20	30	40	50	60
06 (5)	XYE	1500	55	MBH	6.5	15.6	24.7	33.7	42.8	51.9	61.0	70.1
				kW	3.6	3.7	3.8	3.9	4.0	4.2	4.3	4.4
			70	MBH	4.6	13.5	22.5	31.5	40.5	49.4	58.4	67.4
				kW	4.0	4.1	4.3	4.4	4.6	4.7	4.9	5.0
		2000	80	MBH	3.4	12.2	21.0	29.9	38.7	47.5	56.3	65.2
				kW	4.3	4.5	4.6	4.8	5.0	5.1	5.3	5.5
			55	MBH	5.3	14.5	23.8	33.0	42.3	51.6	60.8	70.1
				kW	3.5	3.6	3.7	3.9	4.0	4.1	4.3	4.4
		2500	70	MBH	4.2	13.3	22.3	31.3	40.3	49.4	58.4	67.4
				kW	3.8	4.0	4.2	4.4	4.5	4.7	4.9	5.1
			80	MBH	2.9	11.8	20.8	29.7	38.6	47.6	56.5	65.5
				kW	4.2	4.4	4.5	4.7	4.9	5.1	5.3	5.5

XYE07 Heating Capacities

Size (Tons)	Model	Airflow CFM	Indoor Temp	Capacity & kw	OUTDOOR TEMPERATURE (°F) (72% RH)							
					-10	0	10	20	30	40	50	60
07 (6)	XYE	1800	55	MBH	20.3	29.4	38.5	47.6	56.6	65.7	74.8	83.9
				kW	4.37	4.62	4.86	5.11	5.36	5.60	5.85	6.10
			70	MBH	17.0	26.0	35.1	44.2	53.3	62.3	71.4	80.5
				kW	5.00	5.25	5.50	5.74	5.99	6.24	6.49	6.73
		2400	80	MBH	14.3	23.3	32.4	41.5	50.6	59.6	68.7	77.8
				kW	5.49	5.74	5.99	6.23	6.48	6.73	6.97	7.22
			55	MBH	19.7	28.8	37.9	47.0	56.0	65.1	74.2	83.3
				kW	3.28	3.53	3.77	4.02	4.27	4.52	4.76	5.01
		3000	70	MBH	16.4	25.4	34.5	43.6	52.7	61.7	70.8	79.9
				kW	3.91	4.16	4.41	4.65	4.90	5.15	5.39	5.64
			80	MBH	13.7	22.7	31.8	40.9	50.0	59.0	68.1	77.2
				kW	4.40	4.64	4.89	5.14	5.39	5.63	5.88	6.13

XYE08 Heating Capacities

Size (Tons)	Model	Airflow CFM	Indoor Temp	Capacity & kw	OUTDOOR TEMPERATURE (°F) (72% RH)							
					-10	0	10	20	30	40	50	60
08 (7.5)	XYE	2250	55	MBH	20.5	31.9	43.3	54.7	66.2	77.6	89.0	100.5
				kW	4.26	4.56	4.87	5.18	5.49	5.79	6.10	6.41
			70	MBH	16.9	28.4	39.8	51.2	62.7	74.1	85.5	97.0
				kW	4.98	5.29	5.59	5.90	6.21	6.51	6.82	7.13
			80	MBH	15.7	27.2	38.6	50.0	61.5	72.9	84.3	95.8
				kW	5.74	6.05	6.36	6.67	6.97	7.28	7.59	7.89
		3000	55	MBH	20.6	32.1	43.5	54.9	66.4	77.8	89.2	100.7
				kW	3.82	4.12	4.43	4.74	5.05	5.35	5.66	5.97
			70	MBH	17.1	28.6	40.0	51.4	62.9	74.3	85.7	97.2
				kW	4.54	4.85	5.15	5.46	5.77	6.08	6.38	6.69
			80	MBH	15.9	27.3	38.8	50.2	61.6	73.1	84.5	95.9
				kW	5.30	5.61	5.92	6.22	6.53	6.84	7.15	7.45
		3750	55	MBH	21.9	33.3	44.8	56.2	67.6	79.0	90.5	101.9
				kW	3.57	3.88	4.18	4.49	4.80	5.11	5.41	5.72
			70	MBH	18.4	29.8	41.2	52.7	64.1	75.5	87.0	98.4
				kW	4.29	4.60	4.91	5.21	5.52	5.83	6.13	6.44
			80	MBH	17.2	28.6	40.0	51.5	62.9	74.3	85.8	97.2
				kW	5.06	5.36	5.67	5.98	6.29	6.59	6.90	7.21

XYE09 Heating Capacities

Size (Tons)	Model	Airflow CFM	Indoor Temp	Capacity & kw	OUTDOOR TEMPERATURE (°F) (72% RH)							
					-10	0	10	20	30	40	50	60
09 (8.5)	XYE	2550	55	MBH	20.6	34.0	47.5	61.0	74.4	87.9	101.4	114.8
				kW	4.30	4.70	5.10	5.50	5.90	6.30	6.70	7.10
			70	MBH	15.1	28.6	42.0	55.5	69.0	82.4	95.9	109.4
				kW	5.32	5.72	6.12	6.52	6.92	7.32	7.72	8.12
			80	MBH	12.1	25.6	39.1	52.5	66.0	79.5	92.9	106.4
				kW	6.19	6.59	6.99	7.39	7.79	8.19	8.59	8.99
		3400	55	MBH	22.4	35.8	49.3	62.8	76.2	89.7	103.2	116.6
				kW	3.63	4.03	4.43	4.82	5.22	5.62	6.02	6.42
			70	MBH	17.0	30.4	43.9	57.4	70.8	84.3	97.8	111.2
				kW	4.66	5.06	5.46	5.85	6.25	6.65	7.05	7.45
			80	MBH	13.9	27.4	40.9	54.3	67.8	81.3	94.7	108.2
				kW	5.52	5.92	6.32	6.71	7.11	7.51	7.91	8.31
		4250	55	MBH	22.7	36.2	49.7	63.1	76.6	90.1	103.5	117.0
				kW	3.25	3.65	4.05	4.44	4.84	5.24	5.64	6.04
			70	MBH	17.3	30.7	44.2	57.7	71.1	84.6	98.1	111.5
				kW	4.27	4.67	5.07	5.47	5.87	6.27	6.67	7.06
			80	MBH	14.3	27.8	41.2	54.7	68.2	81.6	95.1	108.6
				kW	5.14	5.54	5.94	6.34	6.74	7.13	7.53	7.93

XXEA7 Heating Capacities

Size (Tons)	Model	Airflow CFM	Indoor Temp	Capacity & kw	OUTDOOR TEMPERATURE (°F) (72% RH)							
					-10	0	10	20	30	40	50	60
A7 (6)	XXE	1800	55	MBH	10.7	20.9	31.0	41.1	51.3	61.4	71.5	81.7
				kW	3.28	3.50	3.72	3.94	4.16	4.38	4.60	4.83
			70	MBH	7.3	17.5	27.6	37.7	47.9	58.0	68.2	78.3
				kW	3.87	4.09	4.32	4.54	4.76	4.98	5.20	5.42
		2400	80	MBH	4.7	14.9	25.0	35.1	45.3	55.4	65.6	75.7
				kW	4.38	4.60	4.82	5.04	5.26	5.48	5.70	5.93
			55	MBH	10.6	20.8	30.9	41.0	51.2	61.3	71.4	81.6
				kW	2.75	2.97	3.20	3.42	3.64	3.86	4.08	4.30
		3000	70	MBH	7.3	17.5	27.6	37.7	47.9	58.0	68.1	78.3
				kW	3.38	3.60	3.82	4.04	4.27	4.49	4.71	4.93
			80	MBH	4.7	14.8	24.9	35.1	45.2	55.4	65.5	75.6
				kW	3.87	4.09	4.31	4.53	4.75	4.97	5.19	5.42

XXE08 Heating Capacities

Size (Tons)	Model	Airflow CFM	Indoor Temp	Capacity & kw	OUTDOOR TEMPERATURE (°F) (72% RH)							
					-10	0	10	20	30	40	50	60
08 (7.5)	XXE	2250	55	MBH	16.0	27.6	39.3	51.0	62.6	74.3	86.0	97.6
				kW	4.65	4.85	5.05	5.25	5.45	5.66	5.86	6.06
			70	MBH	11.3	23.0	34.6	46.3	58.0	69.6	81.3	92.9
				kW	5.60	5.80	6.00	6.20	6.41	6.61	6.81	7.01
		3000	80	MBH	7.2	18.9	30.5	42.2	53.8	65.5	77.2	88.8
				kW	6.34	6.54	6.74	6.95	7.15	7.35	7.55	7.75
			55	MBH	19.3	31.0	42.6	54.3	66.0	77.6	89.3	100.9
				kW	4.08	4.28	4.48	4.68	4.89	5.09	5.29	5.49
		3750	70	MBH	14.6	26.3	38.0	49.6	61.3	73.0	84.6	96.3
				kW	5.03	5.23	5.44	5.64	5.84	6.04	6.24	6.44
			80	MBH	10.5	22.2	33.8	45.5	57.2	68.8	80.5	92.1
				kW	5.77	5.97	6.17	6.37	6.58	6.78	6.98	7.18

XXE09 Heating Capacities

Size (Tons)	Model	Airflow CFM	Indoor Temp	Capacity & kw	OUTDOOR TEMPERATURE (°F) (72% RH)							
					-10	0	10	20	30	40	50	60
09 (8.5)	XXE	2550	55	MBH	17.0	29.9	42.8	55.7	68.7	81.6	94.5	107.4
				kW	5.83	6.07	6.30	6.54	6.78	7.02	7.25	7.49
			70	MBH	14.1	27.0	39.9	52.8	65.7	78.7	91.6	104.5
				kW	7.06	7.30	7.54	7.78	8.01	8.25	8.49	8.73
		3400	80	MBH	8.8	21.7	34.6	47.5	60.5	73.4	86.3	99.2
				kW	7.88	8.12	8.35	8.59	8.83	9.07	9.30	9.54
			55	MBH	22.2	35.2	48.1	61.0	73.9	86.8	99.7	112.7
				kW	4.58	4.82	5.06	5.30	5.53	5.77	6.01	6.25
		4250	70	MBH	19.2	32.1	45.0	57.9	70.9	83.8	96.7	109.6
				kW	5.79	6.02	6.26	6.50	6.74	6.97	7.21	7.45
			80	MBH	13.9	26.9	39.8	52.7	65.6	78.5	91.5	104.4
				kW	6.61	6.85	7.09	7.32	7.56	7.80	8.04	8.27

XXE12 Heating Capacities

Size (Tons)	Model	Airflow CFM	Indoor Temp	Capacity & kw	OUTDOOR TEMPERATURE (°F) (72% RH)							
					-10	0	10	20	30	40	50	60
12 (10)	XXE	3000	55	MBH	19.3	34.9	50.4	65.9	81.4	97.0	112.5	128.0
				kW	5.01	5.53	6.04	6.56	7.07	7.58	8.10	8.61
			70	MBH	15.1	30.6	46.1	61.6	77.2	92.7	108.2	123.8
				kW	6.16	6.68	7.19	7.71	8.22	8.73	9.25	9.76
			80	MBH	15.6	31.2	46.7	62.2	77.7	93.3	108.8	124.3
				kW	7.11	7.63	8.14	8.66	9.17	9.68	10.20	10.71
		4000	55	MBH	20.4	35.9	51.5	67.0	82.5	98.1	113.6	129.1
				kW	4.27	4.79	5.30	5.82	6.33	6.84	7.36	7.87
			70	MBH	16.2	31.7	47.2	62.8	78.3	93.8	109.3	124.9
				kW	5.43	5.95	6.46	6.98	7.49	8.00	8.52	9.03
			80	MBH	16.8	32.3	47.8	63.4	78.9	94.4	109.9	125.5
				kW	6.39	6.91	7.42	7.94	8.45	8.96	9.48	9.99
		5000	55	MBH	22.4	38.0	53.5	69.0	84.5	100.1	115.6	131.1
				kW	3.81	4.33	4.84	5.36	5.87	6.38	6.90	7.41
			70	MBH	18.2	33.7	49.2	64.7	80.3	95.8	111.3	126.8
				kW	4.96	5.48	5.99	6.51	7.02	7.53	8.05	8.56
			80	MBH	18.7	34.3	49.8	65.3	80.8	96.4	111.9	127.4
				kW	5.91	6.43	6.94	7.46	7.97	8.48	9.00	9.51

XQE04 Heating Capacities

Size (Tons)	Model	Airflow CFM	Indoor Temp	Capacity & kw	OUTDOOR TEMPERATURE (°F) (72% RH)							
					-10	0	10	20	30	40	50	60
04 (3)	XQE	900	55	MBH	5.9	11.2	16.5	21.8	27.1	32.4	37.7	43.0
				kW	1.93	2.05	2.18	2.30	2.43	2.56	2.68	2.81
			70	MBH	4.0	9.3	14.6	19.9	25.2	30.5	35.8	41.1
				kW	2.38	2.50	2.63	2.75	2.88	3.01	3.13	3.26
		1200	80	MBH	3.0	8.3	13.6	18.9	24.2	29.5	34.8	40.1
				kW	2.78	2.91	3.04	3.16	3.29	3.41	3.54	3.67
			55	MBH	5.8	11.1	16.4	21.7	27.0	32.3	37.6	42.9
				kW	1.62	1.74	1.87	2.00	2.12	2.25	2.37	2.50
		1500	70	MBH	3.9	9.2	14.5	19.8	25.1	30.4	35.7	41.0
				kW	2.06	2.19	2.31	2.44	2.57	2.69	2.82	2.94
			80	MBH	2.8	8.1	13.4	18.7	24.0	29.3	34.6	39.9
				kW	2.47	2.59	2.72	2.85	2.97	3.10	3.22	3.35
		55	70	MBH	6.5	11.8	17.1	22.4	27.7	33.0	38.3	43.6
				kW	1.49	1.62	1.74	1.87	2.00	2.12	2.25	2.37
			80	MBH	4.6	9.9	15.2	20.5	25.8	31.2	36.5	41.8
				kW	1.94	2.07	2.19	2.32	2.45	2.57	2.70	2.82
		55	80	MBH	3.6	8.9	14.2	19.5	24.8	30.1	35.4	40.7
				kW	2.35	2.48	2.60	2.73	2.85	2.98	3.11	3.23

XQE05 Heating Capacities

Size (Tons)	Model	Airflow CFM	Indoor Temp	Capacity & kw	Outdoor Temperature (F @ 72% RH)							
					-10	0	10	20	30	40	50	60
05 (4)	XQ	1200	55	MBH	7.9	14.6	21.2	27.9	34.5	41.1	47.8	54.4
				kW	3.1	3.2	3.3	3.4	3.5	3.6	3.7	3.8
			70	MBH	7.3	13.7	20.1	26.6	33.0	39.5	45.9	52.4
				kW	3.6	3.8	3.9	4.0	4.1	4.3	4.4	4.5
		1600	80	MBH	6.6	13.0	19.3	25.7	32.1	38.4	44.8	51.2
				kW	4.1	4.2	4.4	4.5	4.7	4.8	5.0	5.1
			55	MBH	8.3	15.1	21.9	28.7	35.5	42.3	49.1	55.9
				kW	3.0	3.1	3.1	3.2	3.3	3.3	3.4	3.4
		2000	70	MBH	7.8	14.3	20.9	27.5	34.1	40.7	47.2	53.8
				kW	3.4	3.5	3.6	3.7	3.8	3.9	4.0	4.1
			80	MBH	7.0	13.5	20.0	26.5	33.0	39.5	46.0	52.6
				kW	3.8	3.9	4.0	4.1	4.2	4.3	4.4	4.5
		55	80	MBH	9.1	16.0	22.8	29.7	36.6	43.4	50.3	57.2
				kW	3.3	3.4	3.4	3.4	3.5	3.5	3.6	3.6
			70	MBH	8.2	15.0	21.7	28.5	35.3	42.0	48.8	55.5
				kW	3.8	3.9	3.9	4.0	4.0	4.1	4.1	4.1
			80	MBH	7.0	13.7	20.5	27.3	34.1	40.9	47.6	54.4
				kW	4.2	4.2	4.3	4.3	4.4	4.5	4.5	4.6

XQE06 Heating Capacities

Size (Tons)	Model	Airflow CFM	Indoor Temp	Capacity & kw	Outdoor Temperature (F @ 72% RH)							
					-10	0	10	20	30	40	50	60
06 (5)	XQ	1500	55	MBH	8.4	16.7	24.9	33.1	41.3	49.5	57.7	66.0
				kW	3.6	3.7	3.8	4.0	4.1	4.3	4.4	4.5
			70	MBH	6.4	14.4	22.4	30.5	38.5	46.5	54.5	62.5
				kW	4.0	4.1	4.3	4.5	4.7	4.8	5.0	5.2
		2000	80	MBH	--	13.2	21.1	29.0	36.9	44.8	52.7	60.6
				kW	4.4	4.6	4.8	4.9	5.1	5.3	5.5	5.7
			55	MBH	7.8	16.3	24.8	33.2	41.7	50.1	58.6	67.1
				kW	3.8	3.9	4.0	4.1	4.2	4.3	4.4	4.5
		2500	70	MBH	4.7	13.2	21.7	30.2	38.7	47.2	55.7	64.2
				kW	4.2	4.3	4.4	4.6	4.7	4.8	4.9	5.0
			80	MBH	--	9.5	18.2	27.0	35.7	44.5	53.2	61.9
				kW	4.5	4.7	4.8	4.9	5.1	5.2	5.3	5.5
			55	MBH	7.8	16.5	25.3	34.0	42.7	51.4	60.1	68.8
				kW	4.0	4.1	4.1	4.2	4.2	4.3	4.4	4.4
			70	MBH	4.2	13.0	21.9	30.7	39.6	48.4	57.2	66.1
				kW	4.4	4.5	4.6	4.6	4.7	4.8	4.9	5.0
			80	MBH	3.7	12.2	20.7	29.2	37.8	46.3	54.8	63.3
				kW	4.8	4.9	5.0	5.1	5.2	5.2	5.3	5.4

Drive Selection

1. Determine side or bottom supply duct Application.
2. Determine desired airflow.
3. Calculate or measure the amount of external static pressure.
4. Add or deduct any additional static resistance from "Additional Static Resistance Table".
5. Using the operating point determined from steps 1, 2 & 3, locate this point on the appropriate supply air blower performance table. (Linear interpolation may be necessary.)
6. Noting the RPM and BHP from step 4, locate the appropriate motor and, or drive on the RPM selection table.
7. Review the BHP compared to the motor options available. Select the appropriate motor and, or drive.
8. Review the RPM range for the motor options available. Select the appropriate drive if multiple drives are available for the chosen motor.
9. Determine turns open to obtain the desired operation point.


Example

1. 1600 CFM
2. 1.4 iwg
3. Using the airflow performance table below, the following data point was located: 1417 RPM & 1.28 BHP.
4. Using the RPM selection table below, Model XYE and Size 05 (4-Tons) is found.
5. The High Static Option is selected to achieve the required 1417 RPM.
6. Using the High Static Option, 2 turns open will achieve 1417 RPM.

Airflow Performance**Example Supply Air Blower Performance****XYE05 (4.0 Ton) Bottom Duct**

CFM	Available External Static																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
1200	801	0.25	903	0.38	999	0.51	1089	0.63	1173	0.76	1252	0.88	1327	1.00	1396	1.11	1461	1.22	1521	1.33
1300	822	0.31	924	0.44	1020	0.57	1110	0.69	1194	0.82	1273	0.94	1348	1.06	1417	1.17	1482	1.28	1542	1.39
1400	844	0.38	946	0.51	1042	0.64	1132	0.76	1216	0.89	1295	1.01	1370	1.13	1439	1.24	1504	1.35	1564	1.46
1500	867	0.46	969	0.59	1065	0.71	1155	0.84	1239	0.96	1319	1.08	1393	1.20	1462	1.32	1527	1.43	1587	1.53
1600	891	0.54	993	0.67	1089	0.79	1179	0.92	1264	1.04	1343	1.16	1417	1.28	1486	1.40	1551	1.51	1612	1.61
1700	917	0.63	1019	0.75	1115	0.88	1205	1.01	1289	1.13	1368	1.25	1442	1.37	1512	1.48	1577	1.60	1637	1.70
1800	943	0.72	1045	0.85	1141	0.97	1231	1.10	1316	1.22	1395	1.34	1469	1.46	1538	1.58	1603	1.69	--	--
1900	971	0.81	1073	0.94	1169	1.07	1259	1.19	1344	1.32	1423	1.44	1497	1.56	1566	1.67	1631	1.78	--	--
2000	1000	0.92	1102	1.04	1198	1.17	1288	1.29	1372	1.42	1452	1.54	1526	1.66	1595	1.77	--	--	--	--

$$\text{kW} = 0.929 \times \text{BHP}$$



Medium Static Option with Motor rated at 2.4-hp
 High Static Option with Motor rated at 2.4-hp
Bold Field-supplied AK41 x 3/4" fixed blower pulley with motor rated at 2.4-hp
 -- Exceeds recommended blower speed

Example RPM Selection

Model	Size (Tons)	Airflow Option	Phase	Max BHP	Blower Sheave	Motor Sheave	6 Turns Open	5 Turns Open	4 Turns Open	3 Turns Open	2 Turns Open	1 Turns Open	Fully Closed
XYE	05 (4)	Std.					Direct Drive						
		Med.	3	2.4	AK46	1VL34	N/A	792	875	958	1042	1125	1208
		H. Static	3	2.4	AK46	1VL44	N/A	1167	1250	1333	1417	1500	1593

Example Additional Static Resistance

Model	Size (Tons)	CFM	Economizer ^{1,2}	4" Filter ¹	Electric Heat kW ²				
					6/6.5	9.2/10.5/11	13.8/14/16	23	---
XYE	05 (4.0)	1200	0.24	---	0.01	0.01	0.02	0.03	---
		1300	0.28	---	0.01	0.01	0.03	0.03	---
		1400	0.33	---	0.02	0.02	0.03	0.04	---
		1500	0.44	---	0.02	0.02	0.04	0.04	---
		1600	0.52	---	0.02	0.02	0.04	0.05	---
		1700	0.59	---	0.03	0.03	0.05	0.05	---
		1800	0.66	---	0.03	0.03	0.05	0.06	---
		1900	0.74	---	0.04	0.04	0.06	0.07	---
		2000	0.81	---	0.04	0.04	0.07	0.08	---

Altitude and Temperature Correction for CFM, Static Pressure and Power.

The information below should be used to assist in application of product when being applied at altitudes at or exceeding 1000 feet above sea level.


The air flow rates listed in the standard blower performance tables are based on standard air at sea level. As the altitude or temperature increases, the density of air decreases. In order to

use the indoor blower tables for high altitude applications, certain corrections are necessary.

A centrifugal fan is a "constant volume" device. This means that, if the RPM remains constant, the CFM delivered is the same regardless of the density of the air. However, since the air at high altitude is less dense, less static pressure will be generated and less power will be required than a similar application at sea level. Air density correction factors are shown below.

Altitude/Temperature Correction Factors

Air Temp.	Altitude (Ft.)										
	0	1000	2000	3000	4000	5000	6000	7000	8000	9000	10000
40	1.060	1.022	0.986	0.950	0.916	0.882	0.849	0.818	0.788	0.758	0.729
50	1.039	1.002	0.966	0.931	0.898	0.864	0.832	0.802	0.772	0.743	0.715
60	1.019	0.982	0.948	0.913	0.880	0.848	0.816	0.787	0.757	0.729	0.701
70	1.000	0.964	0.930	0.896	0.864	0.832	0.801	0.772	0.743	0.715	0.688
80	0.982	0.947	0.913	0.880	0.848	0.817	0.787	0.758	0.730	0.702	0.676
90	0.964	0.929	0.897	0.864	0.833	0.802	0.772	0.744	0.716	0.689	0.663
100	0.946	0.912	0.880	0.848	0.817	0.787	0.758	0.730	0.703	0.676	0.651

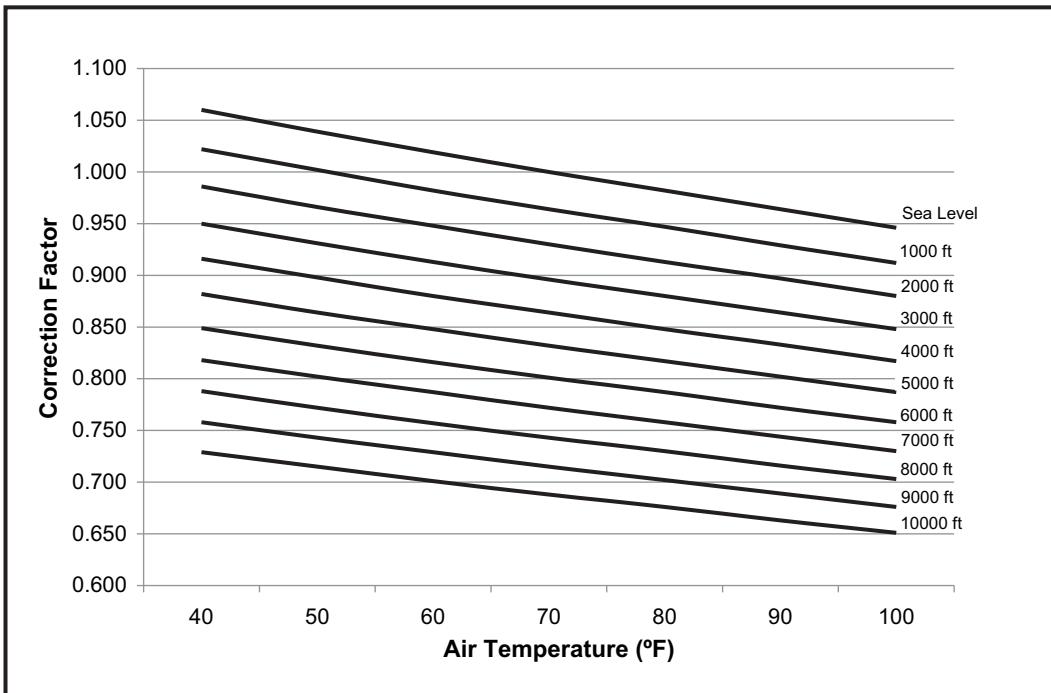

The examples below will assist in determining the airflow performance of the product at altitude.

Example 1: What are the corrected CFM, static pressure, and BHP at an elevation of 5,000 ft. if the airflow performance data is 3,000 CFM, 1.4 IWC and 2.0 BHP?

Solution: At an elevation of 5,000 ft. the indoor blower will still deliver 3,000 CFM if the rpm is unchanged. However, the Altitude correction must be used to determine the static pressure and BHP. Since no temperature data is given, we will assume an Air Temperature of 70°F. The Altitude/Temperature Factors show the correction factor to be 0.832.

$$\text{Corrected static pressure} = 1.4 \times 0.832 = 1.16 \text{ IWC}$$

$$\text{Corrected BHP} = 2.0 \times 0.832 = 1.66$$

Example 2: A system, located at 5,000 feet of elevation, is to deliver 3,000 CFM at a static pressure of 1.4". Use the unit

blower tables to select the blower speed and the BHP requirement.

Solution: As in the example above, no temperature information is given so 70°F is assumed.

The 1.4" static pressure given is at an elevation of 5,000 ft. The first step is to convert this static pressure to equivalent sea level conditions.

$$\text{Sea level static pressure} = 1.4" / .832 = 1.68"$$

Enter the Supply Air Blower Performance Table at 3,000 CFM and static pressure of 1.68". The rpm listed will be the same rpm needed at 5,000 ft.

Suppose that the corresponding BHP listed in the table is 2.0. This value must be corrected for elevation.

$$\text{BHP at 5,000 ft.} = 2.0 \times .832 = 1.66$$

Indoor Blower Specifications

Model	Size (Tons)	Airflow Option	Motor						Motor Sheave			Blower Sheave			Belt
			Phase	Bhp	RPM	Eff.	SF	Frame	Datum Dia. (in.)	Bore (in.)	Model	Datum Dia. (in.)	Bore (in.)	Model	
XYE	04 (3)	Std.							Direct Drive						
		Med.	1	1.5	1725	0.79	1.15	56HZ	1.9 - 2.9	5/8	1VL34	4.2	3/4	AK46	A39
		Med.	3	2.4	1725	0.80	1.15	56Y	1.9 - 2.9	5/8	1VL34	4.2	3/4	AK46	A39
		H. Static	3	2.4	1725	0.80	1.15	56Y	2.8 - 3.8	5/8	1VL44	4.2	3/4	AK46	A40
XYE	05 (4)	Std.							Direct Drive						
		Med.	1	1.5	1725	0.79	1.15	56HZ	1.9 - 2.9	5/8	1VL34	4.2	3/4	AK46	A39
		Med.	3	2.4	1725	0.80	1.15	56Y	1.9 - 2.9	5/8	1VL34	4.2	3/4	AK46	A39
		H. Static	3	2.4	1725	0.80	1.15	56Y	2.8 - 3.8	5/8	1VL44	4.2	3/4	AK46	A40
XYE	06 (5)	Std.							Direct Drive						
		Med.	1	1.5	1750	0.83	1.15	56H	1.9 - 2.9	5/8	1VL34	4.2	3/4	AK46	A37
		Med.	3	2.4	1750	0.87	1.15	56HZ	1.9 - 2.9	5/8	1VL34	4.2	3/4	AK46	A37
		H. Static	3	2.9	1750	0.87	1.15	56Z	2.8 - 3.8	7/8	1VL44	4.2	3/4	AK46	A39
XYE	07 (6)	Std.	3	2.4	1725	0.80	1.15	56Y	1.9 - 2.9	5/8	1VL34	7.0	1	AK74	A47
		Med.	3	2.9	1725	0.81	1.15	56Y	2.8 - 3.8	7/8	1VL44	7.0	1	AK74	A48
		H. Static	3	3.7	1725	0.84	1.15	56HZ	3.4 - 4.4	7/8	1VP50	7.0	1	AK74	A48
XYE	08 (7.5)	Std.	3	2.4	1725	0.80	1.15	56Y	1.9 - 2.9	5/8	1VL34	7.0	1	AK74	A47
		Med.	3	2.4	1725	0.80	1.15	56Y	2.8 - 3.8	5/8	1VL44	7.0	1	AK74	A48
		H. Static	3	3.7	1725	0.84	1.15	56HZ	3.4 - 4.4	7/8	1VP50	7.0	1	AK74	A50
XYE	09 (8.5)	Std.	3	2.4	1725	0.80	1.15	56Y	1.9 - 2.9	5/8	1VL34	7.0	1	AK74	A47
		Med.	3	2.4	1725	0.80	1.15	56Y	2.8 - 3.8	5/8	1VL44	7.0	1	AK74	A48
		H. Static	3	3.7	1725	0.84	1.15	56HZ	3.4 - 4.4	7/8	1VP50	7.0	1	AK74	A50
XXE	A7 (6)	Std.	3	2.4	1725	0.80	1.15	56Y	1.9 - 2.9	5/8	1VL34	4.7	3/4	AK51	A39
		Med.	3	2.9	1725	0.81	1.15	56Y	2.8 - 3.8	7/8	1VL44	4.7	3/4	AK51	A40
		H. Static	3	3.7	1725	0.84	1.15	56HZ	3.4 - 4.4	7/8	1VP50	4.7	3/4	AK51	A41
XXE	08 (7.5)	Std.	3	2.4	1725	0.80	1.15	56Y	1.9 - 2.9	5/8	1VL34	7.0	1	AK74	A47
		Med.	3	2.4	1725	0.80	1.15	56Y	2.8 - 3.8	5/8	1VL44	7.0	1	AK74	A48
		H. Static	3	3.7	1725	0.84	1.15	56HZ	3.4 - 4.4	7/8	1VP50	7.0	1	AK74	A50
XXE	09 (8.5)	Std.	3	2.4	1725	0.80	1.15	56Y	1.9 - 2.9	5/8	1VL34	7.0	1	AK74	A47
		Med.	3	2.4	1725	0.80	1.15	56Y	2.8 - 3.8	5/8	1VL44	7.0	1	AK74	A48
		H. Static	3	3.7	1725	0.84	1.15	56HZ	3.4 - 4.4	7/8	1VP50	7.0	1	AK74	A50
XXE	12 (10)	Std.	3	2.4	1725	0.80	1.15	56Y	2.8 - 3.8	5/8	1VL44	7.5	1	AK79	A50
		Med.	3	3.7	1725	0.84	1.15	56HZ	3.4 - 4.4	7/8	1VP50	7.5	1	AK79	A50
		H. Static	3	5.25	1725	0.84	1.15	145TY	4.3 - 5.3	7/8	1VP56	7.9	1	BK85	BX52
XQE	04 (3)	Std.							Direct Drive						
		Med.	1	1.5	1725	0.79	1.15	56HZ	1.9 - 2.9	5/8	1VL34	4.2	3/4	AK46	A39
		Med.	3	2.4	1725	0.80	1.15	56Y	1.9 - 2.9	5/8	1VL34	4.2	3/4	AK46	A39
		H. Static	3	2.4	1725	0.80	1.15	56Y	2.8 - 3.8	5/8	1VL44	4.2	3/4	AK46	A40

Indoor Blower Specifications (Continued)

XQE	05 (4)	Std.	Direct Drive												
		Med.	1	1.5	1725	0.79	1.15	56HZ	1.9 - 2.9	5/8	1VL34	4.2	3/4	AK46	A39
		Med.	3	2.4	1725	0.80	1.15	56Y	1.9 - 2.9	5/8	1VL34	4.2	3/4	AK46	A39
		H. Static	3	2.4	1725	0.80	1.15	56Y	2.8 - 3.8	5/8	1VL44	4.2	3/4	AK46	A40
XQE	06 (5)	Std.	Direct Drive												
		Med.	1	1.5	1750	0.83	1.15	56H	1.9 - 2.9	5/8	1VL34	4.2	3/4	AK46	A37
		Med.	3	2.4	1750	0.87	1.15	56HZ	1.9 - 2.9	5/8	1VL34	4.2	3/4	AK46	A37
		H. Static	3	2.9	1750	0.87	1.15	56Z	2.8 - 3.8	7/8	1VL44	4.2	3/4	AK46	A39

RPM Selection

Model	Size (Tons)	Airflow Option	Phase	Max BHP	Blower Sheave	Motor Sheave	6 Turns Open	5 Turns Open	4 Turns Open	3 Turns Open	2 Turns Open	1 Turns Open	Fully Closed
Std.												Direct Drive	
XYE	04 (3)	Med	1	1.5	AK46	1VL34	N/A	792	875	958	1042	1125	1208
		Med	3	2.4	AK46	1VL34	N/A	792	875	958	1042	1125	1208
		H. Static	3	2.4	AK46	1VL44	N/A	1167	1250	1333	1417	1500	1593
Std.												Direct Drive	
XYE	05 (4)	Med	1	1.5	AK46	1VL34	N/A	792	875	958	1042	1125	1208
		Med	3	2.4	AK46	1VL34	N/A	792	875	958	1042	1125	1208
		H. Static	3	2.4	AK46	1VL44	N/A	1167	1250	1333	1417	1500	1593
Std.												Direct Drive	
XYE	06 (5)	Med	1	1.5	AK46	1VL34	N/A	792	875	958	1042	1125	1208
		Med	3	2.4	AK46	1VL34	N/A	792	875	958	1042	1125	1208
		H. Static	3	2.9	AK46	1VL44	N/A	1167	1250	1333	1417	1500	1593
Std.												Direct Drive	
XYE	07 (6)	Med	3	2.4	AK74	1VL34	N/A	475	525	575	625	675	725
		Med	3	2.9	AK74	1VL44	N/A	700	750	800	850	900	950
		H. Static	3	3.7	AK74	1VP50	N/A	850	900	950	1000	1050	1100
Std.												Direct Drive	
XYE	08 (7.5)	Med	3	2.4	AK74	1VL34	N/A	475	525	575	625	675	725
		Med	3	2.4	AK74	1VL44	N/A	700	750	800	850	900	950
		H. Static	3	3.7	AK74	1VP50	N/A	850	900	950	1000	1050	1100
Std.												Direct Drive	
XYE	09 (8.5)	Med	3	2.4	AK74	1VL34	N/A	475	525	575	625	675	725
		Med	3	2.4	AK74	1VL44	N/A	700	750	800	850	900	950
		H. Static	3	3.7	AK74	1VP50	N/A	850	900	950	1000	1050	1100
Std.												Direct Drive	
XXE	A7 (6)	Med	3	2.4	AK51	1VL34	N/A	707	782	856	931	1005	1080
		Med	3	2.9	AK51	1VL44	N/A	1043	1117	1191	1266	1340	1415
		H. Static	3	3.7	AK51	1VP50	N/A	1266	1340	1415	1489	1564	1638
Std.												Direct Drive	
XXE	08 (7.5)	Med	3	2.4	AK74	1VL34	N/A	475	525	575	625	675	725
		Med	3	2.9	AK74	1VL44	N/A	700	750	800	850	900	950
		H. Static	3	3.7	AK74	1VP50	N/A	850	900	950	1000	1050	1100
Std.												Direct Drive	
XXE	9 (8.5)	Med	3	2.4	AK74	1VL34	N/A	475	525	575	625	675	725
		Med	3	2.4	AK74	1VL44	N/A	700	750	800	850	900	950
		H. Static	3	3.7	AK74	1VP50	N/A	850	900	950	1000	1050	1100
Std.												Direct Drive	
XXE	12 (10)	Med	3	2.4	AK79	1VL44	N/A	653	700	747	793	840	887
		Med	3	3.7	AK79	1VP50	N/A	793	840	887	933	980	1027
		H. Static	3	5.25	BK85	1VP56	953	997	1041	1085	1130	1174	N/A
Std.												Direct Drive	
XQE	04 (3)	Med	1	1.5	AK46	1VL34	N/A	792	875	958	1042	1125	1208
		Med	3	2.4	AK46	1VL34	N/A	792	875	958	1042	1125	1208
		H. Static	3	2.4	AK46	1VL44	N/A	1167	1250	1333	1417	1500	1593
Std.												Direct Drive	
XQE	05 (4)	Med	1	1.5	AK46	1VL34	N/A	792	875	958	1042	1125	1208
		Med	3	2.4	AK46	1VL34	N/A	792	875	958	1042	1125	1208
		H. Static	3	2.4	AK46	1VL44	N/A	1167	1250	1333	1417	1500	1593
Std.												Direct Drive	
XQE	06 (5)	Med	1	1.5	AK46	1VL34	N/A	792	875	958	1042	1125	1208
		Med	3	2.4	AK46	1VL34	N/A	792	875	958	1042	1125	1208
		H. Static	3	2.9	AK46	1VL44	N/A	1167	1250	1333	1417	1500	1593

Additional Static Resistance - XYE04-06

Model	Size (Tons)	CFM	Economizer ^{1 2}	4" Filter ¹	Electric Heat kW ²				
					6/6.5	9.2/10.5/11	13.8/14/16	23	---
XYE	04 (3.0)	900	0.15	---	0.00	0.00	0.01	0.01	---
		1000	0.18	---	0.00	0.00	0.02	0.02	---
		1100	0.21	---	0.01	0.01	0.02	0.03	---
		1200	0.24	---	0.01	0.01	0.02	0.03	---
		1300	0.28	---	0.01	0.01	0.03	0.03	---
		1400	0.33	---	0.02	0.02	0.03	0.04	---
		1500	0.44	---	0.02	0.02	0.04	0.04	---
XYE	05 (4.0)	1200	0.24	---	0.01	0.01	0.02	0.03	---
		1300	0.28	---	0.01	0.01	0.03	0.03	---
		1400	0.33	---	0.02	0.02	0.03	0.04	---
		1500	0.44	---	0.02	0.02	0.04	0.04	---
		1600	0.52	---	0.02	0.02	0.04	0.05	---
		1700	0.59	---	0.03	0.03	0.05	0.05	---
		1800	0.66	---	0.03	0.03	0.05	0.06	---
		1900	0.74	---	0.04	0.04	0.06	0.07	---
		2000	0.81	---	0.04	0.04	0.07	0.08	---
XYE	06 (5.0)	1800	0.66	---	0.03	0.03	0.05	0.06	---
		2000	0.81	---	0.04	0.04	0.07	0.08	---
		2200	0.95	---	0.06	0.06	0.08	0.09	---
		2400	1.10	---	0.07	0.07	0.10	0.11	---
		2500	1.17	---	0.08	0.08	0.11	0.12	---

1. Deduct these values from the available external static pressure shown in the respective Blower Performance Tables.

2. The pressure drop through the economizer is greater for 100% outdoor air than for 100% return air. If the resistance of the return air duct is less than 0.25 IWG, the unit will deliver less CFM during full economizer operation.

Additional Static Resistance - XYE07

Model	Size (Tons)	CFM	Economizer ^{1 2}	4" Filter ¹	Electric Heat kW ²		
					6/6.5	16/16.5/17	24.8/25.5/27.8
XYE	07 (6)	1800	0.11	---	0.03	0.05	0.06
		1900	0.11	---	0.04	0.06	0.06
		2000	0.11	---	0.04	0.06	0.07
		2100	0.12	---	0.05	0.07	0.08
		2200	0.12	---	0.06	0.07	0.09
		2300	0.12	---	0.06	0.08	0.09
		2400	0.13	---	0.07	0.08	0.10
		2500	0.13	---	0.08	0.09	0.11
		2600	0.13	---	0.08	0.09	0.11
		2700	0.15	---	0.09	0.10	0.12
		2800	0.15	---	0.09	0.10	0.12
		2900	0.16	---	0.10	0.11	0.13
		3000	0.17	---	0.11	0.12	0.14

1. Deduct these values from the available external static pressure shown in the respective Blower Performance Tables.

2. The pressure drop through the economizer is greater for 100% outdoor air than for 100% return air. If the resistance of the return air duct is less than 0.25 IWG, the unit will deliver less CFM during full economizer operation.

Additional Static Resistance - XYE08 thru 09

Model	Size (Tons)	CFM	Economizer ^{1 2}	4" Filter ¹	Electric Heat kW ²			
					16/16.5/17	24.8/25.5/27.8	32/33/34	41.7/42.4
XYE	08 (7.5), 09 (8.5)	2200	0.11	---	0.07	0.09	0.10	0.12
		2600	0.13	---	0.09	0.11	0.12	0.15
		3000	0.17	---	0.12	0.14	0.15	0.19
		3400	0.20	---	0.15	0.18	0.19	0.23
		3800	0.25	---	0.19	0.22	0.23	0.27
		4000	0.28	---	0.21	0.24	0.25	0.30
		4400	0.33	---	0.25	0.29	0.30	0.35
		4800	0.38	---	0.30	0.34	0.35	0.41
		5200	0.43	---	0.35	0.39	0.41	0.47
		5600	0.46	---	0.41	0.45	0.47	0.54
		6000	0.50	---	0.48	0.52	0.54	0.60

1. Deduct these values from the available external static pressure shown in the respective Blower Performance Tables.

2. The pressure drop through the economizer is greater for 100% outdoor air than for 100% return air. If the resistance of the return air duct is less than 0.25 IWG, the unit will deliver less CFM during full economizer operation.

Additional Static Resistance - XXEA7

Model	Size (Tons)	CFM	Economizer ^{1 2}	4" Filter ²	Electric Heat kW ²						
					6/6.5	9.2/10.5/11	13.8/14/16	16/16.5/17	23	24.8/25.5/27.8	
XXE	A7 (6.0)	1800	0.13	---	0.03	0.03	0.05	---	---	---	---
		2000	0.15	---	0.04	0.04	0.06	---	---	---	---
		2200	0.18	---	0.06	0.06	0.07	---	---	---	---
		2400	0.21	---	0.07	0.07	0.08	---	---	---	---
		2600	0.24	---	0.08	0.08	0.09	---	---	---	---
		2800	0.29	---	0.09	0.09	0.10	---	---	---	---
		3000	0.35	---	0.11	0.11	0.12	---	---	---	---

1. Deduct these values from the available external static pressure shown in the respective Blower Performance Tables.

2. The pressure drop through the economizer is greater for 100% outdoor air than for 100% return air. If the resistance of the return air duct is less than 0.25 IWG, the unit will deliver less CFM during full economizer operation.

Additional Static Resistance - XXE08-12

Model	Size (Tons)	CFM	Economizer ^{1 2}	4" Filter ¹	Electric Heat kW ²			
					16/16.5/17	24.8/25.5/27.8	32/33/34	41.7/42.4
XXE	08 (7.5), 09 (8.5)	2200	0.11	---	0.07	0.09	0.10	0.12
		2600	0.13	---	0.09	0.11	0.12	0.15
		3000	0.17	---	0.12	0.14	0.15	0.19
		3400	0.20	---	0.15	0.18	0.19	0.23
		3800	0.25	---	0.19	0.22	0.23	0.27
		4000	0.28	---	0.21	0.24	0.25	0.30
		4400	0.33	---	0.25	0.29	0.30	0.35
		4800	0.38	---	0.30	0.34	0.35	0.41
		5200	0.43	---	0.35	0.39	0.41	0.47
		5600	0.46	---	0.41	0.45	0.47	0.54
		6000	0.50	---	0.48	0.52	0.54	0.60
XXE	12 (10.0)	2200	0.11	---	0.07	0.09	0.10	0.12
		2600	0.13	---	0.09	0.11	0.12	0.15
		3000	0.17	---	0.12	0.14	0.15	0.19
		3400	0.20	---	0.15	0.18	0.19	0.23
		3800	0.25	---	0.19	0.22	0.23	0.27
		4000	0.28	---	0.21	0.24	0.25	0.30
		4400	0.33	---	0.25	0.29	0.30	0.35
		4800	0.38	---	0.30	0.34	0.35	0.41
		5200	0.43	---	0.35	0.39	0.41	0.47
		5600	0.46	---	0.41	0.45	0.47	0.54
		6000	0.50	---	0.48	0.52	0.54	0.60

1. Deduct these values from the available external static pressure shown in the respective Blower Performance Tables.

2. The pressure drop through the economizer is greater for 100% outdoor air than for 100% return air. If the resistance of the return air duct is less than 0.25 IWG, the unit will deliver less CFM during full economizer operation.

Additional Static Resistance - XQE04-06

Model	Size (Tons)	CFM	Economizer ^{1 2}	4" Filter ¹	Electric Heat kW ²				
					6/6.5	9.2/10.5/11	13.8/14/16	23	---
XQE	04 (3.0)	900	0.15	---	0.00	0.00	0.01	0.01	---
		1000	0.18	---	0.00	0.00	0.02	0.02	---
		1100	0.21	---	0.01	0.01	0.02	0.03	---
		1200	0.24	---	0.01	0.01	0.02	0.03	---
		1300	0.28	---	0.01	0.01	0.03	0.03	---
		1400	0.33	---	0.02	0.02	0.03	0.04	---
		1500	0.44	---	0.02	0.02	0.04	0.04	---
XQE	05 (4.0)	1200	0.24	---	0.01	0.01	0.02	0.03	---
		1300	0.28	---	0.01	0.01	0.03	0.03	---
		1400	0.33	---	0.02	0.02	0.03	0.04	---
		1500	0.44	---	0.02	0.02	0.04	0.04	---
		1600	0.52	---	0.02	0.02	0.04	0.05	---
		1700	0.59	---	0.03	0.03	0.05	0.05	---
		1800	0.66	---	0.03	0.03	0.05	0.06	---
		1900	0.74	---	0.04	0.04	0.06	0.07	---
		2000	0.81	---	0.04	0.04	0.07	0.08	---
XQE	06 (5.0)	1800	0.66	---	0.03	0.03	0.05	0.06	---
		2000	0.81	---	0.04	0.04	0.07	0.08	---
		2200	0.95	---	0.06	0.06	0.08	0.09	---
		2400	1.10	---	0.07	0.07	0.10	0.11	---
		2500	1.17	---	0.08	0.08	0.11	0.12	---

1. Deduct these values from the available external static pressure shown in the respective Blower Performance Tables.

2. The pressure drop through the economizer is greater for 100% outdoor air than for 100% return air. If the resistance of the return air duct is less than 0.25 IWG, the unit will deliver less CFM during full economizer operation.


Airflow Performance

XYE04-09 Side Duct Application (Belt Drive)

XYE04 (3.0 Ton) Side Duct

CFM	Available External Static																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
900			810	0.27	922	0.38	1024	0.49	1118	0.59	1205	0.69	1285	0.80	1359	0.91	1429	1.03	1496	1.16
1000	703	0.19	826	0.31	938	0.43	1041	0.53	1135	0.64	1221	0.74	1301	0.85	1376	0.96	1446	1.08	1513	1.21
1100	721	0.25	843	0.37	956	0.48	1058	0.59	1152	0.69	1239	0.80	1319	0.90	1393	1.01	1463	1.13	1530	1.26
1200	738	0.31	861	0.43	973	0.54	1076	0.65	1170	0.75	1256	0.86	1336	0.96	1411	1.08	1481	1.19	1548	1.33
1300	756	0.38	879	0.50	991	0.61	1094	0.72	1188	0.82	1274	0.92	1354	1.03	1429	1.14	1499	1.26	1566	1.39
1400	774	0.45	897	0.57	1009	0.68	1112	0.79	1206	0.89	1292	1.00	1372	1.10	1447	1.21	1517	1.33	1584	1.47
1500	792	0.53	915	0.65	1027	0.76	1129	0.87	1223	0.97	1310	1.07	1390	1.18	1464	1.29	1535	1.41	1602	1.54

kW = 0.929 x BHP



Field-supplied AK51 x 3/4" fixed blower pulley with motor rated at 2.4-hp

Medium Static Option with Motor rated at 2.4-hp

High Static Option with Motor rated at 2.4-hp




Field-supplied AK41 x 3/4" fixed blower pulley with motor rated at 2.4-hp

XYE05 (4.0 Ton) Side Duct

CFM	Available External Static																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
1200	759	0.28	860	0.38	957	0.49	1050	0.62	1139	0.76	1224	0.89	1306	1.03	1383	1.15	1457	1.26	1527	1.36
1300	777	0.34	878	0.44	975	0.55	1068	0.68	1157	0.81	1242	0.95	1324	1.08	1401	1.21	1475	1.32	1545	1.42
1400	796	0.40	897	0.50	995	0.61	1088	0.74	1177	0.88	1262	1.01	1343	1.15	1420	1.27	1494	1.38	1564	1.48
1500	816	0.46	918	0.56	1015	0.68	1108	0.81	1197	0.94	1282	1.08	1363	1.21	1440	1.34	1514	1.45	1584	1.54
1600	837	0.53	938	0.63	1035	0.75	1129	0.88	1218	1.01	1303	1.15	1384	1.28	1461	1.41	1535	1.52	1605	1.61
1700	858	0.61	960	0.71	1057	0.83	1150	0.95	1239	1.09	1324	1.22	1405	1.36	1482	1.48	1556	1.60	1626	1.69
1800	880	0.69	981	0.79	1078	0.91	1171	1.04	1260	1.17	1345	1.31	1427	1.44	1504	1.57	1578	1.68	1648	1.77
1900	902	0.78	1003	0.88	1100	1.00	1193	1.12	1282	1.26	1367	1.40	1448	1.53	1526	1.65	1599	1.77	--	--
2000	924	0.88	1025	0.98	1122	1.09	1215	1.22	1304	1.35	1389	1.49	1470	1.62	1548	1.75	1621	1.86	--	--

kW = 0.929 x BHP



Field-supplied AK51 x 3/4" fixed blower pulley with motor rated at 2.4-hp

Medium Static Option with Motor rated at 2.4-hp

High Static Option with Motor rated at 2.4-hp




Field-supplied AK41 x 3/4" fixed blower pulley with motor rated at 2.4-hp

Exceeds recommended blower speed

XYE06 (5.0 Ton) Side Duct

CFM	Available External Static																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
1500	770	0.40	836	0.50	901	0.60	964	0.69	1025	0.79	1084	0.89	1142	0.98	1197	1.07	1250	1.15	1300	1.23
1600	779	0.45	845	0.54	910	0.64	973	0.74	1034	0.83	1093	0.93	1151	1.02	1206	1.11	1259	1.20	1309	1.27
1700	791	0.50	857	0.60	922	0.69	985	0.79	1046	0.89	1105	0.98	1162	1.07	1218	1.16	1271	1.25	1321	1.33
1800	805	0.56	872	0.66	936	0.75	999	0.85	1060	0.95	1120	1.04	1177	1.13	1232	1.22	1285	1.31	1335	1.39
1900	822	0.63	888	0.72	953	0.82	1016	0.92	1077	1.01	1136	1.11	1194	1.20	1249	1.29	1302	1.38	1352	1.46
2000	841	0.70	907	0.80	972	0.89	1035	0.99	1096	1.09	1155	1.18	1212	1.27	1268	1.36	1321	1.45	1371	1.53
2100	862	0.78	928	0.87	993	0.97	1056	1.07	1117	1.16	1176	1.26	1233	1.35	1289	1.44	1341	1.53	1392	1.61
2200	885	0.86	951	0.96	1016	1.05	1079	1.15	1140	1.25	1199	1.34	1256	1.43	1311	1.52	1364	1.61	1415	1.69
2300	910	0.95	976	1.04	1040	1.14	1103	1.23	1165	1.33	1224	1.43	1281	1.52	1336	1.61	1389	1.69	1440	1.77
2400	936	1.03	1002	1.13	1067	1.23	1130	1.32	1191	1.42	1250	1.52	1307	1.61	1362	1.70	1415	1.78	1466	1.86
2500	964	1.13	1030	1.22	1095	1.32	1158	1.41	1219	1.51	1278	1.61	1335	1.70	1390	1.79	1443	1.87	1494	1.95

kW = 0.857 x BHP



Field-supplied AK51 x 3/4" fixed blower pulley with motor rated at 2.4-hp

Medium Static Option with Motor rated at 2.4-hp

High Static Option with Motor rated at 2.9-hp

XYE07 (6.0 Ton) Side Duct

CFM	Available External Static																			
	0.20		0.40		0.60		0.80		1.00		1.20		1.40		1.60		1.80		2.00	
	RPMs	BHP	RPMs	BHP	RPMs	BHP	RPMs	BHP	RPMs	BHP	RPMs	BHP	RPMs	BHP	RPMs	BHP	RPMs	BHP	RPMs	BHP
1800	532	0.30	592	0.48	647	0.66	698	0.84	746	1.02	793	1.19	842	1.34	892	1.48	946	1.60	1006	1.69
1900	540	0.34	600	0.52	655	0.70	706	0.88	754	1.06	802	1.23	850	1.39	900	1.52	954	1.64	1014	1.73
2000	548	0.39	609	0.56	664	0.74	714	0.92	763	1.10	810	1.27	859	1.43	909	1.57	963	1.68	1023	1.77
2100	558	0.43	618	0.61	673	0.79	724	0.97	772	1.15	820	1.32	868	1.47	918	1.61	972	1.73	1032	1.82
2200	567	0.48	628	0.66	683	0.84	733	1.02	782	1.20	829	1.37	877	1.52	928	1.66	982	1.78	1042	1.86
2300	578	0.53	638	0.71	693	0.89	744	1.07	792	1.25	839	1.42	888	1.57	938	1.71	992	1.83	1052	1.91
2400	588	0.59	648	0.76	703	0.94	754	1.12	802	1.30	850	1.47	898	1.63	948	1.77	1003	1.88	1062	1.97
2500	599	0.64	659	0.82	714	1.00	765	1.18	813	1.36	861	1.53	909	1.69	959	1.82	1013	1.94	1073	2.03
2600	610	0.71	670	0.88	725	1.06	776	1.24	824	1.42	872	1.59	920	1.75	971	1.89	1025	2.00	1084	2.09
2700	622	0.77	682	0.95	737	1.13	788	1.31	836	1.49	883	1.66	932	1.81	982	1.95	1036	2.07	1096	2.16
2800	633	0.84	694	1.02	749	1.20	799	1.38	848	1.56	895	1.73	943	1.89	994	2.02	1048	2.14	-	-
2900	646	0.92	706	1.09	761	1.27	812	1.46	860	1.63	907	1.80	956	1.96	1006	2.10	1060	2.21	-	-
3000	658	1.00	718	1.17	773	1.35	824	1.54	872	1.71	920	1.88	968	2.04	1018	2.18	1073	2.29	-	-



Standard Static Option with Motor rated at 2.4-Max Bhp

Medium Static Option with Motor rated at 2.9-Max Bhp

High Static Option with Motor rated at 3.7-Max Bhp

Exceeds recommended blower speed

kW = 0.929 x BHP for Standard & Medium Static options kW = 0.895 x BHP for High Static option

XYE08 (7.5 Ton) Side Duct

CFM	Available External Static																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
2250	562	0.17	616	0.36	671	0.57	726	0.78	781	1.00	835	1.20	886	1.40	935	1.59	979	1.75	1019	1.89
2400	567	0.26	620	0.45	675	0.65	730	0.87	785	1.08	839	1.29	890	1.49	939	1.67	983	1.84	1023	1.97
2600	572	0.38	625	0.58	680	0.78	736	0.99	790	1.21	844	1.42	895	1.62	944	1.80	989	1.96	1029	2.10
2800	578	0.53	632	0.72	687	0.93	742	1.14	797	1.35	850	1.56	902	1.76	950	1.95	995	2.11	1035	2.24
3000	586	0.69	639	0.88	694	1.08	749	1.30	804	1.51	858	1.72	909	1.92	958	2.10	1002	2.27	1043	2.40
3200	595	0.86	648	1.05	703	1.25	758	1.46	813	1.68	867	1.89	918	2.09	967	2.27	1012	2.43	1052	2.57
3400	606	1.03	660	1.23	714	1.43	770	1.64	824	1.86	878	2.07	930	2.27	978	2.45	1023	2.61	1063	2.75
3600	619	1.22	673	1.41	728	1.62	783	1.83	838	2.04	891	2.25	943	2.45	991	2.63	1036	2.80	1076	2.93
3750	631	1.36	684	1.55	739	1.76	794	1.97	849	2.19	903	2.39	954	2.59	1003	2.78	1047	2.94	1087	3.08



Standard Static Option with Motor rated at 2.4-hp

Medium Static Option with Motor rated at 2.4-hp

High Static Option with Motor rated at 3.7-hp

kW = 0.929 x BHP for Standard & Medium Static options kW = 0.895 x BHP for High Static option

XYE09 (8.5 Ton) Side Duct

CFM	Available External Static																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
2550	571	0.35	624	0.54	679	0.75	734	0.96	789	1.17	843	1.38	894	1.58	943	1.77	987	1.93	1027	2.07
2600	572	0.38	625	0.58	680	0.78	736	0.99	790	1.21	844	1.42	895	1.62	944	1.80	989	1.96	1029	2.10
2800	578	0.53	632	0.72	687	0.93	742	1.14	797	1.35	850	1.56	902	1.76	950	1.95	995	2.11	1035	2.24
3000	586	0.69	639	0.88	694	1.08	749	1.30	804	1.51	858	1.72	909	1.92	958	2.10	1002	2.27	1043	2.40
3200	595	0.86	648	1.05	703	1.25	758	1.46	813	1.68	867	1.89	918	2.09	967	2.27	1012	2.43	1052	2.57
3400	606	1.03	660	1.23	714	1.43	770	1.64	824	1.86	878	2.07	930	2.27	978	2.45	1023	2.61	1063	2.75
3600	619	1.22	673	1.41	728	1.62	783	1.83	838	2.04	891	2.25	943	2.45	991	2.63	1036	2.80	1076	2.93
3800	635	1.41	688	1.60	743	1.81	798	2.02	853	2.23	907	2.44	958	2.64	1007	2.83	1051	2.99	1091	3.13
4000	652	1.61	706	1.80	761	2.01	816	2.22	871	2.43	924	2.64	976	2.84	1024	3.02	1069	3.19	--	--
4200	672	1.81	726	2.00	781	2.21	836	2.42	891	2.64	944	2.84	996	3.04	1044	3.23	1089	3.39	--	--
4250	678	1.86	731	2.06	786	2.26	841	2.47	896	2.69	950	2.90	1001	3.10	1050	3.28	1094	3.44	--	--



Standard Static Option with Motor rated at 2.4-hp

Medium Static Option with Motor rated at 2.4-hp

High Static Option with Motor rated at 3.7-hp

Field-supplied AK79 x 1 fixed pulley with Motor rated at 3.7-hp

Exceeds recommended blower speed

kW = 0.929 x BHP for Standard & Medium Static options kW = 0.895 x BHP for High Static option

XXEA7, XXE08 - XXE09, XXE12 Side Duct Application (Belt Drive)**XXEA7 (6.0 Ton) Side Duct**

CFM	Available External Static Pressure - IWG																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
1800	845	0.46	901	0.58	959	0.71	1017	0.83	1076	0.96	1133	1.08	1188	1.21	1240	1.34	1288	1.47	1332	1.60
1900	860	0.53	917	0.66	974	0.78	1033	0.91	1091	1.03	1148	1.16	1203	1.28	1255	1.41	1303	1.54	1347	1.68
2000	878	0.62	934	0.74	992	0.86	1050	0.99	1108	1.11	1165	1.24	1220	1.36	1272	1.49	1321	1.62	1365	1.76
2100	897	0.70	954	0.83	1011	0.95	1070	1.08	1128	1.20	1185	1.33	1240	1.45	1292	1.58	1340	1.71	1384	1.84
2200	919	0.80	975	0.92	1033	1.05	1091	1.17	1149	1.29	1206	1.42	1261	1.55	1313	1.68	1362	1.81	1406	1.94
2300	942	0.90	998	1.02	1056	1.15	1114	1.27	1172	1.40	1229	1.52	1284	1.65	1336	1.78	1385	1.91	1429	2.04
2400	966	1.01	1022	1.14	1080	1.26	1138	1.38	1196	1.51	1253	1.63	1308	1.76	1361	1.89	1409	2.02	1453	2.15
2500	992	1.13	1048	1.25	1106	1.38	1164	1.50	1222	1.63	1279	1.75	1334	1.88	1386	2.01	1435	2.14	1479	2.27
2600	1018	1.26	1075	1.38	1132	1.51	1191	1.63	1249	1.76	1306	1.88	1361	2.01	1413	2.14	1461	2.27	1505	2.40
2700	1046	1.40	1102	1.52	1160	1.64	1218	1.77	1276	1.89	1333	2.02	1388	2.14	1441	2.27	1489	2.40	1533	2.54
2800	1075	1.54	1131	1.67	1188	1.79	1247	1.91	1305	2.04	1362	2.16	1417	2.29	1469	2.42	1518	2.55	1561	2.68
2900	1104	1.70	1160	1.82	1218	1.94	1276	2.07	1334	2.19	1391	2.32	1446	2.45	1498	2.57	1547	2.70	1591	2.84
3000	1134	1.86	1190	1.98	1248	2.11	1306	2.23	1364	2.36	1421	2.48	1476	2.61	1528	2.74	1577	2.87	1621	3.00

Standard Static Option with Motor rated at 2.4-hp

Medium Static Option with Motor rated at 2.9-hp

High Static Option with Motor rated at 3.7-hp

- Exceeds recommended blower speed

Note: See RPM SELECTION table to determine desired motor sheave setting and to determine the maximum continuous BHP.

kW = 0.929 x BHP

XXE08 (7.5 Ton) Side Duct

CFM	Available External Static																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
2250	562	0.17	616	0.36	671	0.57	726	0.78	781	1.00	835	1.20	886	1.40	935	1.59	979	1.75	1019	1.89
2400	567	0.26	620	0.45	675	0.65	730	0.87	785	1.08	839	1.29	890	1.49	939	1.67	983	1.84	1023	1.97
2600	572	0.38	625	0.58	680	0.78	736	0.99	790	1.21	844	1.42	895	1.62	944	1.80	989	1.96	1029	2.10
2800	578	0.53	632	0.72	687	0.93	742	1.14	797	1.35	850	1.56	902	1.76	950	1.95	995	2.11	1035	2.24
3000	586	0.69	639	0.88	694	1.08	749	1.30	804	1.51	858	1.72	909	1.92	958	2.10	1002	2.27	1043	2.40
3200	595	0.86	648	1.05	703	1.25	758	1.46	813	1.68	867	1.89	918	2.09	967	2.27	1012	2.43	1052	2.57
3400	606	1.03	660	1.23	714	1.43	770	1.64	824	1.86	878	2.07	930	2.27	978	2.45	1023	2.61	1063	2.75
3600	619	1.22	673	1.41	728	1.62	783	1.83	838	2.04	891	2.25	943	2.45	991	2.63	1036	2.80	1076	2.93
3750	631	1.36	684	1.55	739	1.76	794	1.97	849	2.19	903	2.39	954	2.59	1003	2.78	1047	2.94	1087	3.08

Standard Static Option with Motor rated at 2.4-hp


Medium Static Option with Motor rated at 2.4-hp

High Static Option with Motor rated at 3.7-hp

kW = 0.929 x BHP for Standard & Medium Static options kW = 0.895 x BHP for High Static option

XXE09 (8.5 Ton) Side Duct


CFM	Available External Static																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
2550	571	0.35	624	0.54	679	0.75	734	0.96	789	1.17	843	1.38	894	1.58	943	1.77	987	1.93	1027	2.07
2600	572	0.38	625	0.58	680	0.78	736	0.99	790	1.21	844	1.42	895	1.62	944	1.80	989	1.96	1029	2.10
2800	578	0.53	632	0.72	687	0.93	742	1.14	797	1.35	850	1.56	902	1.76	950	1.95	995	2.11	1035	2.24
3000	586	0.69	639	0.88	694	1.08	749	1.30	804	1.51	858	1.72	909	1.92	958	2.10	1002	2.27	1043	2.40
3200	595	0.86	648	1.05	703	1.25	758	1.46	813	1.68	867	1.89	918	2.09	967	2.27	1012	2.43	1052	2.57
3400	606	1.03	660	1.23	714	1.43	770	1.64	824	1.86	878	2.07	930	2.27	978	2.45	1023	2.61	1063	2.75
3600	619	1.22	673	1.41	728	1.62	783	1.83	838	2.04	891	2.25	943	2.45	991	2.63	1036	2.80	1076	2.93
3800	635	1.41	688	1.60	743	1.81	798	2.02	853	2.23	907	2.44	958	2.64	1007	2.83	1051	2.99	1091	3.13
4000	652	1.61	706	1.80	761	2.01	816	2.22	871	2.43	924	2.64	976	2.84	1024	3.02	1069	3.19	--	--
4200	672	1.81	726	2.00	781	2.21	836	2.42	891	2.64	944	2.84	996	3.04	1044	3.23	1089	3.39	--	--
4250	678	1.86	731	2.06	786	2.26	841	2.47	896	2.69	950	2.90	1001	3.10	1050	3.28	1094	3.44	--	--



Standard Static Option with Motor rated at 2.4-hp
 Medium Static Option with Motor rated at 2.4-hp
 High Static Option with Motor rated at 3.7-hp
Field-supplied AK79 x 1 fixed pulley with Motor rated at 3.7-hp
 Exceeds recommended blower speed
 kW = 0.929 x BHP for Standard & Medium Static options kW = 0.895 x BHP for High Static option

XXE12 (10 Ton) Side Duct

CFM	Available External Static Pressure - IWG																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
3000			665	0.63	707	0.90	750	1.15	795	1.39	842	1.62	888	1.85	935	2.07	980	2.30	1024	2.53
3200			673	0.79	714	1.06	758	1.31	803	1.56	849	1.79	896	2.01	942	2.24	988	2.47	1032	2.70
3400			682	0.97	723	1.24	767	1.50	812	1.74	858	1.97	905	2.20	951	2.42	997	2.65	1041	2.88
3600	654	0.88	692	1.17	733	1.44	777	1.69	822	1.93	868	2.17	915	2.39	961	2.62	1007	2.84	1051	3.08
3800	665	1.10	704	1.38	745	1.65	788	1.91	834	2.15	880	2.38	927	2.61	973	2.83	1018	3.06	1062	3.29
4000	678	1.32	717	1.61	758	1.88	801	2.13	847	2.37	893	2.61	940	2.83	986	3.06	1032	3.28	1076	3.52
4200	693	1.57	731	1.85	772	2.12	816	2.37	861	2.62	907	2.85	954	3.07	1000	3.30	1046	3.53	1090	3.76
4400	709	1.82	747	2.11	788	2.38	832	2.63	877	2.87	923	3.10	970	3.33	1016	3.55	1062	3.78	1106	4.01
4600	726	2.09	764	2.37	806	2.64	849	2.90	894	3.14	941	3.37	987	3.60	1034	3.82	1079	4.05	1123	4.28
4800	745	2.37	783	2.65	824	2.92	868	3.18	913	3.42	959	3.65	1006	3.88	1052	4.10	1098	4.33	1142	4.56
5000	765	2.66	803	2.95	844	3.22	888	3.47	933	3.71	979	3.94	1026	4.17	1072	4.39	1118	4.62	1162	4.85



Standard Static Option with Motor rated at 2.4-hp
 Medium Static Option with Motor rated at 3.7-hp
Field Supplied AK84 x 1 fixed pulley with Motor rated at 3.7-hp
 High Static Option with Motor rated at 5.25-hp
 Exceeds recommended blower speed

XQE04-06 Side Duct Application (Belt Drive)**XQE04 (3.0 Ton) Side Duct**

CFM	Available External Static																			
	0.2 RPM BHP		0.4 RPM BHP		0.6 RPM BHP		0.8 RPM BHP		1.0 RPM BHP		1.2 RPM BHP		1.4 RPM BHP		1.6 RPM BHP		1.8 RPM BHP		2.0 RPM BHP	
900			810	0.27	922	0.38	1024	0.49	1118	0.59	1205	0.69	1285	0.80	1359	0.91	1429	1.03	1496	1.16
1000	703	0.19	826	0.31	938	0.43	1041	0.53	1135	0.64	1221	0.74	1301	0.85	1376	0.96	1446	1.08	1513	1.21
1100	721	0.25	843	0.37	956	0.48	1058	0.59	1152	0.69	1239	0.80	1319	0.90	1393	1.01	1463	1.13	1530	1.26
1200	738	0.31	861	0.43	973	0.54	1076	0.65	1170	0.75	1256	0.86	1336	0.96	1411	1.08	1481	1.19	1548	1.33
1300	756	0.38	879	0.50	991	0.61	1094	0.72	1188	0.82	1274	0.92	1354	1.03	1429	1.14	1499	1.26	1566	1.39
1400	774	0.45	897	0.57	1009	0.68	1112	0.79	1206	0.89	1292	1.00	1372	1.10	1447	1.21	1517	1.33	1584	1.47
1500	792	0.53	915	0.65	1027	0.76	1129	0.87	1223	0.97	1310	1.07	1390	1.18	1464	1.29	1535	1.41	1602	1.54

kW = 0.929 x BHP

Bold

Field-supplied AK51 x 3/4" fixed blower pulley with motor rated at 2.4-hp

Green

Medium Static Option with Motor rated at 2.4-hp

Red

High Static Option with Motor rated at 2.4-hp

Bold

Field-supplied AK41 x 3/4" fixed blower pulley with motor rated at 2.4-hp

XQE05 (4.0 Ton) Side Duct

CFM	Available External Static																			
	0.2 RPM BHP		0.4 RPM BHP		0.6 RPM BHP		0.8 RPM BHP		1.0 RPM BHP		1.2 RPM BHP		1.4 RPM BHP		1.6 RPM BHP		1.8 RPM BHP		2.0 RPM BHP	
1200	759	0.28	860	0.38	957	0.49	1050	0.62	1139	0.76	1224	0.89	1306	1.03	1383	1.15	1457	1.26	1527	1.36
1300	777	0.34	878	0.44	975	0.55	1068	0.68	1157	0.81	1242	0.95	1324	1.08	1401	1.21	1475	1.32	1545	1.42
1400	796	0.40	897	0.50	995	0.61	1088	0.74	1177	0.88	1262	1.01	1343	1.15	1420	1.27	1494	1.38	1564	1.48
1500	816	0.46	918	0.56	1015	0.68	1108	0.81	1197	0.94	1282	1.08	1363	1.21	1440	1.34	1514	1.45	1584	1.54
1600	837	0.53	938	0.63	1035	0.75	1129	0.88	1218	1.01	1303	1.15	1384	1.28	1461	1.41	1535	1.52	1605	1.61
1700	858	0.61	960	0.71	1057	0.83	1150	0.95	1239	1.09	1324	1.22	1405	1.36	1482	1.48	1556	1.60	1626	1.69
1800	880	0.69	981	0.79	1078	0.91	1171	1.04	1260	1.17	1345	1.31	1427	1.44	1504	1.57	1578	1.68	1648	1.77
1900	902	0.78	1003	0.88	1100	1.00	1193	1.12	1282	1.26	1367	1.40	1448	1.53	1526	1.65	1599	1.77	--	--
2000	924	0.88	1025	0.98	1122	1.09	1215	1.22	1304	1.35	1389	1.49	1470	1.62	1548	1.75	1621	1.86	--	--

kW = 0.929 x BHP

Bold

Field-supplied AK51 x 3/4" fixed blower pulley with motor rated at 2.4-hp

Green

Medium Static Option with Motor rated at 2.4-hp

Red

High Static Option with Motor rated at 2.4-hp

Bold

Field-supplied AK41 x 3/4" fixed blower pulley with motor rated at 2.4-hp

White

Exceeds recommended blower speed

XQE06 (5.0 Ton) Side Duct

CFM	Available External Static																			
	0.2 RPM BHP		0.4 RPM BHP		0.6 RPM BHP		0.8 RPM BHP		1.0 RPM BHP		1.2 RPM BHP		1.4 RPM BHP		1.6 RPM BHP		1.8 RPM BHP		2.0 RPM BHP	
1500	770	0.40	836	0.50	901	0.60	964	0.69	1025	0.79	1084	0.89	1142	0.98	1197	1.07	1250	1.15	1300	1.23
1600	779	0.45	845	0.54	910	0.64	973	0.74	1034	0.83	1093	0.93	1151	1.02	1206	1.11	1259	1.20	1309	1.27
1700	791	0.50	857	0.60	922	0.69	985	0.79	1046	0.89	1105	0.98	1162	1.07	1218	1.16	1271	1.25	1321	1.33
1800	805	0.56	872	0.66	936	0.75	999	0.85	1060	0.95	1120	1.04	1177	1.13	1232	1.22	1285	1.31	1335	1.39
1900	822	0.63	888	0.72	953	0.82	1016	0.92	1077	1.01	1136	1.11	1194	1.20	1249	1.29	1302	1.38	1352	1.46
2000	841	0.70	907	0.80	972	0.89	1035	0.99	1096	1.09	1155	1.18	1212	1.27	1268	1.36	1321	1.45	1371	1.53
2100	862	0.78	928	0.87	993	0.97	1056	1.07	1117	1.16	1176	1.26	1233	1.35	1289	1.44	1341	1.53	1392	1.61
2200	885	0.86	951	0.96	1016	1.05	1079	1.15	1140	1.25	1199	1.34	1256	1.43	1311	1.52	1364	1.61	1415	1.69
2300	910	0.95	976	1.04	1040	1.14	1103	1.23	1165	1.33	1224	1.43	1281	1.52	1336	1.61	1389	1.69	1440	1.77
2400	936	1.03	1002	1.13	1067	1.23	1130	1.32	1191	1.42	1250	1.52	1307	1.61	1362	1.70	1415	1.78	1466	1.86
2500	964	1.13	1030	1.22	1095	1.32	1158	1.41	1219	1.51	1278	1.61	1335	1.70	1390	1.79	1443	1.87	1494	1.95

kW = 0.857 x BHP

Bold

Field-supplied AK51 x 3/4" fixed blower pulley with motor rated at 2.4-hp

Green

Medium Static Option with Motor rated at 2.4-hp

Red

High Static Option with Motor rated at 2.9-hp

XYE04-09 Bottom Duct Application (Belt Drive)**XYE04 (3.0 Ton) Bottom Duct**

CFM	Available External Static																			
	0.2 RPM BHP		0.4 RPM BHP		0.6 RPM BHP		0.8 RPM BHP		1.0 RPM BHP		1.2 RPM BHP		1.4 RPM BHP		1.6 RPM BHP		1.8 RPM BHP		2.0 RPM BHP	
900	743	0.14	852	0.26	955	0.37	1050	0.48	1140	0.57	1225	0.67	1306	0.77	1384	0.87	1460	0.98	1535	1.09
1000	757	0.20	867	0.33	969	0.44	1065	0.54	1155	0.64	1240	0.74	1321	0.84	1399	0.94	1475	1.04	1549	1.16
1100	774	0.27	884	0.40	986	0.51	1082	0.61	1172	0.71	1257	0.81	1338	0.91	1416	1.01	1492	1.11	1566	1.23
1200	793	0.35	903	0.47	1005	0.58	1101	0.69	1191	0.78	1276	0.88	1357	0.98	1435	1.08	1511	1.19	1585	1.30
1300	814	0.42	924	0.54	1026	0.65	1122	0.76	1212	0.86	1297	0.96	1378	1.05	1456	1.15	1532	1.26	1606	1.37
1400	837	0.49	947	0.61	1049	0.72	1145	0.83	1235	0.93	1320	1.03	1401	1.12	1479	1.23	1555	1.33	1629	1.45
1500	862	0.56	972	0.68	1074	0.79	1170	0.90	1260	1.00	1345	1.09	1426	1.19	1504	1.29	1580	1.40	--	--

kW = 0.929 x BHP

Bold

Field-supplied AK51 x 3/4" fixed blower pulley with motor rated at 2.4-hp

Medium Static Option with Motor rated at 2.4-hp

High Static Option with Motor rated at 2.4-hp

Bold Field-supplied AK41 x 3/4" fixed blower pulley with motor rated at 2.4-hp

-- Exceeds recommended blower speed

XYE05 (4.0 Ton) Bottom Duct

CFM	Available External Static																			
	0.2 RPM BHP		0.4 RPM BHP		0.6 RPM BHP		0.8 RPM BHP		1.0 RPM BHP		1.2 RPM BHP		1.4 RPM BHP		1.6 RPM BHP		1.8 RPM BHP		2.0 RPM BHP	
1200	801	0.25	903	0.38	999	0.51	1089	0.63	1173	0.76	1252	0.88	1327	1.00	1396	1.11	1461	1.22	1521	1.33
1300	822	0.31	924	0.44	1020	0.57	1110	0.69	1194	0.82	1273	0.94	1348	1.06	1417	1.17	1482	1.28	1542	1.39
1400	844	0.38	946	0.51	1042	0.64	1132	0.76	1216	0.89	1295	1.01	1370	1.13	1439	1.24	1504	1.35	1564	1.46
1500	867	0.46	969	0.59	1065	0.71	1155	0.84	1239	0.96	1319	1.08	1393	1.20	1462	1.32	1527	1.43	1587	1.53
1600	891	0.54	993	0.67	1089	0.79	1179	0.92	1264	1.04	1343	1.16	1417	1.28	1486	1.40	1551	1.51	1612	1.61
1700	917	0.63	1019	0.75	1115	0.88	1205	1.01	1289	1.13	1368	1.25	1442	1.37	1512	1.48	1577	1.60	1637	1.70
1800	943	0.72	1045	0.85	1141	0.97	1231	1.10	1316	1.22	1395	1.34	1469	1.46	1538	1.58	1603	1.69	--	--
1900	971	0.81	1073	0.94	1169	1.07	1259	1.19	1344	1.32	1423	1.44	1497	1.56	1566	1.67	1631	1.78	--	--
2000	1000	0.92	1102	1.04	1198	1.17	1288	1.29	1372	1.42	1452	1.54	1526	1.66	1595	1.77	--	--	--	--

kW = 0.929 x BHP

Bold

Medium Static Option with Motor rated at 2.4-hp

High Static Option with Motor rated at 2.4-hp

Bold Field-supplied AK41 x 3/4" fixed blower pulley with motor rated at 2.4-hp

-- Exceeds recommended blower speed

XYE06 (5.0 Ton) Bottom Duct

CFM	Available External Static																			
	0.2 RPM BHP		0.4 RPM BHP		0.6 RPM BHP		0.8 RPM BHP		1.0 RPM BHP		1.2 RPM BHP		1.4 RPM BHP		1.6 RPM BHP		1.8 RPM BHP		2.0 RPM BHP	
1500	812	0.36	869	0.46	931	0.55	997	0.64	1063	0.74	1129	0.84	1193	0.94	1253	1.05	1307	1.16	1354	1.27
1600	829	0.43	886	0.52	948	0.61	1013	0.71	1080	0.80	1146	0.90	1210	1.01	1270	1.11	1324	1.22	1370	1.34
1700	846	0.50	904	0.59	966	0.68	1031	0.78	1097	0.87	1164	0.97	1227	1.07	1287	1.18	1341	1.29	1388	1.41
1800	865	0.57	922	0.66	985	0.75	1050	0.85	1116	0.95	1182	1.05	1246	1.15	1306	1.25	1360	1.36	1407	1.48
1900	885	0.65	943	0.74	1005	0.83	1070	0.93	1136	1.02	1203	1.12	1266	1.23	1326	1.33	1380	1.44	1427	1.56
2000	907	0.73	964	0.82	1026	0.92	1092	1.01	1158	1.11	1224	1.21	1288	1.31	1348	1.42	1402	1.53	1449	1.64
2100	930	0.82	987	0.91	1049	1.01	1115	1.10	1181	1.20	1247	1.30	1311	1.40	1371	1.51	1425	1.62	1472	1.73
2200	955	0.92	1012	1.01	1074	1.10	1139	1.20	1206	1.29	1272	1.39	1336	1.50	1396	1.60	1450	1.71	1496	1.83
2300	981	1.02	1038	1.11	1101	1.20	1166	1.30	1232	1.39	1298	1.49	1362	1.60	1422	1.70	1476	1.81	1523	1.93
2400	1009	1.12	1066	1.22	1128	1.31	1194	1.40	1260	1.50	1326	1.60	1390	1.70	1450	1.81	1504	1.92	1551	2.03
2500	1038	1.24	1096	1.33	1158	1.42	1223	1.52	1290	1.61	1356	1.71	1420	1.82	1480	1.92	1534	2.03	1580	2.15

Kw = 0.857 x BHP


Bold

Medium Static Option with Motor rated at 2.4-hp

High Static Option with Motor rated at 2.9-hp

XYE07 (6.0 Ton) Bottom Duct

CFM	Available External Static																			
	0.20		0.40		0.60		0.80		1.00		1.20		1.40		1.60		1.80		2.00	
	RPMs	BHP	RPMs	BHP	RPMs	BHP	RPMs	BHP	RPMs	BHP	RPMs	BHP	RPMs	BHP	RPMs	BHP	RPMs	BHP	RPMs	BHP
1800	517	0.35	592	0.51	661	0.67	723	0.83	779	0.99	832	1.15	881	1.30	927	1.43	973	1.56	1017	1.66
1900	526	0.39	601	0.55	670	0.71	732	0.87	789	1.03	841	1.19	890	1.34	937	1.48	982	1.60	1026	1.71
2000	535	0.44	611	0.60	679	0.76	741	0.92	798	1.08	850	1.24	899	1.39	946	1.52	991	1.65	1036	1.76
2100	544	0.49	620	0.65	688	0.81	750	0.97	807	1.13	859	1.29	908	1.44	955	1.57	1000	1.70	1045	1.80
2200	554	0.54	629	0.70	698	0.86	760	1.02	816	1.18	869	1.34	918	1.49	964	1.63	1010	1.75	1054	1.86
2300	563	0.60	639	0.76	707	0.92	769	1.08	826	1.24	878	1.40	927	1.55	974	1.68	1019	1.81	1064	1.91
2400	573	0.66	649	0.82	717	0.98	779	1.14	836	1.30	888	1.46	937	1.61	984	1.74	1029	1.87	1074	1.98
2500	583	0.73	658	0.88	727	1.04	789	1.20	846	1.37	898	1.52	947	1.67	994	1.81	1039	1.93	1084	2.04
2600	593	0.79	669	0.95	737	1.11	799	1.27	856	1.43	908	1.59	957	1.74	1004	1.88	1049	2.00	1094	2.11
2700	603	0.87	679	1.02	747	1.18	809	1.35	866	1.51	919	1.66	968	1.81	1014	1.95	1059	2.07	-	-
2800	614	0.94	690	1.10	758	1.26	820	1.42	877	1.58	929	1.74	978	1.89	1025	2.03	1070	2.15	-	-
2900	625	1.02	701	1.18	769	1.34	831	1.50	888	1.66	940	1.82	989	1.97	1036	2.11	1081	2.23	-	-
3000	636	1.11	712	1.27	780	1.43	842	1.59	899	1.75	951	1.91	1000	2.05	1047	2.19	1092	2.32	-	-



Standard Static Option with Motor rated at 2.4-Max Bhp

Medium Static Option with Motor rated at 2.9-Max Bhp


High Static Option with Motor rated at 3.7-Max Bhp

Exceeds recommended blower speed

kW = 0.929 x BHP for Standard & Medium Static options kW = 0.895 x BHP for High Static option

XYE08 (7.5 Ton) Bottom Duct

CFM	Available External Static																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
2250	552	0.25	614	0.43	674	0.63	733	0.83	789	1.02	844	1.22	898	1.41	950	1.58	1000	1.75	1049	1.89
2400	559	0.34	621	0.52	682	0.72	740	0.91	797	1.11	852	1.31	905	1.49	957	1.67	1007	1.83	1056	1.98
2600	569	0.47	631	0.65	691	0.85	750	1.04	806	1.24	861	1.44	915	1.62	967	1.80	1017	1.96	1066	2.11
2800	579	0.61	641	0.79	701	0.99	760	1.19	817	1.38	872	1.58	925	1.77	977	1.94	1027	2.11	1076	2.25
3000	590	0.76	652	0.95	713	1.14	771	1.34	828	1.54	883	1.73	936	1.92	988	2.10	1038	2.26	1087	2.40
3200	602	0.92	665	1.11	725	1.30	783	1.50	840	1.70	895	1.89	948	2.08	1000	2.26	1050	2.42	1099	2.57
3400	616	1.09	678	1.28	738	1.47	797	1.67	854	1.87	909	2.06	962	2.25	1014	2.43	1064	2.59	--	--
3600	631	1.27	693	1.45	754	1.65	812	1.85	869	2.04	924	2.24	977	2.43	1029	2.60	1079	2.77	--	--
3750	644	1.40	706	1.59	766	1.78	824	1.98	881	2.18	936	2.37	990	2.56	1041	2.74	1092	2.90	--	--



Standard Static Option with Motor rated at 2.4-hp

Medium Static Option with Motor rated at 2.4-hp


High Static Option with Motor rated at 3.7-hp

Exceeds recommended blower speed

kW = 0.929 x BHP for Standard & Medium Static options kW = 0.895 x BHP for High Static option

XYE09 (8.5 Ton) Bottom Duct

CFM	Available External Static																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
2550	567	0.43	629	0.62	689	0.81	747	1.01	804	1.21	859	1.40	912	1.59	964	1.77	1014	1.93	1063	2.07
2600	569	0.47	631	0.65	691	0.85	750	1.04	806	1.24	861	1.44	915	1.62	967	1.80	1017	1.96	1066	2.11
2800	579	0.61	641	0.79	701	0.99	760	1.19	817	1.38	872	1.58	925	1.77	977	1.94	1027	2.11	1076	2.25
3000	590	0.76	652	0.95	713	1.14	771	1.34	828	1.54	883	1.73	936	1.92	988	2.10	1038	2.26	1087	2.40
3200	602	0.92	665	1.11	725	1.30	783	1.50	840	1.70	895	1.89	948	2.08	1000	2.26	1050	2.42	1099	2.57
3400	616	1.09	678	1.28	738	1.47	797	1.67	854	1.87	909	2.06	962	2.25	1014	2.43	1064	2.59	--	--
3600	631	1.27	693	1.45	754	1.65	812	1.85	869	2.04	924	2.24	977	2.43	1029	2.60	1079	2.77	--	--
3800	648	1.45	710	1.64	770	1.83	829	2.03	885	2.23	940	2.42	994	2.61	1046	2.78	1096	2.95	--	--
4000	666	1.64	729	1.82	789	2.01	847	2.21	904	2.41	959	2.61	1012	2.79	1064	2.97	--	--	--	--
4200	687	1.82	749	2.01	809	2.20	867	2.42	924	2.60	979	2.79	1032	2.98	1084	3.16	--	--	--	--
4250	692	1.87	754	2.06	814	2.25	873	2.45	929	2.65	984	2.84	1038	3.03	1090	3.21	--	--	--	--



Standard Static Option with Motor rated at 2.4-hp

Medium Static Option with Motor rated at 2.4-hp

High Static Option with Motor rated at 3.7-hp

Exceeds recommended blower speed

kW = 0.929 x BHP for Standard & Medium Static options kW = 0.895 x BHP for High Static option

XXEA7, XXE08 - XXE09, XXE12 Bottom Duct Application (Belt Drive)**XXEA7 (6.0 Ton) Bottom Duct**

CFM	Available External Static Pressure - IWG																			
	0.2 RPM BHP		0.4 RPM BHP		0.6 RPM BHP		0.8 RPM BHP		1.0 RPM BHP		1.2 RPM BHP		1.4 RPM BHP		1.6 RPM BHP		1.8 RPM BHP		2.0 RPM BHP	
1800	843	0.55	911	0.66	975	0.79	1035	0.93	1092	1.07	1148	1.21	1203	1.36	1258	1.49	1316	1.62	1376	1.74
1900	870	0.62	939	0.74	1003	0.86	1063	1.00	1120	1.14	1175	1.29	1230	1.43	1286	1.56	1343	1.69	1404	1.81
2000	898	0.70	967	0.82	1031	0.95	1090	1.08	1147	1.22	1203	1.37	1258	1.51	1314	1.64	1371	1.77	1432	1.89
2100	926	0.79	995	0.91	1059	1.04	1119	1.17	1176	1.31	1231	1.46	1286	1.60	1342	1.73	1399	1.86	1460	1.98
2200	955	0.89	1023	1.01	1087	1.14	1147	1.27	1204	1.41	1260	1.56	1315	1.70	1370	1.83	1428	1.96	1488	2.08
2300	983	1.00	1052	1.12	1116	1.24	1176	1.38	1233	1.52	1288	1.67	1343	1.81	1399	1.94	1456	2.07	1517	2.19
2400	1012	1.12	1081	1.23	1145	1.36	1205	1.50	1262	1.64	1317	1.79	1372	1.93	1428	2.06	1485	2.19	1546	2.31
2500	1041	1.25	1110	1.36	1173	1.49	1233	1.63	1290	1.77	1346	1.91	1401	2.06	1457	2.19	1514	2.32	1574	2.44
2600	1070	1.38	1139	1.50	1202	1.63	1262	1.77	1319	1.91	1375	2.05	1430	2.19	1485	2.33	1543	2.46	1603	2.57
2700	1098	1.53	1167	1.65	1231	1.78	1291	1.91	1348	2.06	1404	2.20	1459	2.34	1514	2.48	1572	2.60	1632	2.72
2800	1127	1.69	1196	1.80	1260	1.93	1320	2.07	1377	2.21	1432	2.36	1487	2.50	1543	2.63	1600	2.76	-	-
2900	1156	1.85	1225	1.97	1289	2.10	1348	2.24	1406	2.38	1461	2.52	1516	2.66	1572	2.80	1629	2.93	-	-
3000	1184	2.03	1253	2.14	1317	2.27	1377	2.41	1434	2.55	1490	2.69	1545	2.84	1600	2.97	1658	3.10	-	-

 Standard Static Option with Motor rated at 2.4-hp
 Medium Static Option with Motor rated at 2.9-hp
 High Static Option with Motor rated at 3.7-hp
 -- Exceeds recommended blower speed

Note: See RPM SELECTION table to determine desired motor sheave setting and to determine the maximum continuous BHP.

kW = 0.929 x BHP

XXE08 (7.5 Ton) Bottom Duct


CFM	Available External Static																			
	0.2 RPM BHP		0.4 RPM BHP		0.6 RPM BHP		0.8 RPM BHP		1.0 RPM BHP		1.2 RPM BHP		1.4 RPM BHP		1.6 RPM BHP		1.8 RPM BHP		2.0 RPM BHP	
2250	552	0.25	614	0.43	674	0.63	733	0.83	789	1.02	844	1.22	898	1.41	950	1.58	1000	1.75	1049	1.89
2400	559	0.34	621	0.52	682	0.72	740	0.91	797	1.11	852	1.31	905	1.49	957	1.67	1007	1.83	1056	1.98
2600	569	0.47	631	0.65	691	0.85	750	1.04	806	1.24	861	1.44	915	1.62	967	1.80	1017	1.96	1066	2.11
2800	579	0.61	641	0.79	701	0.99	760	1.19	817	1.38	872	1.58	925	1.77	977	1.94	1027	2.11	1076	2.25
3000	590	0.76	652	0.95	713	1.14	771	1.34	828	1.54	883	1.73	936	1.92	988	2.10	1038	2.26	1087	2.40
3200	602	0.92	665	1.11	725	1.30	783	1.50	840	1.70	895	1.89	948	2.08	1000	2.26	1050	2.42	1099	2.57
3400	616	1.09	678	1.28	738	1.47	797	1.67	854	1.87	909	2.06	962	2.25	1014	2.43	1064	2.59	--	--
3600	631	1.27	693	1.45	754	1.65	812	1.85	869	2.04	924	2.24	977	2.43	1029	2.60	1079	2.77	--	--
3750	644	1.40	706	1.59	766	1.78	824	1.98	881	2.18	936	2.37	990	2.56	1041	2.74	1092	2.90	--	--

 Standard Static Option with Motor rated at 2.4-hp
 Medium Static Option with Motor rated at 2.4-hp
 High Static Option with Motor rated at 3.7-hp
 -- Exceeds recommended blower speed

kW = 0.929 x BHP for Standard & Medium Static options kW = 0.895 x BHP for High Static option

XXE09 (8.5 Ton) Bottom Duct

CFM	Available External Static																			
	0.2 RPM BHP		0.4 RPM BHP		0.6 RPM BHP		0.8 RPM BHP		1.0 RPM BHP		1.2 RPM BHP		1.4 RPM BHP		1.6 RPM BHP		1.8 RPM BHP		2.0 RPM BHP	
2550	567	0.43	629	0.62	689	0.81	747	1.01	804	1.21	859	1.40	912	1.59	964	1.77	1014	1.93	1063	2.07
2600	569	0.47	631	0.65	691	0.85	750	1.04	806	1.24	861	1.44	915	1.62	967	1.80	1017	1.96	1066	2.11
2800	579	0.61	641	0.79	701	0.99	760	1.19	817	1.38	872	1.58	925	1.77	977	1.94	1027	2.11	1076	2.25
3000	590	0.76	652	0.95	713	1.14	771	1.34	828	1.54	883	1.73	936	1.92	988	2.10	1038	2.26	1087	2.40
3200	602	0.92	665	1.11	725	1.30	783	1.50	840	1.70	895	1.89	948	2.08	1000	2.26	1050	2.42	1099	2.57
3400	616	1.09	678	1.28	738	1.47	797	1.67	854	1.87	909	2.06	962	2.25	1014	2.43	1064	2.59	--	--
3600	631	1.27	693	1.45	754	1.65	812	1.85	869	2.04	924	2.24	977	2.43	1029	2.60	1079	2.77	--	--
3800	648	1.45	710	1.64	770	1.83	829	2.03	885	2.23	940	2.42	994	2.61	1046	2.78	1096	2.95	--	--
4000	666	1.64	729	1.82	789	2.01	847	2.21	904	2.41	959	2.61	1012	2.79	1064	2.97	--	--	--	--
4200	687	1.82	749	2.01	809	2.20	867	2.42	924	2.60	979	2.79	1032	2.98	1084	3.16	--	--	--	--
4250	692	1.87	754	2.06	814	2.25	873	2.45	929	2.65	984	2.84	1038	3.03	1090	3.21	--	--	--	--



Standard Static Option with Motor rated at 2.4-hp

Medium Static Option with Motor rated at 2.4-hp


High Static Option with Motor rated at 3.7-hp

Exceeds recommended blower speed

kW = 0.929 x BHP for Standard & Medium Static options kW = 0.895 x BHP for High Static option

XXE12 (10 Ton) Bottom Duct

CFM	Available External Static Pressure - IWG																			
	0.2 RPM BHP		0.4 RPM BHP		0.6 RPM BHP		0.8 RPM BHP		1.0 RPM BHP		1.2 RPM BHP		1.4 RPM BHP		1.6 RPM BHP		1.8 RPM BHP		2.0 RPM BHP	
3000			665	0.84	715	1.05	763	1.25	809	1.45	855	1.64	901	1.84	947	2.04	995	2.26	1045	2.48
3200			675	1.01	726	1.22	774	1.42	820	1.61	866	1.81	911	2.01	958	2.21	1005	2.42	1055	2.65
3400			687	1.19	737	1.40	785	1.60	832	1.80	878	1.99	923	2.19	970	2.40	1017	2.61	1067	2.83
3600			700	1.39	750	1.60	798	1.80	845	2.00	891	2.20	936	2.39	983	2.60	1030	2.81	1080	3.04
3800	662	1.39	715	1.61	765	1.82	813	2.02	859	2.22	905	2.41	951	2.61	997	2.81	1045	3.03	1094	3.25
4000	677	1.62	730	1.84	780	2.05	828	2.26	875	2.45	921	2.65	966	2.85	1013	3.05	1060	3.26	1110	3.49
4200	694	1.87	747	2.09	797	2.30	845	2.50	892	2.70	937	2.90	983	3.09	1029	3.30	1077	3.51	1127	3.74
4400	712	2.13	765	2.35	815	2.57	863	2.77	910	2.96	956	3.16	1001	3.36	1048	3.56	1095	3.77	1145	4.00
4600	732	2.41	785	2.63	835	2.84	883	3.04	929	3.24	975	3.44	1021	3.63	1067	3.84	1115	4.05	1165	4.28
4800	752	2.70	805	2.92	856	3.13	904	3.33	950	3.53	996	3.73	1041	3.92	1088	4.13	1135	4.34	-	-
5000	774	3.00	827	3.22	878	3.43	925	3.64	972	3.83	1018	4.03	1063	4.23	1110	4.43	1157	4.64	-	-



Standard Static Option with Motor rated at 2.4-hp

Medium Static Option with Motor rated at 3.7-hp

Bold Field Supplied AK84 x 1 fixed pulley with Motor rated at 3.7-hp

High Static Option with Motor rated at 5.25-hp

Exceeds recommended blower speed

XQE04-09 Bottom Duct Application (Belt Drive)**XQE04 (3.0 Ton) Bottom Duct**

CFM	Available External Static																			
	0.2 RPM BHP		0.4 RPM BHP		0.6 RPM BHP		0.8 RPM BHP		1.0 RPM BHP		1.2 RPM BHP		1.4 RPM BHP		1.6 RPM BHP		1.8 RPM BHP		2.0 RPM BHP	
900	743	0.14	852	0.26	955	0.37	1050	0.48	1140	0.57	1225	0.67	1306	0.77	1384	0.87	1460	0.98	1535	1.09
1000	757	0.20	867	0.33	969	0.44	1065	0.54	1155	0.64	1240	0.74	1321	0.84	1399	0.94	1475	1.04	1549	1.16
1100	774	0.27	884	0.40	986	0.51	1082	0.61	1172	0.71	1257	0.81	1338	0.91	1416	1.01	1492	1.11	1566	1.23
1200	793	0.35	903	0.47	1005	0.58	1101	0.69	1191	0.78	1276	0.88	1357	0.98	1435	1.08	1511	1.19	1585	1.30
1300	814	0.42	924	0.54	1026	0.65	1122	0.76	1212	0.86	1297	0.96	1378	1.05	1456	1.15	1532	1.26	1606	1.37
1400	837	0.49	947	0.61	1049	0.72	1145	0.83	1235	0.93	1320	1.03	1401	1.12	1479	1.23	1555	1.33	1629	1.45
1500	862	0.56	972	0.68	1074	0.79	1170	0.90	1260	1.00	1345	1.09	1426	1.19	1504	1.29	1580	1.40	--	--

kW = 0.929 x BHP

Bold

Field-supplied AK51 x 3/4" fixed blower pulley with motor rated at 2.4-hp

Medium Static Option with Motor rated at 2.4-hp

High Static Option with Motor rated at 2.4-hp

Bold

Field-supplied AK41 x 3/4" fixed blower pulley with motor rated at 2.4-hp

--

Exceeds recommended blower speed

XQE05 (4.0 Ton) Bottom Duct

CFM	Available External Static																			
	0.2 RPM BHP		0.4 RPM BHP		0.6 RPM BHP		0.8 RPM BHP		1.0 RPM BHP		1.2 RPM BHP		1.4 RPM BHP		1.6 RPM BHP		1.8 RPM BHP		2.0 RPM BHP	
1200	801	0.25	903	0.38	999	0.51	1089	0.63	1173	0.76	1252	0.88	1327	1.00	1396	1.11	1461	1.22	1521	1.33
1300	822	0.31	924	0.44	1020	0.57	1110	0.69	1194	0.82	1273	0.94	1348	1.06	1417	1.17	1482	1.28	1542	1.39
1400	844	0.38	946	0.51	1042	0.64	1132	0.76	1216	0.89	1295	1.01	1370	1.13	1439	1.24	1504	1.35	1564	1.46
1500	867	0.46	969	0.59	1065	0.71	1155	0.84	1239	0.96	1319	1.08	1393	1.20	1462	1.32	1527	1.43	1587	1.53
1600	891	0.54	993	0.67	1089	0.79	1179	0.92	1264	1.04	1343	1.16	1417	1.28	1486	1.40	1551	1.51	1612	1.61
1700	917	0.63	1019	0.75	1115	0.88	1205	1.01	1289	1.13	1368	1.25	1442	1.37	1512	1.48	1577	1.60	1637	1.70
1800	943	0.72	1045	0.85	1141	0.97	1231	1.10	1316	1.22	1395	1.34	1469	1.46	1538	1.58	1603	1.69	--	--
1900	971	0.81	1073	0.94	1169	1.07	1259	1.19	1344	1.32	1423	1.44	1497	1.56	1566	1.67	1631	1.78	--	--
2000	1000	0.92	1102	1.04	1198	1.17	1288	1.29	1372	1.42	1452	1.54	1526	1.66	1595	1.77	--	--	--	--

kW = 0.929 x BHP

Bold

Medium Static Option with Motor rated at 2.4-hp

High Static Option with Motor rated at 2.4-hp

Bold

Field-supplied AK41 x 3/4" fixed blower pulley with motor rated at 2.4-hp

--

Exceeds recommended blower speed

XQE06 (5.0 Ton) Bottom Duct

CFM	Available External Static																			
	0.2 RPM BHP		0.4 RPM BHP		0.6 RPM BHP		0.8 RPM BHP		1.0 RPM BHP		1.2 RPM BHP		1.4 RPM BHP		1.6 RPM BHP		1.8 RPM BHP		2.0 RPM BHP	
1500	812	0.36	869	0.46	931	0.55	997	0.64	1063	0.74	1129	0.84	1193	0.94	1253	1.05	1307	1.16	1354	1.27
1600	829	0.43	886	0.52	948	0.61	1013	0.71	1080	0.80	1146	0.90	1210	1.01	1270	1.11	1324	1.22	1370	1.34
1700	846	0.50	904	0.59	966	0.68	1031	0.78	1097	0.87	1164	0.97	1227	1.07	1287	1.18	1341	1.29	1388	1.41
1800	865	0.57	922	0.66	985	0.75	1050	0.85	1116	0.95	1182	1.05	1246	1.15	1306	1.25	1360	1.36	1407	1.48
1900	885	0.65	943	0.74	1005	0.83	1070	0.93	1136	1.02	1203	1.12	1266	1.23	1326	1.33	1380	1.44	1427	1.56
2000	907	0.73	964	0.82	1026	0.92	1092	1.01	1158	1.11	1224	1.21	1288	1.31	1348	1.42	1402	1.53	1449	1.64
2100	930	0.82	987	0.91	1049	1.01	1115	1.10	1181	1.20	1247	1.30	1311	1.40	1371	1.51	1425	1.62	1472	1.73
2200	955	0.92	1012	1.01	1074	1.10	1139	1.20	1206	1.29	1272	1.39	1336	1.50	1396	1.60	1450	1.71	1496	1.83
2300	981	1.02	1038	1.11	1101	1.20	1166	1.30	1232	1.39	1298	1.49	1362	1.60	1422	1.70	1476	1.81	1523	1.93
2400	1009	1.12	1066	1.22	1128	1.31	1194	1.40	1260	1.50	1326	1.60	1390	1.70	1450	1.81	1504	1.92	1551	2.03
2500	1038	1.24	1096	1.33	1158	1.42	1223	1.52	1290	1.61	1356	1.71	1420	1.82	1480	1.92	1534	2.03	1580	2.15

kW = 0.857 x BHP

Bold

Medium Static Option with Motor rated at 2.4-hp

High Static Option with Motor rated at 2.9-hp

XYE04-06 Side Duct Application (Direct Drive)**XYE04-06 Side Duct**

Unit (Ton)	Motor Speed	Available External Static														
		0.2			0.4			0.6			0.8			1.0		
		CFM	WATTS	RPM	CFM	WATTS	RPM	CFM	WATTS	RPM	CFM	WATTS	RPM	CFM	WATTS	RPM
XYE04 (3)	1 (LOW)	987	120	651	813	145	774	698	162	864	541	180	959	383	201	1047
	2 (MED/LOW)	1079	144	677	936	171	795	793	190	886	692	214	975	521	232	1063
	3 (MED)	1153	166	701	1037	195	812	875	221	913	786	239	986	654	263	1076
	4 (MED/HI)	1191	178	712	1086	206	815	927	233	916	837	257	998	711	278	1083
	5 (HI)	1326	229	757	1235	261	856	1124	291	951	973	319	1035	896	336	1099
XYE05 (4)	1 (LOW)	1302	207	727	1188	240	841	1037	266	933	941	296	1022	882	318	1098
	2 (MED/LOW)	1421	247	757	1323	282	861	1209	315	958	1064	346	1043	993	368	1116
	3 (MED)	1538	297	795	1453	332	888	1343	367	982	1216	396	1058	1093	427	1146
	4 (MED/HI)	1571	315	809	1496	352	898	1385	389	996	1288	420	1072	1135	444	1147
	5 (HI)	1779	432	878	1707	470	960	1615	511	1042	1516	544	1123	1165	468	1160
XYE06 (5)	1 (LOW)	1588	298	695	1517	330	761	1409	358	835	1273	393	913	1167	418	973
	2 (MED/LOW)	1624	321	713	1557	352	777	1464	383	845	1315	418	924	1224	446	983
	3 (MED)	1942	504	792	1881	536	852	1800	565	908	1714	605	969	1611	644	1038
	4 (MED/HI)	2146	631	840	2064	692	908	2001	713	954	1932	757	1007	1843	794	1065
	5 (HI)	2316	812	892	2240	861	954	2181	894	1000	2113	938	1045	2003	946	1093

XYE04-06 Bottom Duct Application (Direct Drive)**XYE04-06 Bottom Duct**

Unit (Ton)	Motor Speed	Available External Static														
		0.2			0.4			0.6			0.8			1.0		
		CFM	WATTS	RPM	CFM	WATTS	RPM	CFM	WATTS	RPM	CFM	WATTS	RPM	CFM	WATTS	RPM
XYE04 (3)	1 (LOW)	929	128	699	782	148	794	663	164	880	514	187	976	377	202	1053
	2 (MED/LOW)	1036	157	732	870	177	827	803	198	905	649	217	996	508	236	1074
	3 (MED)	1106	181	760	956	204	849	878	225	928	755	245	1010	616	266	1092
	4 (MED/HI)	1147	197	776	1042	218	860	916	243	944	820	262	1017	671	286	1103
	5 (HI)	1272	252	830	1177	277	909	1037	304	986	975	323	1053	872	347	1125
XYE05 (4)	1 (LOW)	1256	220	776	1170	242	851	1077	266	931	988	298	1025	872	321	1113
	2 (MED/LOW)	1350	272	828	1279	292	893	1196	320	966	1105	347	1048	1003	372	1131
	3 (MED)	1449	323	866	1380	350	937	1303	370	996	1223	402	1071	1133	428	1149
	4 (MED/HI)	1488	345	882	1418	374	954	1357	394	1006	1264	424	1083	1160	442	1155
	5 (HI)	1677	471	966	1602	507	1034	1543	525	1083	1475	545	1131	1209	465	1162
XYE06 (5)	1 (LOW)	1548	310	720	1441	336	792	1337	370	864	1213	397	928	1097	421	988
	2 (MED/LOW)	1593	337	738	1488	363	805	1381	394	875	1271	425	937	1150	451	997
	3 (MED)	1880	532	827	1792	563	890	1719	588	944	1632	629	1006	1527	652	1061
	4 (MED/HI)	2066	689	895	1999	712	942	1907	761	999	1830	773	1048	1734	809	1100
	5 (HI)	2237	862	949	2163	882	996	2097	929	1036	1998	946	1085	1815	883	1115


XQE04-06 Side Duct Application (Direct Drive)**XQE04-06 Side Duct**

Unit (Ton)	Motor Speed	Available External Static														
		0.2			0.4			0.6			0.8			1.0		
		CFM	WATTS	RPM	CFM	WATTS	RPM	CFM	WATTS	RPM	CFM	WATTS	RPM	CFM	WATTS	RPM
XYE04 (3)	1 (LOW)	987	120	651	813	145	774	698	162	864	541	180	959	383	201	1047
	2 (MED/LOW)	1079	144	677	936	171	795	793	190	886	692	214	975	521	232	1063
	3 (MED)	1153	166	701	1037	195	812	875	221	913	786	239	986	654	263	1076
	4 (MED/HI)	1191	178	712	1086	206	815	927	233	916	837	257	998	711	278	1083
	5 (HI)	1326	229	757	1235	261	856	1124	291	951	973	319	1035	896	336	1099
XYE05 (4)	1 (LOW)	1302	207	727	1188	240	841	1037	266	933	941	296	1022	882	318	1098
	2 (MED/LOW)	1421	247	757	1323	282	861	1209	315	958	1064	346	1043	993	368	1116
	3 (MED)	1538	297	795	1453	332	888	1343	367	982	1216	396	1058	1093	427	1146
	4 (MED/HI)	1571	315	809	1496	352	898	1385	389	996	1288	420	1072	1135	444	1147
	5 (HI)	1779	432	878	1707	470	960	1615	511	1042	1516	544	1123	1165	468	1160
XYE06 (5)	1 (LOW)	1588	298	695	1517	330	761	1409	358	835	1273	393	913	1167	418	973
	2 (MED/LOW)	1624	321	713	1557	352	777	1464	383	845	1315	418	924	1224	446	983
	3 (MED)	1942	504	792	1881	536	852	1800	565	908	1714	605	969	1611	644	1038
	4 (MED/HI)	2146	631	840	2064	692	908	2001	713	954	1932	757	1007	1843	794	1065
	5 (HI)	2316	812	892	2240	861	954	2181	894	1000	2113	938	1045	2003	946	1093


XQE04-06 Bottom Duct Application (Direct Drive)**XQE04-06 Bottom Duct**

Unit (Ton)	Motor Speed	Available External Static														
		0.2			0.4			0.6			0.8			1.0		
		CFM	WATTS	RPM	CFM	WATTS	RPM	CFM	WATTS	RPM	CFM	WATTS	RPM	CFM	WATTS	RPM
XQE04 (3)	1 (LOW)	929	128	699	782	148	794	663	164	880	514	187	976	377	202	1053
	2 (MED/LOW)	1036	157	732	870	177	827	803	198	905	649	217	996	508	236	1074
	3 (MED)	1106	181	760	956	204	849	878	225	928	755	245	1010	616	266	1092
	4 (MED/HI)	1147	197	776	1042	218	860	916	243	944	820	262	1017	671	286	1103
	5 (HI)	1272	252	830	1177	277	909	1037	304	986	975	323	1053	872	347	1125
XQE05 (4)	1 (LOW)	1256	220	776	1170	242	851	1077	266	931	988	298	1025	872	321	1113
	2 (MED/LOW)	1350	272	828	1279	292	893	1196	320	966	1105	347	1048	1003	372	1131
	3 (MED)	1449	323	866	1380	350	937	1303	370	996	1223	402	1071	1133	428	1149
	4 (MED/HI)	1488	345	882	1418	374	954	1357	394	1006	1264	424	1083	1160	442	1155
	5 (HI)	1677	471	966	1602	507	1034	1543	525	1083	1475	545	1131	1209	465	1162
XQE06 (5)	1 (LOW)	1548	310	720	1441	336	792	1337	370	864	1213	397	928	1097	421	988
	2 (MED/LOW)	1593	337	738	1488	363	805	1381	394	875	1271	425	937	1150	451	997
	3 (MED)	1880	532	827	1792	563	890	1719	588	944	1632	629	1006	1527	652	1061
	4 (MED/HI)	2066	689	895	1999	712	942	1907	761	999	1830	773	1048	1734	809	1100
	5 (HI)	2237	862	949	2163	882	996	2097	929	1036	1998	946	1085	1815	883	1115


Power Exhaust Blower Curves

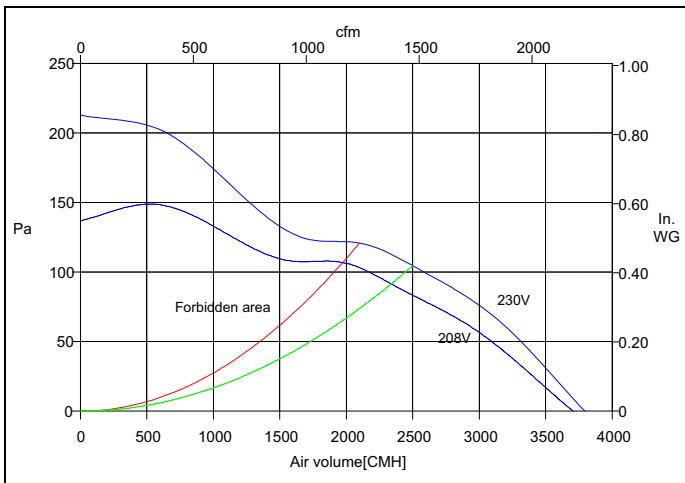


208/280-1-60 Power Exhaust Fan Curve

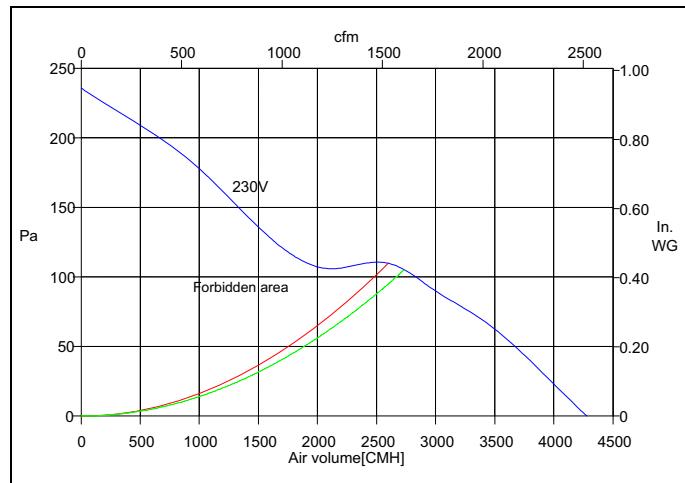

208/280-3-60 Power Exhaust Fan Curve

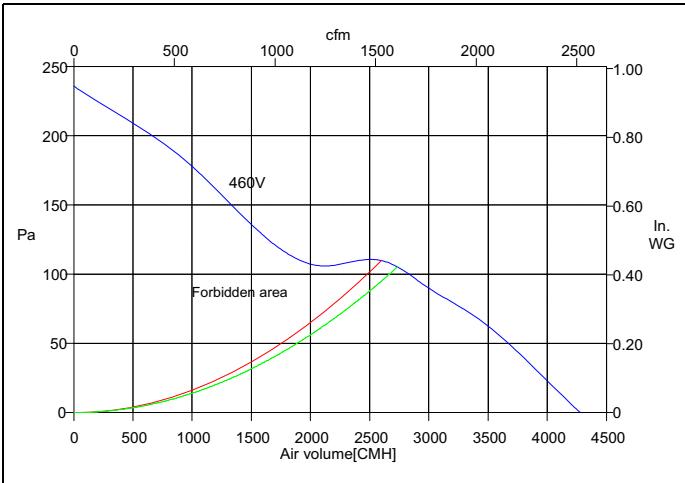

460-3-60 Power Exhaust Fan Curve

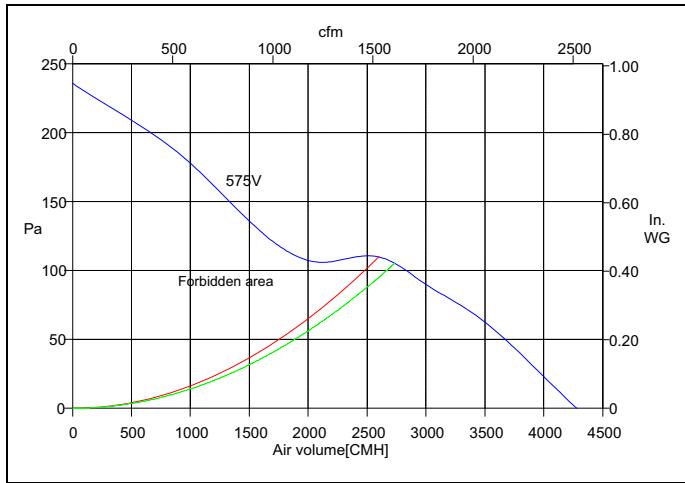

575-3-50 Power Exhaust Fan Curve

Electrical Data

XYE04-09 Standard Indoor Blower - Without Powered Convenience Outlet

Size (Tons)	Nominal Unit Voltage	Compressor 1			Compressor 2			OD Fan Motors (each)	Supply Blower Motor	Pwr Exh Motor	Pwr Conv Outlet	Electric Heat Field Installed Kit 2EK045*				MCA ¹ (Amps)	Min Fuse ² / Breaker ³ Size (Amps)	Max Fuse ² / Breaker ³ Size (Amps)	Min Discon- nect Rating ⁴		MCA ¹ w/Pwr Exh (Amps)	Min Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Max Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Min Discon- nect Rating ⁴ / Pwr Exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps		FLA	LRA							
		RLA	LRA	MCC	RLA	LRA	MCC																		
04 (3)	208-1-60	15.4	83.9	24				2.3	6.6	1.5		None	-	-	-	28.2	30	40	28	91	29.7	30	45	30	94
												10625	4.9	1	23.6	57.7	60	60	55	114	59.2	60	60	57	118
												11125	7.9	1	38	75.7	80	80	72	129	77.2	80	80	73	132
												None	-	-	-	27.6	30	40	27	91	28.9	30	40	29	94
												10625	6.5	1	27.1	61.5	70	70	58	118	62.8	70	70	60	121
												11125	10.5	1	43.8	82.4	90	90	78	135	83.7	90	90	79	138
	230-1-60	15.4	83.9	24				2.3	6	1.3		None	-	-	-	21.9	25	30	22	80	23	25	30	23	82
												10625	4.9	1	13.6	38.9	40	45	38	93	40	40	45	39	96
												11125	7.9	1	21.9	49.3	50	50	47	102	50.4	60	60	49	104
												11625	12	1	33.3	63.5	70	70	60	113	64.6	70	70	62	116
												None	-	-	-	21.3	25	30	22	80	22.3	25	30	23	82
												10625	6.5	1	15.6	40.8	45	45	39	96	41.8	45	45	41	98
	208-3-60	10.4	73	16				2.3	6.6	1.1		11125	10.5	1	25.3	52.9	60	60	51	105	53.9	60	60	52	108
												11625	16	1	38.5	69.4	70	70	66	119	70.4	80	80	67	121
												None	-	-	-	11.8	15	15	12	43	12.3	15	15	12	44
												10646	6	1	7.2	20.8	25	25	20	50	21.3	25	25	21	51
												11146	11.5	1	13.8	29.1	30	30	28	57	29.6	30	30	28	58
												11446	14	1	16.8	32.8	35	35	31	60	33.3	35	35	32	61
	460-3-60	5.8	38	9				1.3	3.2	0.5		None	-	-	-	8.3	15	15	8	40	8.7	15	15	9	41
												11058	9.2	1	8.9	19.4	20	20	19	49	19.8	20	20	19	49
												11458	13.8	1	13.3	24.9	25	25	24	53	25.3	30	30	24	54
												None	-	-	-	35.2	40	50	35	137	36.7	40	50	37	140
												10625	4.9	1	23.6	64.7	70	70	62	160	66.2	70	70	64	164
												11125	7.9	1	38	82.7	90	90	79	175	84.2	90	90	80	178
	230-1-60	19.6	130	31				2.3	7.6	1.3		None	-	-	-	34.4	35	50	34	137	35.7	40	50	35	140
												10625	6.5	1	27.1	68.3	70	80	65	164	69.6	70	80	67	167
												11125	10.5	1	43.8	89.2	90	90	84	181	90.5	100	100	86	184
												None	-	-	-	27.8	30	40	28	90	28.9	30	40	29	92
												10625	4.9	1	13.6	44.8	45	50	44	104	45.9	50	50	45	106
												11125	7.9	1	21.9	55.2	60	60	53	112	56.3	60	60	55	114
05 (4)	208-3-60	13.7	83.1	21				2.3	8.4	1.1		11625	12	1	33.3	69.4	70	70	66	123	70.5	80	80	68	126
												None	-	-	-	27	30	40	27	90	28	30	40	28	92
												10625	6.5	1	15.6	46.5	50	50	45	106	47.5	50	50	46	108
												11125	10.5	1	25.3	58.6	60	60	56	115	59.6	60	60	57	118
												11625	16	1	38.5	75.1	80	80	71	129	76.1	80	80	73	131
												None	-	-	-	13.1	15	15	13	46	13.6	15	15	14	47
	460-3-60	6.2	41	10				1.3	4	0.5		10646	6	1	7.2	22.1	25	25	22	53	22.6	25	25	22	54
												11146	11.5	1	13.8	30.4	35	35	29	60	30.9	35	35	30	61
												11446	14	1	16.8	34.1	35	35	33	63	34.6	35	35	33	64
												None	-	-	-	10.1	15	15	10	36	10.5	15	15	11	37
												11058	9.2	1	8.9	21.2	25	25	20	45	21.6	25	25	21	46
												11458	13.8	1	13.3	26.7	30	30	26	49	27.1	30	30	26	50

XYE04-09 Standard Indoor Blower - Without Powered Convenience Outlet (Continued)

Size (Tons)	Nominal Unit Voltage	Compressor 1			Compressor 2			OD Fan Motors (each)	Supply Blower Motor	Pwr Exh Motor	Pwr Conv Outlet	Electric Heat Field Installed Kit 2EK045*				MCA ¹ (Amps)	Min Fuse ² / Breaker ³ Size (Amps)	Max Fuse ² / Breaker ³ Size (Amps)	Min Disconnect Rating ⁴	MCA ¹ w/Pwr Exh (Amps)	Min Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Max Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Min Disconnect Rating ⁴ / Pwr Exh		
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps		FLA	LRA							
06 (5)	208-1-60	24.4	144.2	38				2.3	8.4	1.5		None	-	-	-	41.2	45	60	40	151	42.7	45	60	42	154
												10625	4.9	1	23.6	70.7	80	80	68	175	72.2	80	90	69	178
												11125	7.9	1	38	88.7	90	100	84	189	90.2	100	100	86	192
	230-1-60	24.4	144.2	38				2.3	7.6	1.3		None	-	-	-	40.4	45	60	39	151	41.7	45	60	41	154
												10625	6.5	1	27.1	74.3	80	90	71	178	75.6	80	90	72	181
												11125	10.5	1	43.8	95.2	100	100	90	195	96.5	100	100	91	198
	208-3-60	16	110	25				2.3	8.4	1.1		None	-	-	-	30.7	35	45	31	117	31.8	35	45	32	119
												10625	4.9	1	13.6	47.7	50	60	46	130	48.8	50	60	48	133
												11125	7.9	1	21.9	58.1	60	60	56	139	59.2	60	60	57	141
	230-3-60	16	110	25				2.3	7.6	1		None	-	-	-	29.9	30	45	30	117	30.9	35	45	31	119
												10625	6.5	1	15.6	49.4	50	60	48	133	50.4	60	60	49	135
												11125	10.5	1	25.3	61.5	70	70	59	142	62.5	70	70	60	145
	460-3-60	7.8	52	12				1.3	4	0.5		None	-	-	-	15.1	20	20	15	57	15.6	20	20	16	58
												10646	6	1	7.2	24.1	25	30	23	64	24.6	25	30	24	65
												11146	11.5	1	13.8	32.4	35	35	31	71	32.9	35	35	32	72
	575-3-60	5.7	38.9	9				1.1	7.6	0.4		None	-	-	-	11.2	15	15	11	42	11.6	15	15	12	43
												11458	13.8	1	13.3	27.8	30	30	27	55	28.2	30	30	27	56
												12358	23	1	22.1	38.8	40	40	37	64	39.2	40	40	37	65
07 (6)	208-3-60	19.6	136	31				2.3	5.2	1.1		None	-	-	-	34.3	35	50	34	178	36.5	40	50	36	188
												10725	4.9	1	13.6	51.3	60	60	49	191	53.5	60	60	52	201
												11725	12	1	33.3	75.9	80	80	72	211	78.1	80	80	75	221
	230-3-60	19.6	136	31				2.3	5.2	1		None	-	-	-	34.3	35	50	34	181	36.3	40	50	36	176
												10725	6.5	1	15.6	53.8	60	60	52	197	55.8	60	70	54	206
												11725	16	1	38.5	82.4	90	90	78	220	84.4	90	90	80	229
	460-3-60	8.2	66.1	13				1.3	2.6	0.5		None	-	-	-	15.5	20	20	15	90	16.5	20	20	17	87
												10746	6	1	7.2	24.5	25	30	24	97	25.5	30	30	25	102
												11746	16.5	1	19.8	40.3	45	45	38	110	41.3	45	45	39	114
	575-3-60	6.6	55.3	10				1.1	2	0.4		None	-	-	-	12.5	15	15	12	75	13.3	15	15	13	72
												11758	17	1	16.4	33	35	35	31	91	33.8	35	35	32	95
												12658	25.7	1	24.7	43.4	45	45	41	99	44.2	45	45	42	103

XYE04-09 Standard Indoor Blower - Without Powered Convenience Outlet (Continued)

Size (Tons)	Nominal Unit Voltage	Compressor 1			Compressor 2			OD Fan Motors (each)	Supply Blower Motor	Pwr Exh Motor	Pwr Conv Outlet	Electric Heat Field Installed Kit 2EK045*				MCA ¹ (Amps)	Min Fuse ² / Breaker ³ Size (Amps)	Max Fuse ² / Breaker ³ Size (Amps)	Min Disconnect Rating ⁴	MCA ¹ w/Pwr Exh (Amps)	Min Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Max Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Min Disconnect Rating ⁴ / Pwr Exh
		Model	kW	Stages	Amps	FLA	LRA					FLA	LRA										
		RLA	LRA	MCC	RLA	LRA	MCC					FLA	LRA										
08 (7.5)	208-3-60	None	-	-	-	41.9	45	50	44	211	44.1	45	50	47	221								
		11725	12	1	33.3	83.5	90	90	82	244	85.7	90	90	85	254								
		12525	18.6	1	51.6	106.4	110	110	104	262	108.6	110	110	106	272								
		13225	24	1	66.6	125.2	150	150	121	277	127.4	150	150	123	287								
		14225	31.8	2	88.3	116.9	125	125	112	270	119.6	125	125	115	280								
	230-3-60	None	-	-	-	41.3	45	50	43	210	43.3	45	50	46	215								
		11725	16	1	38.5	89.4	90	90	88	249	91.4	100	100	90	258								
		12525	24.8	1	59.7	115.9	125	125	112	270	117.9	125	125	114	279								
		13225	32	1	77	137.6	150	150	132	287	139.6	150	150	134	296								
		14225	42.4	2	102	134	150	150	122	278	136.5	150	150	124	288								
	460-3-60	None	-	-	-	19.4	20	25	20	106	20.4	25	25	22	108								
		11746	16.5	1	19.8	44.2	45	45	43	125	45.2	50	50	44	130								
		12846	27.8	1	33.4	61.2	70	70	59	139	62.2	70	70	60	143								
		13346	33	1	39.7	69	70	70	66	145	70	70	70	67	150								
		14246	41.7	2	50.2	66	70	70	59	139	67.3	70	70	60	143								
	575-3-60	None	-	-	-	14.5	15	15	15	87	15.3	20	20	16	89								
		11758	17	1	16.4	35	35	35	34	104	35.8	40	40	35	107								
		13458	34	1	32.7	55.4	60	60	53	120	56.2	60	60	54	124								
09 (8.5)	208-3-60	None	-	-	-	42.8	45	50	45	226	45	45	50	48	236								
		11725	12	1	33.3	84.4	90	90	83	259	86.6	90	90	86	269								
		12525	18.6	1	51.6	107.3	110	110	104	277	109.5	110	110	107	287								
		13225	24	1	66.6	126.1	150	150	122	292	128.3	150	150	124	302								
		14225	31.8	2	88.3	116.9	125	125	113	285	119.6	125	125	116	295								
	230-3-60	None	-	-	-	42.2	45	50	44	225	44.2	45	50	47	230								
		11725	16	1	38.5	90.3	100	100	89	264	92.3	100	100	91	273								
		12525	24.8	1	59.7	116.8	125	125	113	285	118.8	125	125	115	294								
		13225	32	1	77	138.5	150	150	133	302	140.5	150	150	135	311								
		14225	42.4	2	102	134	150	150	123	293	136.5	150	150	125	302								
	460-3-60	None	-	-	-	19.6	20	25	21	120	20.6	25	25	22	122								
		11746	16.5	1	19.8	44.4	45	45	43	139	45.4	50	50	45	144								
		12846	27.8	1	33.4	61.4	70	70	59	153	62.4	70	70	60	157								
		13346	33	1	39.7	69.2	70	70	66	159	70.2	80	80	68	164								
		14246	41.7	2	50.2	66	70	70	59	153	67.3	70	70	60	157								
	575-3-60	None	-	-	-	16.5	20	20	17	95	17.3	20	20	18	97								
		11758	17	1	16.4	37	40	40	36	112	37.8	40	40	40	115								
		13458	34	1	32.7	57.4	60	60	55	128	58.2	60	60	56	132								

With VFD

08 (7.5)	208-3-60	None	-	-	-	43.7	45	50	46	248	45.9	50	50	49	258						
		11725	12	1	33.3	85.3	90	90	85	282	87.5	90	90	87	292						
		12525	18.6	1	51.6	108.2	110	110	106	300	110.4	125	125	108	310						
		13225	24	1	66.6	127	150	150	123	315	129.2	150	150	125	325						
		14225	31.8	2	88.3	119.1	125	125	114	307	121.9	125	125	117	317						
	230-3-60	None	-	-	-	43.3	45	50	46	247	45.3	50	50	48	252						
		11725	16	1	38.5	91.4	100	100	90	286	93.4	100	100	92	295						
		12525	24.8	1	59.7	117.9	125	125	114	307	119.9	125	125	117	316						
		13225	32	1	77	139.6	150	150	134	324	141.6	150	150	137	333						
		14225	42.4	2	102	136.5	150	150	124	315	139	150	150	126	324						
	460-3-60	None	-	-	-	20.4	25	25	22	124	21.4	25	25	23	126						
		11746	16.5	1	19.8	45.2	50	50	44	144	46.2	50	50	46	148						
		12846	27.8	1	33.4	62.2	70	70	60	157	63.2	70	70	61	162						
		13346	33	1	39.7	70	70	70	67	164	71	80	80	68	168						
		14246	41.7	2	50.2	67.3	70	70	60	157	68.5	70	70	61	162						
	575-3-60	None	-	-	-	15	20	20	16	95	15.8	20	20	20	17	97					
		11758	17	1	16.4	35.5	40	40	35	111	36.3	40	40	40	36	115					
		13458	34	1	32.7	55.9	60	60	53	128	56.7	60	60	60	54	131					

XYE04-09 Standard Indoor Blower - Without Powered Convenience Outlet (Continued)

Size (Tons)	Nominal Unit Voltage	Compressor 1			Compressor 2			OD Fan Motors (each)	Supply Blower Motor	Pwr Exh Motor	Pwr Conv Outlet	Electric Heat Field Installed Kit 2EK045*				MCA ¹ (Amps)	Min Fuse ² / Breaker ³ Size (Amps)	Max Fuse ² / Breaker ³ Size (Amps)	Min Disconnect Rating ⁴	MCA ¹ w/Pwr Exh (Amps)	Min Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Max Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Min Disconnect Rating ⁴ / Pwr Exh		
		Model	kW	Stages	Amps	FLA	LRA																		
		RLA	LRA	MCC	RLA	LRA	MCC					FLA	LRA	FLA	LRA										
09 (8.5)	208-3-60	14.5	98	23	13.7	83.1	21	5.8	7	1.1		None	-	-	-	44.6	45	50	47	263	46.8	50	60	50	273
												11725	12	1	33.3	86.2	90	90	85	297	88.4	90	90	88	307
												12525	18.6	1	51.6	109.1	110	110	106	315	111.3	125	125	109	325
												13225	24	1	66.6	127.9	150	150	124	330	130.1	150	150	126	340
												14225	31.8	2	88.3	119.1	125	125	115	322	121.9	125	125	118	332
	230-3-60	14.5	98	23	13.7	83.1	21	5.2	7.2	1		None	-	-	-	44.2	45	50	47	262	46.2	50	60	49	267
												11725	16	1	38.5	92.3	100	100	91	300	94.3	100	100	93	310
												12525	24.8	1	59.7	118.8	125	125	115	322	120.8	125	125	118	331
												13225	32	1	77	140.5	150	150	135	339	142.5	150	150	138	348
												14225	42.4	2	102	136.5	150	150	125	330	139	150	150	127	339
	460-3-60	6.3	55	10	6.2	41	10	2.9	3.6	0.5		None	-	-	-	20.6	25	25	22	138	21.6	25	25	23	140
												11746	16.5	1	19.8	45.4	50	50	45	158	46.4	50	50	46	162
												12846	27.8	1	33.4	62.4	70	70	60	171	63.4	70	70	61	176
												13346	33	1	39.7	70.2	80	80	68	178	71.2	80	80	69	182
												14246	41.7	2	50.2	67.3	70	70	60	171	68.5	70	70	61	176
	575-3-60	6	41	9	4.8	33	8	2.2	2.5	0.4		None	-	-	-	17	20	20	18	103	17.8	20	20	19	105
												11758	17	1	16.4	37.5	40	40	37	119	38.3	40	40	38	123
												13458	34	1	32.7	57.9	60	60	55	136	58.7	60	60	56	139

1. Minimum Circuit Ampacity.
2. Dual Element, Time Delay Type.
3. HACR type per NEC.
4. Non-fused Disconnect, Verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

XYE04-09 Standard Indoor Blower - With Powered Convenience Outlet (Continued)

Size (Tons)	Nominal Unit Voltage	Compressor 1			Compressor 2			OD Fan Motors (each)	Supply Blower Motor	Pwr Exh Motor	Pwr Conv Outlet	Electric Heat Field Installed Kit 2EK045*				MCA ¹ (Amps)	Min Fuse ² / Breaker ³ Size (Amps)	Max Fuse ² / Breaker ³ Size (Amps)	Min Disconnect Rating ⁴	MCA ¹ w/Pwr Exh (Amps)	Min Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Max Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Min Disconnect Rating ⁴ / Pwr Exh			
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps		FLA	LRA								
06 (5)	208-1-60	24.4	144. 2	38				2.3	8.4	1.5	8.6	None	-	-	-	45.5	50	60	45	155	47	50	70	47	159	
												10625	4.9	1	23.6	75	80	90	72	179	76.5	80	90	74	182	
												11125	7.9	1	38	93	100	100	89	193	94.5	100	100	91	197	
	230-1-60	24.4	144. 2	38				2.3	7.6	1.3	8.6	None	-	-	-	44.7	45	60	44	156	46	50	70	46	158	
												10625	6.5	1	27.1	78.6	80	90	76	183	79.9	80	90	77	186	
												11125	10.5	1	43.8	99.5	100	110	95	199	100.8	110	110	96	202	
	208-3-60	16	110	25				2.3	8.4	1.1	8.6	None	-	-	-	35	35	50	36	121	36.1	40	50	37	124	
												10625	4.9	1	13.6	52	60	60	51	135	53.1	60	60	53	137	
												11125	7.9	1	21.9	62.4	70	70	61	143	63.5	70	70	62	146	
	230-3-60	16	110	25				2.3	7.6	1	8.6	None	-	-	-	33.3	76.6	80	80	74	154	77.7	80	80	75	157
												10625	6.5	1	15.6	53.7	60	60	53	137	54.7	60	60	54	139	
												11125	10.5	1	25.3	65.8	70	70	64	147	66.8	70	70	65	149	
	460-3-60	7.8	52	12				1.3	4	0.5	8.6	None	-	-	-	17.3	20	25	18	59	17.8	20	25	18	60	
												10646	6	1	7.2	26.3	30	30	26	66	26.8	30	30	26	67	
												11146	11.5	1	13.8	34.6	35	35	33	73	35.1	40	40	34	74	
	575-3-60	5.7	38.9	9				1.1	7.6	0.4	8.6	None	-	-	-	13	15	15	13	44	13.4	15	15	14	45	
												11458	13.8	1	13.3	29.6	30	30	29	57	30	30	30	29	58	
												12358	23	1	22.1	40.6	45	45	39	66	41	45	45	39	67	
07 (6)	208-3-60	19.6	136	31				2.3	5.2	1.1	8.6	None	-	-	-	38.6	40	50	39	182	40.8	45	50	41	192	
												10725	4.9	1	13.6	55.6	60	70	54	196	57.8	60	70	57	206	
												11725	12	1	33.3	80.2	90	90	77	215	82.4	90	90	80	225	
	230-3-60	19.6	136	31				2.3	5.2	1	8.6	None	-	-	-	38.6	40	50	39	185	40.6	45	60	41	180	
												10725	6.5	1	15.6	58.1	60	70	57	201	60.1	70	70	59	210	
												11725	16	1	38.5	86.7	90	90	83	224	88.7	90	90	85	233	
	460-3-60	8.2	66.1	13				1.3	2.6	0.5	8.6	None	-	-	-	17.7	20	25	18	92	18.7	20	25	19	89	
												10746	6	1	7.2	26.7	30	30	26	100	27.7	30	30	27	104	
												11746	16.5	1	19.8	42.5	45	45	41	112	43.5	45	45	42	117	
	575-3-60	6.6	55.3	10				1.1	2	0.4	8.6	None	-	-	-	14.2	15	20	14	76	15	15	20	15	74	
												11758	17	1	16.4	34.7	35	35	33	93	35.5	40	40	34	96	
												12658	25.7	1	24.7	45.1	50	50	43	101	45.9	50	50	44	105	

XYE04-09 Standard Indoor Blower - With Powered Convenience Outlet (Continued)

Size (Tons)	Nominal Unit Voltage	Compressor 1			Compressor 2			OD Fan Motors (each)	Supply Blower Motor	Pwr Exh Motor	Pwr Conv Outlet	Electric Heat Field Installed Kit 2EK045*				MCA ¹ (Amps)	Min Fuse ² / Breaker ³ Size (Amps)	Max Fuse ² / Breaker ³ Size (Amps)	Min Disconnect Rating ⁴		MCA ¹ w/Pwr Exh (Amps)	Min Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Max Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Min Disconnect Rating ⁴ / Pwr Exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps		FLA	LRA							
09 (8.5)	208-3-60	14.5	98	23	13.7	83.1	21	5.8	7	1.1	8.6	None	-	-	-	48.9	50	60	52	268	51.1	60	60	55	278
			11725	12	1	33.3	90.5					100	100	90	301	92.7	100	100	100	93	311				
			12525	18.6	1	51.6	113.4					125	125	111	319	115.6	125	125	125	114	329				
			13225	24	1	66.6	132.2					150	150	129	334	134.4	150	150	150	131	344				
			14225	31.8	2	88.3	124.5					125	125	120	327	127.3	150	150	150	123	337				
			None	-	-	-	-					48.5	50	60	52	266	50.5	60	60	54	271				
	230-3-60	14.5	98	23	13.7	83.1	21	5.2	7.2	1	8.6	11725	16	1	38.5	96.6	100	100	96	305	98.6	100	100	98	314
			12525	24.8	1	59.7	123.1					125	125	120	326	125.1	150	150	150	123	335				
			13225	32	1	77	144.8					150	150	140	343	146.8	150	150	150	142	352				
			14225	42.4	2	102	141.9					150	150	130	334	144.4	150	150	150	132	344				
			None	-	-	-	-					22.8	25	25	24	140	23.8	25	25	26	142				
			11746	16.5	1	19.8	47.6					50	50	47	160	48.6	50	50	48	164					
460-3-60	6.3	55	10	6.2	41	10	2.9	3.6	0.5	8.6	12846	27.8	1	33.4	64.6	70	70	63	173	65.6	70	70	64	178	
			13346	33	1	39.7	72.4					80	80	70	180	73.4	80	80	80	71	184				
			14246	41.7	2	50.2	69.9					70	70	63	173	71.2	80	80	80	64	178				
			None	-	-	-	-					18.7	20	20	20	105	19.5	20	20	21	107				
			11758	17	1	16.4	39.2					40	40	39	121	40	40	40	40	40	125				
575-3-60	6	41	9	4.8	33	8	2.2	2.5	0.4	8.6	13458	34	1	32.7	59.6	60	60	57	137	60.4	70	70	58	141	

1. Minimum Circuit Ampacity.
2. Dual Element, Time Delay Type.
3. HACR type per NEC.
4. Non-fused Disconnect, Verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

XYE04-09 Medium Indoor Blower - Without Powered Convenience Outlet

Size (Tons)	Nominal Unit Voltage	Compressor 1			Compressor 2			OD Fan Motors (each)	Supply Blower Motor	Pwr Exh Motor	Pwr Conv Outlet	Electric Heat Field Installed Kit 2EK045*				MCA ¹ (Amp s)	Min Fuse ² / Breaker ³ Size (Amps)	Max Fuse ² / Breaker ³ Size (Amps)	Min Disconnect Rating ⁴		MCA ¹ w/Pwr Exh (Amp s)	Min Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Max Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Min Disconnect Rating ⁴ / Pwr Exh			
		Model	kW	Stages	Amps							FLA	LRA	FLA	LRA				FLA								
		RLA	LRA	MCC	RLA	LRA	MCC					FLA	LRA	FLA	LRA				FLA								
04 (3)	208-1-60	15.4	83.9	24				2.3	7.6	1.5		None	-	-	-	29.2	30	40	29	122	30.7	35	45	31	125		
		10625	4.9	1	23.6	58.7	60					10625	6.5	1	27.1	62.5	70	70	60	152	63.8	70	70	58	149		
		11125	7.9	1	38	76.7	80					11125	10.5	1	43.8	83.4	90	90	79	168	84.7	90	80	75	163		
	230-1-60	15.4	83.9	24				2.3	7	1.3		None	-	-	-	28.6	30	40	28	124	29.9	30	45	30	127		
		10625	6.5	1	27.1	62.5	70					10625	9.2	1	31.6	75.5	80	80	36	114	38.6	40	45	37	116		
		11125	10.5	1	43.8	83.4	90					11125	12.9	1	47.9	97.9	100	100	46	122	49	50	50	47	125		
	208-3-60	10.4	73	16				2.3	5.2	1.1		None	-	-	-	20.5	25	30	21	100	21.6	25	30	22	103		
		10625	4.9	1	13.6	37.5	40					10625	6.5	1	15.6	40	40	40	39	119	41	45	45	40	121		
		11125	7.9	1	21.9	47.9	50					11125	10.5	1	25.3	52.1	60	60	50	128	53.1	60	60	51	131		
	230-3-60	10.4	73	16				2.3	5.2	1		None	-	-	-	38.5	68.6	70	70	65	142	69.6	70	70	66	144	
		10625	6.5	1	15.6	40	40					10625	10.5	1	25.3	52.1	60	60	50	128	53.1	60	60	51	131		
		11125	12.9	1	33.3	62.1	70					11125	16	1	38.5	68.6	70	70	65	142	69.6	70	70	66	144		
	460-3-60	5.8	38	9				1.3	2.6	0.5		None	-	-	-	11.2	15	15	11	53	11.7	15	15	12	55		
		10646	6	1	7.2	20.2	25					10646	11.5	1	13.8	28.5	30	30	27	67	29	30	30	28	68		
		11146	11.5	1	13.8	28.5	30					11146	14	1	16.8	32.2	35	35	30	70	32.7	35	35	31	71		
	575-3-60	3.8	36.5	6				1.1	2	0.4		None	-	-	-	7.9	15	15	8	49	8.3	15	15	8	50		
		11058	9.2	1	8.9	19	20					11058	13.8	1	13.3	24.5	25	25	23	62	24.9	25	25	24	63		
		11458	13.8	1	13.3	24.5	25					11458	19.6	130	31				None	-	-	34.4	35	50	34	168	35.9
	208-1-60	19.6	130	31				2.3	7.6	1.5		10625	4.9	1	23.6	63.9	70	70	61	191	65.4	70	70	63	195		
		11125	7.9	1	38	81.9	90					11125	10.5	1	43.8	88.6	90	90	78	206	83.4	90	90	79	209		
		10625	6.5	1	27.1	67.7	70					10625	9.2	1	13.6	41.6	45	50	33	171	35.1	40	50	35	173		
	230-1-60	19.6	130	31				2.3	7	1.3		None	-	-	-	33.8	35	50	33	171	35.1	40	50	35	173		
		11125	10.5	1	43.8	88.6	90					11125	13.8	1	13.3	24.5	25	25	23	62	24.9	25	25	24	63		
		10625	4.9	1	13.6	41.6	45					10625	16.2	1	23.6	63.9	70	70	61	191	65.4	70	70	63	195		
	208-3-60	13.7	83.1	21				2.3	5.2	1.1		None	-	-	-	24.6	25	35	24	110	25.7	30	35	26	113		
		10625	6.5	1	15.6	44.1	45					10625	9.2	1	13.6	41.6	45	50	40	124	42.7	45	50	41	126		
		11125	7.9	1	21.9	52	60					11125	10.5	1	25.3	56.2	60	60	50	132	53.1	60	60	51	135		
	230-3-60	13.7	83.1	21				2.3	5.2	1		None	-	-	-	33.8	35	50	33	171	35.1	40	50	43	131		
		11125	10.5	1	43.8	88.6	90					11125	16	1	38.5	72.7	80	80	69	152	73.7	80	80	60	154		
		10625	6.5	1	15.6	44.1	45					10625	9.2	1	13.6	41.6	45	50	42	129	45.1	50	50	43	131		
	460-3-60	6.2	41	10				1.3	2.6	0.5		None	-	-	-	11.7	15	15	12	56	12.2	15	15	12	58		
		10646	6	1	7.2	20.7	25					10646	11.5	1	13.8	29	30	30	27	70	29.5	30	30	28	71		
		11146	11.5	1	13.8	29	30					11146	14	1	16.8	32.7	35	35	31	73	33.2	35	35	32	74		
	575-3-60	4.8	33	8				1.1	2	0.4		None	-	-	-	9.1	15	15	9	45	9.5	15	15	10	46		
		11058	9.2	1	8.9	20.2	25					11058	13.8	1	13.3	25.7	30	30	27	70	29.5	30	30	28	71		
		11458	13.8	1	13.3	25.7	30					11458	19.6	130	31				None	-	-	9.1	15	15	9	45	9.5

XYE04-09 Medium Indoor Blower - With Powered Convenience Outlet

Size (Tons)	Nominal Unit Voltage	Compressor 1			Compressor 2			OD Fan Motors (each)	Supply Blower Motor	Pwr Exh Motor	Pwr Conv Outlet	Electric Heat Field Installed Kit 2EK045*				MCA ¹ (Amps)	Min Fuse ² / Breaker ³ Size (Amps)	Max Fuse ² / Breaker ³ Size (Amps)	Min Discon- nect Rating ⁴		MCA ¹ w/Pwr Exh (Amps)	Min Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Max Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Min Discon- nect Rating ⁴ / Pwr Exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps		FLA	LRA			FLA	LRA			
		RA	LA	RA	RA	LA	RA					RA	RA	RA	RA		RA	RA			RA	RA			
04 (3)	208-1-60	15.4	83.9	24				2.3	7.6	1.5	8.6	None	-	-	-	33.5	35	45	34	126	35	35	50	36	129
												10625	4.9	1	23.6	63	70	70	61	150	64.5	70	70	63	153
												11125	7.9	1	38	81	90	90	78	164	82.5	90	90	79	167
	230-1-60	15.4	83.9	24				2.3	7	1.3	8.6	None	-	-	-	32.9	35	45	33	129	34.2	35	45	35	132
												10625	6.5	1	27.1	66.8	70	70	65	156	68.1	70	70	66	159
												11125	10.5	1	43.8	87.7	90	90	84	173	89	90	90	85	175
	208-3-60	10.4	73	16				2.3	5.2	1.1	8.6	None	-	-	-	24.8	25	35	26	105	25.9	30	35	27	107
												10625	4.9	1	13.6	41.8	45	45	41	118	42.9	45	45	42	121
												11125	7.9	1	21.9	52.2	60	60	51	126	53.3	60	60	52	129
	230-3-60	10.4	73	16				2.3	5.2	1	8.6	11625	12	1	33.3	66.4	70	70	64	138	67.5	70	70	65	140
												10625	6.5	1	15.6	44.3	45	50	43	123	45.3	50	50	45	125
												11125	10.5	1	25.3	56.4	60	60	55	133	57.4	60	60	56	135
05 (4)	460-3-60	5.8	38	9				1.3	2.6	0.5	8.6	None	-	-	-	13.4	15	15	14	56	13.9	15	15	14	57
												10646	6	1	7.2	22.4	25	25	22	63	22.9	25	25	23	64
												11146	11.5	1	13.8	30.7	35	35	30	69	31.2	35	35	30	70
	575-3-60	3.8	36.5	6				1.1	2	0.4	8.6	None	-	-	-	9.6	15	15	10	51	10	15	15	10	51
												11058	9.2	1	8.9	20.7	25	25	20	59	21.1	25	25	21	60
												11458	13.8	1	13.3	26.2	30	30	25	64	26.6	30	30	26	65
	208-1-60	19.6	130	31				2.3	7.6	1.5	8.6	None	-	-	-	38.7	40	50	39	172	40.2	45	50	41	176
												10625	4.9	1	23.6	68.2	70	80	66	196	69.7	70	80	68	199
												11125	7.9	1	38	86.2	90	90	83	210	87.7	90	90	84	214
	230-1-60	19.6	130	31				2.3	7	1.3	8.6	None	-	-	-	38.1	40	50	38	175	39.4	40	50	40	178
												10625	6.5	1	27.1	72	80	80	69	202	73.3	80	80	71	205
												11125	10.5	1	43.8	92.9	100	100	89	219	94.2	100	100	90	222
05 (4)	208-3-60	13.7	83.1	21				2.3	5.2	1.1	8.6	None	-	-	-	28.9	30	40	29	115	30	30	40	31	117
												10625	4.9	1	13.6	45.9	50	50	45	128	47	50	50	46	131
												11125	7.9	1	21.9	56.3	60	60	55	137	57.4	60	60	56	139
	230-3-60	13.7	83.1	21				2.3	5.2	1	8.6	11625	12	1	33.3	70.5	80	80	68	148	71.6	80	80	69	150
												10625	6.5	1	15.6	48.4	50	50	47	133	49.4	50	50	48	135
												11125	10.5	1	25.3	60.5	70	70	58	143	61.5	70	70	60	145
	460-3-60	6.2	41	10				1.3	2.6	0.5	8.6	None	-	-	-	13.9	15	20	14	59	14.4	15	20	15	60
												10646	6	1	7.2	22.9	25	25	22	66	23.4	25	25	23	67
												11146	11.5	1	13.8	31.2	35	35	30	72	31.7	35	35	31	73
	575-3-60	4.8	33	8				1.1	2	0.4	8.6	11446	14	1	16.8	34.9	35	35	33	75	35.4	40	40	34	76
												11058	9.2	1	8.9	21.9	25	25	21	56	22.3	25	25	22	57
												11458	13.8	1	13.3	27.4	30	30	26	60	27.8	30	30	27	61

XYE04-09 High Indoor Blower - Without Powered Convenience Outlet (Continued)

Size (Tons)	Nominal Unit Voltage	Compressor 1			Compressor 2			OD Fan Motors (each)	Supply Blower Motor	Pwr Exh Motor	Pwr Conv Outlet	Electric Heat Field Installed Kit 2EK045*			MCA ¹ (Amps)	Min Fuse ² / Breaker ³ Size (Amps)	Max Fuse ² / Breaker ³ Size (Amps)	Min Disconnect Rating ⁴	MCA ¹ w/Pwr Exh (Amp s)	Min Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Max Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Min Disconnect Rating ⁴ / Pwr Exh				
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps				FLA	LRA						
With VFD																										
08 (7.5)	208-3-60	13.8	83.1	22	13.6	83.1	21	5.8	9.9	1.1		None	-	-	-	46.6	50	60	50	261	48.8	50	60	52	271	
												11725	12	1	33.3	88.2	90	90	88	294	90.4	100	100	90	304	
												12525	18.6	1	51.6	111.1	125	125	109	312	113.3	125	125	125	111	322
												13225	24	1	66.6	129.9	150	150	126	327	132.1	150	150	150	129	337
												14225	31.8	2	88.3	122.8	125	125	118	320	125.5	150	150	150	120	330
	230-3-60	13.8	83.1	22	13.6	83.1	21	5.2	9.4	1		None	-	-	-	45.5	50	50	48	266	47.5	50	60	51	270	
												11725	16	1	38.5	93.6	100	100	93	304	95.6	100	100	95	314	
												12525	24.8	1	59.7	120.1	125	125	117	326	122.1	125	125	125	119	335
												13225	32	1	77	141.8	150	150	137	343	143.8	150	150	150	139	352
	460-3-60	6.2	41	10	6.1	41	10	2.9	4.7	0.5		None	-	-	-	21.5	25	25	23	133	22.5	25	25	24	136	
												11746	16.5	1	19.8	46.3	50	50	46	153	47.3	50	50	47	158	
												12846	27.8	1	33.4	63.3	70	70	61	167	64.3	70	70	70	62	171
												13346	33	1	39.7	71.1	80	80	69	173	72.1	80	80	80	70	177
	575-3-60	4.9	33	8	4.2	33	7	2.2	4.3	0.4		None	-	-	-	16.8	20	20	18	117	17.6	20	20	19	119	
												11758	17	1	16.4	37.3	40	40	37	134	38.1	40	40	40	38	137
												13458	34	1	32.7	57.7	60	60	56	150	58.5	60	60	60	56	154
												None	-	-	-	47.5	50	60	50	276	49.7	50	60	53	286	
09 (8.5)	208-3-60	14.5	98	23	13.7	83.1	21	5.8	9.9	1.1		None	-	-	-	47.5	50	60	50	276	49.7	50	60	53	286	
												11725	12	1	33.3	89.1	90	90	89	309	91.3	100	100	91	319	
												12525	18.6	1	51.6	112	125	125	110	327	114.2	125	125	125	112	337
												13225	24	1	66.6	130.8	150	150	127	342	133	150	150	150	130	352
	230-3-60	14.5	98	23	13.7	83.1	21	5.2	9.4	1		None	-	-	-	46.4	50	60	49	281	48.4	50	60	52	285	
												11725	16	1	38.5	94.5	100	100	93	319	96.5	100	100	96	328	
												12525	24.8	1	59.7	121	125	125	118	340	123	125	125	120	350	
												13225	32	1	77	142.7	150	150	138	358	144.7	150	150	150	140	367
	460-3-60	6.3	55	10	6.2	41	10	2.9	4.7	0.5		None	-	-	-	21.7	25	25	23	147	22.7	25	25	24	150	
												11746	16.5	1	19.8	46.5	50	50	46	167	47.5	50	50	47	172	
												12846	27.8	1	33.4	63.5	70	70	62	181	64.5	70	70	63	185	
												13346	33	1	39.7	71.3	80	80	69	187	72.3	80	80	70	63	185
	575-3-60	6	41	9	4.8	33	8	2.2	4.3	0.4		None	-	-	-	18.8	20	20	20	125	19.6	20	20	21	127	
												11758	17	1	16.4	39.3	40	40	39	142	40.1	45	45	40	40	145
												13458	34	1	32.7	59.7	60	60	58	158	60.5	70	70	58	58	162

1. Minimum Circuit Ampacity.
2. Dual Element, Time Delay Type.
3. HACR type per NEC.
4. Non-fused Disconnect, Verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

XYE04-09 High Indoor Blower - With Powered Convenience Outlet

Size (Tons)	Nominal Unit Voltage	Compressor 1			Compressor 2			OD Fan Motors (each)	Supply Blower Motor	Pwr Exh Motor	Pwr Conv Outlet	Electric Heat Field Installed Kit 2EK045*				MCA ¹ (Amps)	Min Fuse ² / Breaker ³ Size (Amps)	Max Fuse ² / Breaker ³ Size (Amps)	Min Disconnect Rating ⁴	MCA ¹ w/Pwr Exh (Amp s)	Min Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Max Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Min Disconnect Rating ⁴ / Pwr Exh			
		Model	kW	Stages	Amps	FLA	LRA																			
		RLA	LRA	MCC	RLA	LRA	MCC					FLA	LRA	FLA	LRA											
04 (3)	208-3-60	10.4	73	16				2.3	5.2	1.1	8.6	None	-	-	-	24.8	25	35	26	105	25.9	30	35	27	107	
		10625	4.9	1	13.6	41.8	45					10625	6.5	1	15.6	44.3	45	50	43	123	45.3	50	50	45	121	
		11125	7.9	1	21.9	52.2	60					11125	10.5	1	25.3	56.4	60	60	55	133	57.4	60	60	56	129	
		11625	12	1	33.3	66.4	70					11625	16	1	38.5	72.9	80	80	70	146	73.9	80	70	70	65	140
	230-3-60	10.4	73	16				2.3	5.2	1	8.6	None	-	-	-	24.8	25	35	26	107	25.8	30	35	27	110	
		10625	6.5	1	15.6	44.3	45					10625	10.5	1	25.3	56.4	60	60	55	133	57.4	60	60	56	135	
		11125	10.5	1	25.3	56.4	60					11125	16	1	38.5	72.9	80	80	70	146	73.9	80	80	71	148	
		11625	16	1	38.5	72.9	80					11625	None	-	-	-	13.4	15	15	14	56	13.9	15	15	14	57
	460-3-60	5.8	38	9				1.3	2.6	0.5	8.6	10646	6	1	7.2	22.4	25	25	22	63	22.9	25	25	23	64	
		11146	11.5	1	13.8	30.7	35					11146	14	1	16.8	34.4	35	35	30	69	31.2	35	35	30	70	
		11446	14	1	16.8	34.4	35					11446	None	-	-	-	9.6	15	15	10	51	10	15	15	10	51
		11508	9.2	1	8.9	20.7	25					11508	11.8	1	13.3	26.2	30	30	25	64	26.6	30	30	26	65	
05 (4)	208-3-60	3.8	36.5	6				1.1	2	0.4	8.6	11458	9.2	1	8.9	20.7	25	25	20	59	21.1	25	25	21	60	
		11508	9.2	1	8.9	20.7	25					11508	13.8	1	13.3	26.2	30	30	25	64	26.6	30	30	26	65	
		11625	12	1	33.3	70.5	80					11625	None	-	-	-	28.9	30	40	29	115	30	30	40	31	117
		10625	4.9	1	13.6	45.9	50					10625	16	1	38.5	72.9	80	80	68	148	71.6	80	80	69	150	
	230-3-60	13.7	83.1	21				2.3	5.2	1.1	8.6	10646	6.5	1	15.6	48.4	50	50	47	133	49.4	50	50	48	135	
		11125	7.9	1	21.9	56.3	60					11125	16	1	38.5	77	80	80	74	156	78	80	80	75	158	
		11625	16	1	38.5	77	80					11625	None	-	-	-	28.9	30	40	29	117	29.9	30	40	30	120
		11146	11.5	1	13.8	31.2	35					11146	14	1	16.8	34.9	35	35	30	72	31.7	35	35	31	73	
	460-3-60	6.2	41	10				1.3	2.6	0.5	8.6	10646	6	1	7.2	22.9	25	25	22	66	23.4	25	25	23	67	
		11146	11.5	1	13.8	31.2	35					11146	14	1	16.8	34.9	35	35	30	75	35.4	40	40	34	76	
		11446	14	1	16.8	34.9	35					11446	None	-	-	-	10.8	15	15	11	47	11.2	15	15	12	48
		11508	9.2	1	8.9	21.9	25					11508	11.8	1	13.3	27.4	30	30	21	56	22.3	25	25	22	57	
06 (5)	208-3-60	4.8	33	8				1.1	2	0.4	8.6	11458	9.2	1	8.9	21.9	25	25	21	56	22.3	25	25	22	61	
		11508	9.2	1	8.9	21.9	25					11508	13.8	1	13.3	27.4	30	30	26	60	27.8	30	30	27	61	
		11625	12	1	33.3	77.1	80					11625	None	-	-	-	35.5	40	50	36	196	36.6	40	50	37	198
		10625	4.9	1	13.6	52.5	60					10625	16	1	38.5	82.9	90	90	75	229	78.2	80	80	76	232	
	230-3-60	16	110	25				2.3	8.2	1	8.6	11125	7.9	1	21.9	62.9	70	70	61	218	64	70	70	63	220	
		11625	12	1	33.3	77.1	80					11625	None	-	-	-	34.8	35	50	35	198	35.8	40	50	37	201
		10625	6.5	1	15.6	54.3	60					10625	16	1	38.5	82.9	90	90	65	224	67.4	70	70	66	226	
		11125	10.5	1	25.3	66.4	70					11125	16	1	38.5	82.9	90	90	80	237	83.9	90	90	90	81	239
	460-3-60	7.8	52	12				1.3	4.1	0.5	8.6	10646	6	1	7.2	26.4	30	30	26	99	26.9	30	30	27	100	
		11146	11.5	1	13.8	34.7	35					11146	14	1	16.8	38.4	40	40	34	105	35.2	40	40	34	106	
		11446	14	1	16.8	38.4	40					11446	None	-	-	-	17.4	20	25	18	92	17.9	20	25	18	93
		11508	13.8	1	13.3	29.7	30					11508	12	1	22.1	40.7	45	45	39	91	41.1	45	45	39	92	
	575-3-60	5.7	38.9	9				1.1	3.2	0.4	8.6	11458	13.8	1	13.3	29.7	30	30	29	82	30.1	35	35	29	83	
		12358	23	1	22.1	40.7	45					12358	None	-	-	-	13.1	15	15	13	69	13.5	15	15	14	70
		11625	23	1	22.1	40.7	45					11625	None	-	-	-	13.1	15	15	13	69	13.5	15	15	14	70
		11446	23	1	22.1	40.7	45					11446	None	-	-	-	13.1	15	15	13	69	13.5	15	15	14	70

XYE04-09 High Indoor Blower - With Powered Convenience Outlet (Continued)

Size (Tons)	Nominal Unit Voltage	Compressor 1			Compressor 2			OD Fan Motors (each)	Supply Blower Motor	Pwr Exh Motor	Pwr Conv Outlet	Electric Heat Field Installed Kit 2EK045*				MCA ¹ (Amps)	Min Fuse ² / Breaker ³ Size (Amps)	Max Fuse ² / Breaker ³ Size (Amps)	Min Disconnect Rating ⁴	MCA ¹ w/Pwr Exh (Amp s)	Min Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Max Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Min Disconnect Rating ⁴ / Pwr Exh		
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps		FLA	LRA							
		RA	LRA																						
07 (6)	208-3-60	19.6	136	31				2.3	10.2	1.1	8.6	None	-	-	-	43.6	45	60	45	223	45.8	50	60	47	233
		10725	4.9	1	13.6	60.6	70					60	236	62.8	70		70	70	63	246					
		11725	12	1	33.3	85.2	90					90	256	87.4	90		90	90	85	266					
		12525	18.6	1	51.6	108.1	110					110	274	110.3	125		125	125	125	106	284				
	230-3-60	19.6	136	31				2.3	10.2	1	8.6	None	-	-	-	43.6	45	60	45	229	45.6	50	60	47	224
		10725	6.5	1	15.6	63.1	70					70	62	245	65.1		70	80	65	254					
		11725	16	1	38.5	91.7	100					100	89	268	93.7		100	100	91	277					
		12525	24.8	1	59.7	118.2	125					125	113	289	120.2		125	125	125	115	298				
	460-3-60	8.2	66.1	13				1.3	4.8	0.5	8.6	None	-	-	-	19.9	20	25	20	114	20.9	25	25	22	111
		10746	6	1	7.2	28.9	30					30	35	29	122	29.9	30	35	30	126					
		11746	16.5	1	19.8	44.7	45					45	43	134	45.7	50	50	44	139						
		12646	25.5	1	30.7	58.3	60					60	56	145	59.3	60	60	57	149						
	575-3-60	6.6	55.3	10				1.1	3.4	0.4	8.6	None	-	-	-	15.6	20	20	16	94	16.4	20	20	17	91
		11758	17	1	16.4	36.1	40					40	40	35	110	36.9	40	40	40	114					
		12658	25.7	1	24.7	46.5	50					50	44	119	47.3	50	50	45	122						
08 (7.5)	208-3-60	13.8	83.1	22	13.6	83.1	21	5.8	10.2	1.1	8.6	None	-	-	-	51.2	60	60	55	256	53.4	60	60	57	266
		11725	12	1	33.3	92.8	100					100	93	289	95		100	100	96	299					
		12525	18.6	1	51.6	115.7	125					125	114	307	117.9		125	125	117	317					
		13225	24	1	66.6	134.5	150					150	131	322	136.7		150	150	134	332					
	230-3-60	13.8	83.1	22	13.6	83.1	21	5.2	10.2	1	8.6	None	-	-	-	50.6	60	60	54	259	52.6	60	60	56	263
		11725	16	1	38.5	98.7	100					100	98	297	100.7		110	110	101	306					
		12525	24.8	1	59.7	125.2	150					150	123	318	127.2		150	150	125	327					
		13225	32	1	77	146.9	150					150	143	336	148.9		150	150	145	345					
	460-3-60	6.2	41	10	6.1	41	10	2.9	4.8	0.5	8.6	None	-	-	-	23.8	25	25	26	130	24.8	25	25	27	132
		11746	16.5	1	19.8	48.6	50					50	48	149	49.6		50	50	49	154					
		12846	27.8	1	33.4	65.6	70					70	64	163	66.6		70	70	65	167					
		13346	33	1	39.7	73.4	80					80	71	169	74.4		80	80	72	174					
	575-3-60	4.9	33	8	4.2	33	7	2.2	3.4	0.4	8.6	None	-	-	-	17.6	20	20	19	107	18.4	20	20	20	108
		11758	17	1	16.4	38.1	40					40	38	123	38.9		40	40	39	127					
		13458	34	1	32.7	58.5	60					60	56	139	59.3		60	60	57	143					
09 (8.5)	208-3-60	14.5	98	23	13.7	83.1	21	5.8	10.2	1.1	8.6	None	-	-	-	52.1	60	60	56	271	54.3	60	60	58	281
		11725	12	1	33.3	93.7	100					100	94	304	95.9		100	100	97	314					
		12525	18.6	1	51.6	116.6	125					125	115	322	118.8		125	125	118	332					
		13225	24	1	66.6	135.4	150					150	132	337	137.6		150	150	135	347					
	230-3-60	14.5	98	23	13.7	83.1	21	5.2	10.2	1	8.6	None	-	-	-	51.5	60	60	55	273	53.5	60	60	57	278
		11725	16	1	38.5	99.6	100					100	99	312	101.6		110	110	102	321					
		12525	24.8	1	59.7	126.1	150					150	124	333	128.1		150	150	126	342					
		13225	32	1	77	147.8	150					150	144	350	149.8		150	150	146	360					
	460-3-60	6.3	55	10	6.2	41	10	2.9	4.8	0.5	8.6	None	-	-	-	24	25	25	26	144	25	25	25	27	146
		11746	16.5	1	19.8	48.8	50					50	50	49	163	49.8	50	50	50	168					
		12846	27.8	1	33.4	65.8	70					70	64	177	66.8	70	70	65	181						
	575-3-60	6	41	9	4.8	33	8	2.2	3.4	0.4	8.6	None	-	-	-	19.6	20	25	21	115	20.4	25	25	22	116
		11758	17	1	16.4	40.1	45					45	45	40	131	40.9	45	45	45	135					
		13458	34	1	32.7	60.5	70					70	58	147	61.3	70	70	59	151						

XYE04-09 High Indoor Blower - With Powered Convenience Outlet (Continued)

Size (Tons)	Nominal Unit Voltage	Compressor 1			Compressor 2			OD Fan Motors (each)	Supply Blower Motor	Pwr Exh Motor	Pwr Conv Outlet	Electric Heat Field Installed Kit 2EK045*			MCA ¹ (Amps)	Min Fuse ² / Breaker ³ Size (Amps)	Max Fuse ² / Breaker ³ Size (Amps)	Min Disconnect Rating ⁴	MCA ¹ w/Pwr Exh (Amp s)	Min Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Max Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Min Disconnect Rating ⁴ / Pwr Exh			
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps				FLA	LRA					
With VFD																									
08 (7.5)	208-3-60	13.8	83.1	22	13.6	83.1	21	5.8	9.9	1.1	8.6	None	-	-	-	50.9	60	60	55	265	53.1	60	60	57	275
												11725	12	1	33.3	92.5	100	100	93	298	94.7	100	100	95	308
												12525	18.6	1	51.6	115.4	125	125	114	317	117.6	125	125	125	327
												13225	24	1	66.6	134.2	150	150	131	332	136.4	150	150	150	342
	230-3-60	13.8	83.1	22	13.6	83.1	21	5.2	9.4	1	8.6	None	-	-	-	49.8	50	60	53	270	51.8	60	60	56	275
												11725	16	1	38.5	97.9	100	100	98	309	99.9	100	100	100	318
												12525	24.8	1	59.7	124.4	125	125	122	330	126.4	150	150	150	339
												13225	32	1	77	146.1	150	150	142	347	148.1	150	150	150	356
	460-3-60	6.2	41	10	6.1	41	10	2.9	4.7	0.5	8.6	None	-	-	-	23.7	25	25	25	135	24.7	25	25	27	138
												11746	16.5	1	19.8	48.5	50	50	48	155	49.5	50	50	49	160
												12846	27.8	1	33.4	65.5	70	70	64	169	66.5	70	70	70	173
												13346	33	1	39.7	73.3	80	80	71	175	74.3	80	80	80	180
	575-3-60	4.9	33	8	4.2	33	7	2.2	4.3	0.4	8.6	None	-	-	-	18.5	20	20	20	119	19.3	20	20	21	121
												11758	17	1	16.4	39	40	40	39	135	39.8	40	40	40	139
												13458	34	1	32.7	59.4	60	60	58	152	60.2	70	70	70	155
												None	-	-	-	51.8	60	60	55	280	54	60	60	58	290
09 (8.5)	208-3-60	14.5	98	23	13.7	83.1	21	5.8	9.9	1.1	8.6	None	-	-	-	51.8	60	60	55	280	54	60	60	58	290
												11725	12	1	33.3	93.4	100	100	94	313	95.6	100	100	96	323
												12525	18.6	1	51.6	116.3	125	125	115	332	118.5	125	125	125	342
												13225	24	1	66.6	135.1	150	150	132	347	137.3	150	150	150	357
	230-3-60	14.5	98	23	13.7	83.1	21	5.2	9.4	1	8.6	None	-	-	-	50.7	60	60	54	285	52.7	60	60	56	290
												11725	16	1	38.5	98.8	100	100	98	324	100.8	110	110	101	333
												12525	24.8	1	59.7	125.3	150	150	123	345	127.3	150	150	150	354
												13225	32	1	77	147	150	150	143	362	149	150	150	150	371
	460-3-60	6.3	55	10	6.2	41	10	2.9	4.7	0.5	8.6	None	-	-	-	23.9	25	30	26	149	24.9	25	30	27	152
												11746	16.5	1	19.8	48.7	50	50	48	169	49.7	50	50	50	174
												12846	27.8	1	33.4	65.7	70	70	64	183	66.7	70	70	70	187
												13346	33	1	39.7	73.5	80	80	71	189	74.5	80	80	80	194
	575-3-60	6	41	9	4.8	33	8	2.2	4.3	0.4	8.6	None	-	-	-	20.5	25	25	22	127	21.3	25	25	23	129
												11758	17	1	16.4	41	45	45	41	143	41.8	45	45	45	147
												13458	34	1	32.7	61.4	70	70	59	160	62.2	70	70	70	163

1. Minimum Circuit Ampacity.
2. Dual Element, Time Delay Type.
3. HACR type per NEC.
4. Non-fused Disconnect, Verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

XXEA7-12 Standard Indoor Blower - Without Powered Convenience Outlet

Size (Tons)	Nominal Unit Voltage	Compressor 1		Compressor 2		OD Fan Motors (each)	Supply Blower Motor	Pwr Exh Motor	Pwr Conv Outlet	Electric Heat Field Installed Kit 2EK045*			MCA ¹ (Amps)	Min Fuse ² / Breaker ³ Size (Amps)	Max Fuse ² / Breaker ³ Size (Amps)	Min Discon- nect Rating ⁴		MCA ¹ w/Pwr Exh (Amps)	Min Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Max Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Min Discon- nect Rating ⁴ / Pwr Exh				
		RLA	LRA	MCC	RLA	LRA	MCC	Model	kW	Stages	Amps	FLA	LRA	FLA	LRA	FLA	LRA	FLA	LRA	FLA	LRA				
A7 (6)	208-3-60	17.6	136	27				2.3	5.2	1.1		None	-	-	-	29.5	30	45	29	163	30.6	35	45	30	166
												10625	4.9	1	13.6	46.5	50	60	45	177	47.6	50	60	46	179
												11125	7.9	1	21.9	56.9	60	60	54	185	58	60	70	55	188
												11625	12	1	33.3	71.1	80	80	67	197	72.2	80	80	68	199
	230-3-60	17.6	136	27				2.3	5.2	1		None	-	-	-	29.5	30	45	29	166	30.5	35	45	30	168
												10625	6.5	1	15.6	49	50	60	47	182	50	50	60	48	184
												11125	10.5	1	25.3	61.1	70	70	58	191	62.1	70	70	59	194
												11625	16	1	38.5	77.6	80	80	73	205	78.6	80	80	74	207
	460-3-60	8.5	66.1	13				1.3	2.6	0.5		None	-	-	-	14.5	15	20	14	82	15	15	20	15	83
												10646	6	1	7.2	23.5	25	30	23	89	24	25	30	23	90
												11146	11.5	1	13.8	31.8	35	35	30	95	32.3	35	35	31	96
												11446	14	1	16.8	35.5	40	40	34	98	36	40	40	34	99
	575-3-60	6.3	55.3	10				1.1	2	0.4		None	-	-	-	11	15	15	11	68	11.4	15	15	11	69
08 (7.5)	208-3-60											None	-	-	-	40.9	45	50	43	198	43.1	45	50	46	203
												11725	12	1	33.3	82.5	90	90	81	232	84.7	90	90	84	237
												12525	18.6	1	51.6	105.4	110	110	102	250	107.6	110	110	105	255
												13225	24	1	66.6	124.2	125	125	120	265	126.4	150	150	122	270
												14225	31.8	2	88.3	116.9	125	125	111	257	119.6	125	125	114	262
	230-3-60											None	-	-	-	40.9	45	50	43	201	42.9	45	50	45	206
												11725	16	1	38.5	89	90	90	87	240	91	100	100	90	244
												12525	24.8	1	59.7	115.5	125	125	112	261	117.5	125	125	114	266
												13225	32	1	77	137.2	150	150	132	278	139.2	150	150	134	283
												14225	42.4	2	102	134	150	150	121	269	136.5	150	150	124	274
	460-3-60	6.2	41	10	6.2	41	10	1.3	2.6	0.5		None	-	-	-	19.2	20	25	20	100	20.2	25	25	21	103
												11746	16.5	1	19.8	44	45	45	43	120	45	45	45	44	122
												12846	27.8	1	33.4	61	70	70	59	134	62	70	70	60	136
												13346	33	1	39.7	68.8	70	70	66	140	69.8	70	70	67	142
	575-3-60	4.9	33	8	4.9	33	8	1.1	2	0.4		None	-	-	-	15.2	20	20	16	81	16	20	20	17	83
												11758	17	1	16.4	35.7	40	40	35	97	36.5	40	40	36	99
												13458	34	1	32.7	56.1	60	60	54	113	56.9	60	60	55	115
09 (8.5)	208-3-60											None	-	-	-	42.4	45	50	45	228	44.6	45	50	47	233
												11725	12	1	33.3	84	90	90	83	261	86.2	90	90	85	266
												12525	18.6	1	51.6	106.9	110	110	104	280	109.1	110	110	106	285
												13225	24	1	66.6	125.7	150	150	121	295	127.9	150	150	124	300
												14225	31.8	2	88.3	116.9	125	125	113	287	119.6	125	125	115	292
	230-3-60											None	-	-	-	42.4	45	50	45	231	44.4	45	50	47	236
												11725	16	1	38.5	90.5	100	100	89	270	92.5	100	100	91	274
												12525	24.8	1	59.7	117	125	125	113	291	119	125	125	116	295
												13225	32	1	77	138.7	150	150	133	308	140.7	150	150	135	313
												14225	42.4	2	102	134	150	150	123	299	136.5	150	150	125	304
	460-3-60											None	-	-	-	19.4	20	25	20	128	20.4	25	25	22	131
												11746	16.5	1	19.8	44.2	45	45	43	148	45.2	50	50	44	150
												12846	27.8	1	33.4	61.2	70	70	59	162	62.2	70	70	60	164
												13346	33	1	39.7	69	70	70	66	168	70	70	67	170	
												14246	41.7	2	50.2	66	70	70	59	162	67.3	70	70	60	164
	575-3-60	6	41	9	6	41	9	1.1	2	0.4		None	-	-	-	17.7	20	20	19	97	18.5	20	20	20	99
												11758	17	1	16.4	38.2	40	40	37	113	39	40	40	38	115
												13458	34	1	32.7	58.6	60	60	56	129	59.4	60	60	57	131

XXEA7-12 Standard Indoor Blower - Without Powered Convenience Outlet (Continued)

Size (Tons)	Nominal Unit Voltage	Compressor 1		Compressor 2		OD Fan Motors (each)	Supply Blower Motor	Pwr Exh Motor	Pwr Conv Outlet	Electric Heat Field Installed Kit 2EK045*				MCA ¹ (Amps)	Min Fuse ² / Breaker ³ Size (Amps)	Max Fuse ² / Breaker ³ Size (Amps)	Min Disconnect Rating ⁴	MCA ¹ w/Pwr Exh (Amps)	Min Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Max Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Min Disconnect Rating ⁴ / Pwr Exh						
		RLA	LRA	MCC	RLA	LRA	MCC			Model	kW	Stages	Amps				FLA	LRA									
With VFD																											
A7 (6)	208-3-60	17.6	136	27				2.3	7	1.1				None	-	-	-	31.3	35	45	31	201	32.4	35	50	32	203
											10625	4.9	1	13.6	48.3	50	60	47	215	49.4	50	60	48	217			
											11125	7.9	1	21.9	58.7	60	70	56	223	59.8	60	70	57	225			
											11625	12	1	33.3	72.9	80	80	69	234	74	80	80	70	237			
	230-3-60	17.6	136	27				2.3	7.2	1				None	-	-	-	31.5	35	45	31	203	32.5	35	50	32	205
											10625	6.5	1	15.6	51	60	60	49	218	52	60	60	50	221			
											11125	10.5	1	25.3	63.1	70	70	60	228	64.1	70	70	61	230			
											11625	16	1	38.5	79.6	80	80	75	241	80.6	90	90	77	244			
	460-3-60	8.5	66.1	13				1.3	7.2	0.5				None	-	-	-	15.5	20	20	15	100	16	20	20	16	101
											10646	6	1	7.2	24.5	25	30	24	107	25	25	30	24	108			
											11146	11.5	1	13.8	32.8	35	35	31	114	33.3	35	35	32	115			
	575-3-60	6.3	55.3	10				1.1	2.5	0.4				11446	14	1	16.8	36.5	40	40	35	117	37	40	40	35	118
08 (7.5)	208-3-60	13.8	83.1	22	13.8	83.1	22	2.3	7	1.1				None	-	-	-	11.5	15	15	11	75	11.9	15	15	12	76
											11725	12	1	33.3	84.3	90	90	83	269	86.5	90	90	86	274			
											12525	18.6	1	51.6	107.2	110	110	104	288	109.4	110	110	107	293			
											13225	24	1	66.6	126	150	150	122	303	128.2	150	150	124	308			
											14225	31.8	2	88.3	119.1	125	125	113	295	121.9	125	125	117	300			
	230-3-60	13.8	83.1	22	13.8	83.1	22	2.3	7.2	1				None	-	-	-	42.9	45	50	45	238	44.9	45	50	48	241
											11725	16	1	38.5	91	100	100	90	277	93	100	100	92	281			
											12525	24.8	1	59.7	117.5	125	125	114	298	119.5	125	125	116	302			
											13225	32	1	77	139.2	150	150	134	315	141.2	150	150	136	320			
	460-3-60	6.2	41	10	6.2	41	10	1.3	3.6	0.5				None	-	-	-	20.2	25	25	21	119	21.2	25	25	23	121
											11746	16.5	1	19.8	45	45	45	44	139	46	50	50	45	141			
											12846	27.8	1	33.4	62	70	70	60	152	63	70	70	61	154			
	575-3-60	4.9	33	8	4.9	33	8	1.1	2.5	0.4				None	-	-	-	15.7	20	20	17	88	16.5	20	20	18	90
											11758	17	1	16.4	36.2	40	40	36	105	37	40	40	36	107			
											13458	34	1	32.7	56.6	60	60	54	121	57.4	60	60	55	123			
09 (8.5)	208-3-60	14.5	98	23	14.5	98	23	2.3	7	1.1				None	-	-	-	44.2	45	50	47	266	46.4	50	50	49	271
											11725	12	1	33.3	85.8	90	90	85	299	88	90	90	88	304			
											12525	18.6	1	51.6	108.7	110	110	106	317	110.9	125	125	109	322			
											13225	24	1	66.6	127.5	150	150	123	332	129.7	150	150	126	337			
	230-3-60	14.5	98	23	14.5	98	23	2.3	7.2	1				None	-	-	-	44.4	45	50	47	268	46.4	50	60	49	272
											11725	16	1	38.5	92.5	100	100	91	306	94.5	100	100	93	311			
											12525	24.8	1	59.7	119	125	125	116	328	121	125	125	118	332			
											13225	32	1	77	140.7	150	150	135	345	142.7	150	150	138	349			
	460-3-60	6.3	55	10	6.3	55	10	1.3	3.6	0.5				None	-	-	-	20.4	25	25	22	147	21.4	25	25	23	149
											11746	16.5	1	19.8	45.2	50	50	44	167	46.2	50	50	46	169			
											12846	27.8	1	33.4	62.2	70	70	60	180	63.2	70	70	61	182			
	575-3-60	6	41	9	6	41	9	1.1	2.5	0.4				None	-	-	-	18.2	20	20	19	104	19	20	20	20	106
											11758	17	1	16.4	38.7	40	40	38	121	39.5	40	40	39	123			
											13458	34	1	32.7	59.1	60	60	57	137	59.9	60	60	58	139			

XXEA7-12 Standard Indoor Blower - Without Powered Convenience Outlet (Continued)

Size (Tons)	Nominal Unit Voltage	Compressor 1		Compressor 2		OD Fan Motors (each)	Supply Blower Motor	Pwr Exh Motor	Pwr Conv Outlet	Electric Heat Field Installed Kit 2EK045*				MCA ¹ (Amps)	Min Fuse ² / Breaker ³ Size (Amps)	Max Fuse ² / Breaker ³ Size (Amps)	Min Disconnect Rating ⁴	MCA ¹ w/Pwr Exh (Amps)	Min Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Max Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Min Disconnect Rating ⁴ / Pwr Exh				
		Model	kW	Stages	Amps					FLA	LRA														
		RLA	LRA	MCC	RLA	LRA	MCC	FLA	LRA	FLA	LRA														
12 (10)	208-3-60	15.6	110	24	16	110	25	5.8	7	1.1	None	-	-	-	48.4	50	60	51	302	50.6	60	60	54	307	
											11725	12	1	33.3	90	90	90	89	335	92.2	100	100	92	340	
											12525	18.6	1	51.6	112.9	125	125	110	354	115.1	125	125	113	359	
											13225	24	1	66.6	131.7	150	150	128	369	133.9	150	150	150	130	374
											14225	31.8	2	88.3	122.3	125	125	119	361	124.5	125	125	122	122	366
	230-3-60	15.6	110	24	16	110	25	5.2	7.2	1	None	-	-	-	48	50	60	51	301	50	50	60	53	305	
											11725	16	1	38.5	96.1	100	100	95	339	98.1	100	100	97	344	
											12525	24.8	1	59.7	122.6	125	125	119	361	124.6	125	125	122	365	
											13225	32	1	77	144.3	150	150	139	378	146.3	150	150	141	382	
											14225	42.4	2	102	136.5	150	150	129	369	139	150	150	150	131	374
	460-3-60	7.8	52	12	7.8	52	12	2.9	3.6	0.5	None	-	-	-	24.1	25	30	25	146	25.1	30	30	27	148	
											11746	16.5	1	19.8	48.9	50	50	48	166	49.9	50	50	49	168	
											12846	27.8	1	33.4	65.9	70	70	64	179	66.9	70	70	65	182	
											13346	33	1	39.7	73.7	80	80	71	186	74.7	80	80	72	188	
											14246	41.7	2	50.2	67.3	70	70	64	179	68.5	70	70	65	182	
	575-3-60	5.8	38.9	9	5.7	38.9	9	2.2	2.5	0.4	None	-	-	-	17.7	20	20	19	107	18.5	20	20	20	109	
											11758	17	1	16.4	38.2	40	40	37	123	39	40	40	38	125	
											13458	34	1	32.7	58.6	60	60	56	140	59.4	60	60	57	141	

1. Minimum Circuit Ampacity.
2. Dual Element, Time Delay Type.
3. HACR type per NEC.
4. Non-fused Disconnect, Verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

XXEA7-12 Standard Indoor Blower - With Powered Convenience Outlet

Size (Tons)	Nominal Unit Voltage	Compressor 1		Compressor 2		OD Fan Motors (each)	Supply Blower Motor	Pwr Exh Motor	Pwr Conv Outlet	Electric Heat Field Installed Kit 2EK045*			MCA ¹ (Amps)	Min Fuse ² / Breaker ³ Size (Amps)	Max Fuse ² / Breaker ³ Size (Amps)	Min Disconnect Rating ⁴		MCA ¹ w/Pwr Exh (Amps)	Min Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Max Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Min Disconnect Rating ⁴ / Pwr Exh				
		RLA	LRA	MCC	RLA	LRA	MCC	Model	kW	Stages	Amps	FLA	LRA	FLA	LRA	FLA	FLA	LRA	FLA	LRA					
A7 (6)	208-3-60	17.6	136	27		2.3	5.2	1.1	8.6	None	-	-	-	33.8	35	50	34	168	34.9	35	50	35	170		
										10625	4.9	1	13.6	50.8	60	60	49	181	51.9	60	60	51	184		
										11125	7.9	1	21.9	61.2	70	70	59	189	62.3	70	70	60	192		
										11625	12	1	33.3	75.4	80	80	72	201	76.5	80	80	73	203		
	230-3-60	17.6	136	27		2.3	5.2	1	8.6	None	-	-	-	33.8	35	50	34	170	34.8	35	50	35	173		
										10625	6.5	1	15.6	53.3	60	60	52	186	54.3	60	60	53	188		
										11125	10.5	1	25.3	65.4	70	70	63	196	66.4	70	70	64	198		
	460-3-60	8.5	66.1	13		1.3	2.6	0.5	8.6	None	-	-	-	16.7	20	25	17	84	17.2	20	25	17	85		
										10646	6	1	7.2	25.7	30	30	25	91	26.2	30	30	26	92		
										11146	11.5	1	13.8	34	35	35	33	97	34.5	35	35	33	99		
	575-3-60	6.3	55.3	10			1.1	2	0.4	8.6	None	-	-	12.7	15	15	13	69	13.1	15	15	13	70		
08 (7.5)	208-3-60	13.8	83.1	22	13.8	83.1	22	2.3	5.2	1.1	8.6	None	-	-	-	45.2	50	50	48	203	47.4	50	60	50	208
										11725	12	1	33.3	86.8	90	90	86	236	89	90	90	89	241		
										12525	18.6	1	51.6	109.7	110	110	107	254	111.9	125	125	110	259		
										13225	24	1	66.6	128.5	150	150	125	269	130.7	150	150	150	274		
	230-3-60	13.8	83.1	22	13.8	83.1	22	2.3	5.2	1	8.6	None	-	-	-	45.2	50	50	48	206	47.2	50	60	50	210
										11725	16	1	38.5	93.3	100	100	92	244	95.3	100	100	95	249		
										12525	24.8	1	59.7	119.8	125	125	117	265	121.8	125	125	119	270		
	460-3-60	6.2	41	10	6.2	41	10	1.3	2.6	0.5	8.6	None	-	-	-	21.4	25	25	23	102	22.4	25	25	24	105
										11746	16.5	1	19.8	46.2	50	50	46	122	47.2	50	50	47	124		
										12846	27.8	1	33.4	63.2	70	70	61	136	64.2	70	70	62	138		
	575-3-60	4.9	33	8	4.9	33	8	1.1	2	0.4	8.6	None	-	-	-	16.9	20	20	18	82	17.7	20	20	19	84
										11758	17	1	16.4	37.4	40	40	37	99	38.2	40	40	38	101		
										13458	34	1	32.7	57.8	60	60	56	115	58.6	60	60	57	117		
09 (8.5)	208-3-60	14.5	98	23	14.5	98	23	2.3	5.2	1.1	8.6	None	-	-	-	46.7	50	60	50	232	48.9	50	60	52	237
										11725	12	1	33.3	88.3	90	90	88	266	90.5	100	100	90	271		
										12525	18.6	1	51.6	111.2	125	125	109	284	113.4	125	125	111	289		
										13225	24	1	66.6	130	150	150	126	299	132.2	150	150	129	304		
	230-3-60	14.5	98	23	14.5	98	23	2.3	5.2	1	8.6	None	-	-	-	46.7	50	60	50	235	48.7	50	60	52	240
										11725	16	1	38.5	94.8	100	100	94	274	96.8	100	100	96	278		
										12525	24.8	1	59.7	121.3	125	125	118	295	123.3	125	125	121	300		
	460-3-60	6.3	55	10	6.3	55	10	1.3	2.6	0.5	8.6	None	-	-	-	21.6	25	25	23	130	22.6	25	25	24	133
										11746	16.5	1	19.8	46.4	50	50	46	150	47.4	50	50	47	152		
										12846	27.8	1	33.4	63.4	70	70	61	164	64.4	70	70	63	166		
	575-3-60	6	41	9	6	41	9	1.1	2	0.4	8.6	None	-	-	-	19.4	20	25	21	98	20.2	25	25	22	100
										11758	17	1	16.4	39.9	40	40	39	115	40.7	45	45	40	117		
										13458	34	1	32.7	60.3	70	70	58	131	61.1	70	70	59	133		

XXEA7-12 Standard Indoor Blower - With Powered Convenience Outlet (Continued)

Size (Tons)	Nominal Unit Voltage	Compressor 1		Compressor 2		OD Fan Motors (each)	Supply Blower Motor	Pwr Exh Motor	Pwr Conv Outlet	Electric Heat Field Installed Kit 2EK045*			MCA ¹ (Amps)	Min Fuse ² / Breaker ³ Size (Amps)	Max Fuse ² / Breaker ³ Size (Amps)	Min Disconnect Rating ⁴	MCA ¹ w/Pwr Exh (Amps)	Min Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Max Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Min Disconnect Rating ⁴ / Pwr Exh					
		RLA	LRA	MCC	RLA	LRA	MCC			Model	kW	Stages													
With VFD																									
A7 (6)	208-3-60	17.6	136	27		2.3	7	1.1	8.6	None	-	-	-	35.6	40	50	36	205	36.7	40	50	37	208		
										10625	4.9	1	13.6	52.6	60	60	52	219	53.7	60	60	53	221		
										11125	7.9	1	21.9	63	70	70	61	227	64.1	70	70	62	230		
										11625	12	1	33.3	77.2	80	80	74	239	78.3	80	80	75	241		
	230-3-60	17.6	136	27		2.3	7.2	1	8.6	None	-	-	-	35.8	40	50	36	207	36.8	40	50	37	209		
										10625	6.5	1	15.6	55.3	60	60	54	223	56.3	60	70	55	225		
										11125	10.5	1	25.3	67.4	70	70	65	232	68.4	70	70	66	235		
										11625	16	1	38.5	83.9	90	90	80	246	84.9	90	90	82	248		
	460-3-60	8.5	66.1	13		1.3	7.2	0.5	8.6	None	-	-	-	17.7	20	25	18	102	18.2	20	25	19	103		
										10646	6	1	7.2	26.7	30	30	26	109	27.2	30	30	27	110		
										11146	11.5	1	13.8	35	35	40	34	116	35.5	40	40	34	117		
										11446	14	1	16.8	38.7	40	40	37	119	39.2	40	40	38	120		
	575-3-60	6.3	55.3	10			1.1	2.5	0.4	8.6	None	-	-	-	13.2	15	15	13	77	13.6	15	15	14	78	
08 (7.5)	208-3-60	13.8	83.1	22	13.8	83.1	22	2.3	7	1.1	8.6	None	-	-	-	47	50	60	50	240	49.2	50	60	53	245
										11725	12	1	33.3	88.6	90	90	88	274	90.8	100	100	91	279		
										12525	18.6	1	51.6	111.5	125	125	109	292	113.7	125	125	112	297		
										13225	24	1	66.6	130.3	150	150	127	307	132.5	150	150	129	312		
	230-3-60	13.8	83.1	22	13.8	83.1	22	2.3	7.2	1	8.6	None	-	-	-	47.2	50	60	50	242	49.2	50	60	53	247
										11725	16	1	38.5	95.3	100	100	95	281	97.3	100	100	97	285		
										12525	24.8	1	59.7	121.8	125	125	119	302	123.8	125	125	121	307		
										13225	32	1	77	143.5	150	150	139	319	145.5	150	150	141	324		
	460-3-60	6.2	41	10	6.2	41	10	1.3	3.6	0.5	8.6	None	-	-	-	22.4	25	25	24	121	23.4	25	25	25	123
										11746	16.5	1	19.8	47.2	50	50	47	141	48.2	50	50	48	143		
										12846	27.8	1	33.4	64.2	70	70	62	154	65.2	70	70	63	156		
										13346	33	1	39.7	72	80	80	70	161	73	80	80	71	163		
	575-3-60	4.9	33	8	4.9	33	8	1.1	2.5	0.4	8.6	None	-	-	-	17.4	20	20	19	90	18.2	20	20	20	92
										11758	17	1	16.4	37.9	40	40	37	107	38.7	40	40	38	108		
										13458	34	1	32.7	58.3	60	60	56	123	59.1	60	60	57	125		
										None	-	-	-	48.5	50	60	52	270	50.7	60	60	54	275		
09 (8.5)	208-3-60	14.5	98	23	14.5	98	23	2.3	7	1.1	8.6	None	-	-	-	48.7	50	60	52	272	50.7	60	60	54	277
										11725	16	1	38.5	96.8	100	100	96	311	98.8	100	100	98	315		
	230-3-60	14.5	98	23	14.5	98	23	2.3	7.2	1	8.6	None	-	-	-	123.3	125	125	121	332	125.3	150	150	123	336
										12525	24.8	1	59.7	145	150	150	140	349	147	150	150	143	354		
	460-3-60	6.3	55	10	6.3	55	10	1.3	3.6	0.5	8.6	None	-	-	-	22.6	25	25	24	149	23.6	25	25	25	151
										11746	16.5	1	19.8	47.4	50	50	47	169	48.4	50	50	48	171		
										12846	27.8	1	33.4	64.4	70	70	63	182	65.4	70	70	64	184		
										13346	33	1	39.7	72.2	80	80	70	189	73.2	80	80	71	191		
	575-3-60	6	41	9	6	41	9	1.1	2.5	0.4	8.6	None	-	-	-	19.9	20	25	21	106	20.7	25	25	22	108
										11758	17	1	16.4	40.4	45	45	40	123	41.2	45	45	41	124		
										13458	34	1	32.7	60.8	70	70	59	139	61.6	70	70	60	141		

XXEA7-12 Standard Indoor Blower - With Powered Convenience Outlet (Continued)

Size (Tons)	Nominal Unit Voltage	Compressor 1		Compressor 2		OD Fan Motors (each)	Supply Blower Motor	Pwr Exh Motor	Pwr Conv Outlet	Electric Heat Field Installed Kit 2EK045*				MCA ¹ (Amps)	Min Fuse ² / Breaker ³ Size (Amps)	Max Fuse ² / Breaker ³ Size (Amps)	Min Disconnect Rating ⁴	MCA ¹ w/Pwr Exh (Amps)	Min Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Max Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Min Disconnect Rating ⁴ / Pwr Exh				
		RLA	LRA	MCC	RLA	LRA	MCC			Model	kW	Stages	Amps				FLA	LRA							
										None	-	-	-	52.7	60	60	56	306	54.9	60	60	59	311		
12 (10)	208-3-60	15.6	110	24	16	110	25	5.8	7	1.1	8.6	11725	12	1	33.3	94.3	100	94	340	96.5	100	100	97	345	
										12525	18.6	1	51.6	117.2	125	125	115	358	119.4	125	125	118	363		
										13225	24	1	66.6	136	150	150	133	373	138.2	150	150	150	135	378	
										14225	31.8	2	88.3	126.6	150	150	124	366	128.8	150	150	150	127	371	
										None	-	-	-	52.3	60	60	56	305	54.3	60	70	58	310		
	230-3-60	15.6	110	24	16	110	25	5.2	7.2	1	8.6	11725	16	1	38.5	100.4	110	110	100	344	102.4	110	110	102	348
										12525	24.8	1	59.7	126.9	150	150	124	365	128.9	150	150	150	127	369	
										13225	32	1	77	148.6	150	150	144	382	150.6	175	175	175	146	387	
										14225	42.4	2	102	141.9	150	150	134	373	144.4	150	150	150	136	378	
										None	-	-	-	26.3	30	30	28	148	27.3	30	30	29	150		
460-3-60	7.8	52	12	7.8	52	12	2.9	3.6	0.5	8.6	11746	16.5	1	19.8	51.1	60	60	51	168	52.1	60	60	52	170	
										12846	27.8	1	33.4	68.1	70	70	66	181	69.1	70	70	68	184		
										13346	33	1	39.7	75.9	80	80	74	188	76.9	80	80	75	190		
										14246	41.7	2	50.2	69.9	70	70	66	181	71.2	80	80	68	184		
										None	-	-	-	19.4	20	25	21	109	20.2	25	25	22	110		
575-3-60	5.8	38.9	9	5.7	38.9	9	2.2	2.5	0.4	8.6	11758	17	1	16.4	39.9	40	40	39	125	40.7	45	45	40	127	
										13458	34	1	32.7	60.3	70	70	58	141	61.1	70	70	59	143		

1. Minimum Circuit Ampacity.
2. Dual Element, Time Delay Type.
3. HACR type per NEC.
4. Non-fused Disconnect, Verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

XXEA7-12 Medium Indoor Blower - Without Powered Convenience Outlet

Size (Tons)	Nominal Unit Voltage	Compressor 1		Compressor 2		OD Fan Motors (each)	Supply Blower Motor	Pwr Exh Motor	Pwr Conv Outlet	Electric Heat Field Installed Kit 2EK045*			MCA ¹ (Amps)	Min Fuse ² / Breaker ³ Size (Amps)	Max Fuse ² / Breaker ³ Size (Amps)	Min Discon- nect Rating ⁴		MCA ¹ w/Pwr Exh (Amps)	Min Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Max Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Min Discon- nect Rating ⁴ / Pwr Exh								
		RLA	LRA	MCC	RLA	LRA	MCC	Model	kW	Stages	Amps	FLA	LRA	FLA	LRA	FLA	FLA	LRA	FLA	LRA									
		None	-	-	-	31.8	35	45	32	189	32.9	35	50	33	192														
A7 (6)	208-3-60	17.6	136	27				2.3	7.5	1.1	None	-	-	10625	4.9	1	13.6	48.8	50	60	47	203	49.9	50	60	48	206		
		11125	7.9	1	21.9	59.2	60				11125	7.9	1	10625	6.5	1	15.6	51.3	60	60	70	57	211	60.3	70	70	58	214	
		11625	12	1	33.3	73.4	80				11625	12	1	11125	10.5	1	25.3	63.4	70	70	80	70	223	74.5	80	80	71	225	
		10625	4.9	1	13.6	48.8	50				10625	4.9	1	11625	16	1	38.5	79.9	80	80	90	76	235	80.9	90	90	77	237	
	230-3-60	17.6	136	27				2.3	7.5	1	None	-	-	10625	6.5	1	15.6	51.3	60	60	70	61	221	52.3	60	60	51	214	
		11125	10.5	1	25.3	63.4	70				11125	10.5	1	11625	16	1	38.5	79.9	80	80	90	76	235	80.9	90	90	77	237	
		11625	16	1	38.5	79.9	80				11625	16	1	10646	6	1	7.2	24.3	25	30	35	31	110	33.1	35	35	32	111	
		10646	6	1	7.2	24.3	25				10646	6	1	11146	11.5	1	13.8	32.6	35	35	40	35	113	36.8	40	40	35	114	
	460-3-60	8.5	66.1	13				1.3	3.4	0.5	None	-	-	11446	14	1	16.8	36.3	40	40	50	45	198	43.1	45	50	46	203	
		11146	11.5	1	13.8	32.6	35				11146	11.5	1	10646	6	1	7.2	24.3	25	30	35	31	110	33.1	35	35	32	111	
		11446	14	1	16.8	36.3	40				11446	14	1	10625	6.5	1	15.6	51.3	60	60	70	61	221	52.3	60	60	51	214	
		10625	4.9	1	13.6	48.8	50				10625	4.9	1	11625	16	1	38.5	79.9	80	80	90	76	235	80.9	90	90	77	237	
	08 (7.5)	575-3-60	6.3	55.3	10			1.1	2.8	0.4	None	-	-	11725	12	1	33.3	82.5	90	90	90	81	232	84.7	90	90	84	237	
			11725	12	1	33.3	82.5	90			11725	12	1	12525	18.6	1	51.6	105.4	110	110	110	102	250	107.6	110	110	105	255	
			12525	18.6	1	51.6	105.4	110			12525	18.6	1	13225	24	1	66.6	124.2	125	125	125	120	265	126.4	150	150	150	270	
			13225	24	1	66.6	124.2	125			13225	24	1	14225	31.8	2	88.3	116.9	125	125	125	111	257	119.6	125	125	125	262	
		230-3-60	13.8	83.1	22	13.8	83.1	22	2.3	5.2	1.1	None	-	-	11725	16	1	38.5	89	90	90	90	87	240	91	100	100	90	244
			11725	16	1	38.5	89	90			11725	16	1	12525	24.8	1	59.7	115.5	125	125	125	112	261	117.5	125	125	125	266	
			12525	24.8	1	59.7	115.5	125			12525	24.8	1	13346	33	1	39.7	68.8	70	70	70	66	140	69.8	70	70	67	142	
			13346	33	1	39.7	68.8	70			13346	33	1	14246	41.7	2	50.2	66	70	70	70	59	134	67.3	70	70	60	136	
		460-3-60	6.2	41	10	6.2	41	10	1.3	2.6	0.5	None	-	-	11746	16.5	1	19.8	44	45	45	45	43	120	45	45	45	44	122
			11746	16.5	1	19.8	44	45			11746	16.5	1	12846	27.8	1	33.4	61	70	70	70	59	134	62	70	70	60	136	
			12846	27.8	1	33.4	61	70			12846	27.8	1	13346	33	1	39.7	68.8	70	70	70	66	140	69.8	70	70	67	142	
			13346	33	1	39.7	68.8	70			13346	33	1	14246	41.7	2	50.2	66	70	70	70	59	134	67.3	70	70	60	136	
	09 (8.5)	575-3-60	4.9	33	8	4.9	33	8	1.1	2	0.4	None	-	-	11758	17	1	16.4	35.7	40	40	40	35	97	36.5	40	40	36	99
			11758	17	1	16.4	35.7	40			11758	17	1	13458	34	1	32.7	56.1	60	60	60	54	113	56.9	60	60	55	115	
			13458	34	1	32.7	56.1	60			13458	34	1	10625	6.5	1	19.4	42.4	45	50	50	45	228	44.6	45	50	47	233	
			10625	6.5	1	19.4	42.4	45			10625	6.5	1	11725	12	1	33.3	84	90	90	90	83	261	86.2	90	90	85	266	
		230-3-60	14.5	98	23	14.5	98	23	2.3	5.2	1.1	None	-	-	11725	16	1	38.5	90.5	100	100	100	89	270	92.5	100	100	91	274
			11725	16	1	38.5	90.5	100			11725	16	1	12525	24.8	1	59.7	117	125	125	125	113	291	119	125	125	116	295	
			12525	24.8	1	59.7	117	125			12525	24.8	1	13225	32	1	77	138.7	150	150	150	133	308	140.7	150	150	150	313	
			13225	32	1	77	138.7	150			13225	32	1	14246	42.4	2	102	134	150	150	150	123	299	136.5	150	150	150	304	
	460-3-60	575-3-60	6.3	55	10	6.3	55	10	1.3	2.6	0.5	None	-	-	11746	16.5	1	19.8	44.2	45	45	45	43	148	45.2	50	50	44	150
			11746	16.5	1	19.8	44.2	45			11746	16.5	1	12846	27.8	1	33.4	61.2	70	70	70	59	162	62.2	70	70	60	164	
			12846	27.8	1	33.4	61.2	70			12846	27.8	1	13346	33	1	39.7	69	70	70	70	66	168	70	70	70	67	170	
			13346	33	1	39.7	69	70			13346	33	1	14246	41.7	2	50.2	66	70	70	70	59	162	67.3	70	70	60	164	
			10625	6.5	1	19.4	42.4	45			10625	6.5	1	11758	17	1	16.4	38.2	40	40	40	37	113	39	40	40	38	115	
			11758	17	1	16.4	38.2	40			11758	17	1	13458	34	1	32.7	58.6	60	60	60	56	129	59.4	60	60	57	131	

XXEA7-12 Medium Indoor Blower - Without Powered Convenience Outlet (Continued)

Size (Tons)	Nominal Unit Voltage	Compressor 1		Compressor 2		OD Fan Motors (each)	Supply Blower Motor	Pwr Exh Motor	Pwr Conv Outlet	Electric Heat Field Installed Kit 2EK045*			MCA ¹ (Amps)	Min Fuse ² / Breaker ³ Size (Amps)	Max Fuse ² / Breaker ³ Size (Amps)	Min Disconnect Rating ⁴	MCA ¹ w/Pwr Exh (Amps)	Min Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Max Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Min Disconnect Rating ⁴ / Pwr Exh				
		RLA	LRA	MCC	RLA	LRA	MCC			Model	kW	Stages												
With VFD																								
A7 (6)	208-3-60	17.6	136	27		2.3	8.9	1.1		None	-	-	-	33.2	35	50	33	218	34.3	35	50	34	220	
										10625	4.9	1	13.6	50.2	60	60	49	231	51.3	60	60	50	234	
										11125	7.9	1	21.9	60.6	70	70	58	240	61.7	70	70	60	242	
										11625	12	1	33.3	74.8	80	80	71	251	75.9	80	80	73	253	
	230-3-60	17.6	136	27		2.3	8.2	1		None	-	-	-	32.5	35	50	32	220	33.5	35	50	33	222	
										10625	6.5	1	15.6	52	60	60	50	236	53	60	60	51	238	
										11125	10.5	1	25.3	64.1	70	70	61	245	65.1	70	70	63	248	
										11625	16	1	38.5	80.6	90	90	77	259	81.6	90	90	78	261	
	460-3-60	8.5	66.1	13		1.3	8.2	0.5		None	-	-	-	16	20	20	16	109	16.5	20	20	17	110	
										10646	6	1	7.2	25	25	30	24	116	25.5	30	30	25	117	
										11146	11.5	1	13.8	33.3	35	35	32	122	33.8	35	35	32	123	
	575-3-60	6.3	55.3	10		1.1	3.2	0.4		None	-	-	-	12.2	15	15	12	84	12.6	15	15	13	85	
										None	-	-	-	42.7	45	50	45	236	44.9	45	50	48	241	
08 (7.5)	208-3-60	13.8	83.1	22	13.8	83.1	22	2.3	7	1.1	None	-	-	-	42.7	45	50	45	236	44.9	45	50	48	241
										11725	12	1	33.3	84.3	90	90	83	269	86.5	90	90	86	274	
										12525	18.6	1	51.6	107.2	110	110	104	288	109.4	110	110	107	293	
										13225	24	1	66.6	126	150	150	122	303	128.2	150	150	124	308	
										14225	31.8	2	88.3	119.1	125	125	113	295	121.9	125	125	116	300	
	230-3-60	13.8	83.1	22	13.8	83.1	22	2.3	7.2	1	None	-	-	-	42.9	45	50	45	238	44.9	45	50	48	243
										11725	16	1	38.5	91	100	100	90	277	93	100	100	92	281	
										12525	24.8	1	59.7	117.5	125	125	114	298	119.5	125	125	116	302	
										13225	32	1	77	139.2	150	150	134	315	141.2	150	150	136	320	
	460-3-60	6.2	41	10	6.2	41	10	1.3	3.6	0.5	None	-	-	-	20.2	25	25	21	119	21.2	25	25	23	121
										11746	16.5	1	19.8	45	45	45	44	139	46	50	50	45	141	
										12846	27.8	1	33.4	62	70	70	60	152	63	70	70	61	154	
										13346	33	1	39.7	69.8	70	70	67	158	70.8	80	80	68	161	
										14246	41.7	2	50.2	67.3	70	70	60	152	68.5	70	70	61	154	
	575-3-60	4.9	33	8	4.9	33	8	1.1	2.5	0.4	None	-	-	-	15.7	20	20	17	88	16.5	20	20	18	90
										11758	17	1	16.4	36.2	40	40	36	105	37	40	40	36	107	
										13458	34	1	32.7	56.6	60	60	54	121	57.4	60	60	55	123	
09 (8.5)	208-3-60	14.5	98	23	14.5	98	23	2.3	7	1.1	None	-	-	-	44.2	45	50	47	266	46.4	50	50	49	271
										11725	12	1	33.3	85.8	90	90	85	299	88	90	90	88	304	
										12525	18.6	1	51.6	108.7	110	110	106	317	110.9	125	125	109	322	
										13225	24	1	66.6	127.5	150	150	123	332	129.7	150	150	126	337	
										14225	31.8	2	88.3	119.1	125	125	115	325	121.9	125	125	117	330	
	230-3-60	14.5	98	23	14.5	98	23	2.3	7.2	1	None	-	-	-	44.4	45	50	47	268	46.4	50	60	49	272
										11725	16	1	38.5	92.5	100	100	91	306	94.5	100	100	93	311	
										12525	24.8	1	59.7	119	125	125	116	328	121	125	125	118	332	
										13225	32	1	77	140.7	150	150	135	345	142.7	150	150	138	349	
	460-3-60	6.3	55	10	6.3	55	10	1.3	3.6	0.5	None	-	-	-	20.4	25	25	22	147	21.4	25	25	23	149
										11746	16.5	1	19.8	45.2	50	50	44	167	46.2	50	50	46	169	
										12846	27.8	1	33.4	62.2	70	70	60	180	63.2	70	70	61	182	
										13346	33	1	39.7	70	70	70	67	186	71	80	80	68	189	
										14246	41.7	2	50.2	67.3	70	70	60	180	68.5	70	70	61	182	
	575-3-60	6	41	9	6	41																		

XXEA7-12 Medium Indoor Blower - Without Powered Convenience Outlet (Continued)

Size (Tons)	Nominal Unit Voltage	Compressor 1		Compressor 2		OD Fan Motors (each)	Supply Blower Motor	Pwr Exh Motor	Pwr Conv Outlet	Electric Heat Field Installed Kit 2EK045*				MCA ¹ (Amps)	Min Fuse ² / Breaker ³ Size (Amps)	Max Fuse ² / Breaker ³ Size (Amps)	Min Disconnect Rating ⁴	MCA ¹ w/Pwr Exh (Amps)	Min Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Max Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Min Disconnect Rating ⁴ / Pwr Exh				
		Model	kW	Stages	Amps					FLA	LRA														
		RLA	LRA	MCC	RLA	LRA	MCC	FLA	LRA	FLA	LRA														
12 (10)	208-3-60	15.6	110	24	16	110	25	5.8	9.9	1.1	None	-	-	-	51.3	60	60	54	315	53.5	60	60	57	320	
											11725	12	1	33.3	92.9	100	100	93	348	95.1	100	100	95	353	
											12525	18.6	1	51.6	115.8	125	125	114	366	118	125	125	116	371	
											13225	24	1	66.6	134.6	150	150	131	381	136.8	150	150	150	134	386
											14225	31.8	2	88.3	125.2	150	150	122	374	127.4	150	150	150	125	379
	230-3-60	15.6	110	24	16	110	25	5.2	9.4	1	None	-	-	-	50.2	60	60	53	320	52.2	60	60	55	324	
											11725	16	1	38.5	98.3	100	100	97	358	100.3	110	110	100	363	
											12525	24.8	1	59.7	124.8	125	125	122	379	126.8	150	150	124	384	
											13225	32	1	77	146.5	150	150	142	397	148.5	150	150	144	401	
											14225	42.4	2	102	139.3	150	150	131	388	141.8	150	150	134	392	
	460-3-60	7.8	52	12	7.8	52	12	2.9	4.7	0.5	None	-	-	-	25.2	30	30	27	155	26.2	30	30	28	158	
											11746	16.5	1	19.8	50	50	50	49	175	51	60	60	51	177	
											12846	27.8	1	33.4	67	70	70	65	189	68	70	70	66	191	
											13346	33	1	39.7	74.8	80	80	72	195	75.8	80	80	73	197	
											14246	41.7	2	50.2	68.6	70	70	65	189	69.9	70	70	66	191	
	575-3-60	5.8	38.9	9	5.7	38.9	9	2.2	4.3	0.4	None	-	-	-	19.5	20	25	21	129	20.3	25	25	22	131	
											11758	17	1	16.4	40	40	40	40	146	40.8	45	45	45	147	
											13458	34	1	32.7	60.4	70	70	58	162	61.2	70	70	59	164	

1. Minimum Circuit Ampacity.
2. Dual Element, Time Delay Type.
3. HACR type per NEC.
4. Non-fused Disconnect, Verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

XXEA7-12 Medium Indoor Blower - With Powered Convenience Outlet

Size (Tons)	Nominal Unit Voltage	Compressor 1		Compressor 2		OD Fan Motors (each)	Supply Blower Motor	Pwr Exh Motor	Pwr Conv Outlet	Electric Heat Field Installed Kit 2EK045*			MCA ¹ (Amps)	Min Fuse ² / Breaker ³ Size (Amps)	Max Fuse ² / Breaker ³ Size (Amps)	Min Disconnect Rating ⁴	MCA ¹ w/Pwr Exh (Amps)	Min Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Max Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Min Disconnect Rating ⁴ / Pwr Exh					
		RLA	LRA	MCC	RLA	LRA	MCC			Model	kW	Stages				FLA	LRA								
A7 (6)	208-3-60	17.6	136	27		2.3	7.5	1.1	8.6	None	-	-	-	36.1	40	50	36	194	37.2	40	50	38	196		
										10625	4.9	1	13.6	53.1	60	60	52	207	54.2	60	60	53	210		
										11125	7.9	1	21.9	63.5	70	70	62	216	64.6	70	70	63	218		
										11625	12	1	33.3	77.7	80	80	75	227	78.8	80	80	76	230		
	230-3-60	17.6	136	27		2.3	7.5	1	8.6	None	-	-	-	36.1	40	50	36	200	37.1	40	50	38	203		
										10625	6.5	1	15.6	55.6	60	60	54	216	56.6	60	70	56	218		
										11125	10.5	1	25.3	67.7	70	70	66	226	68.7	70	80	67	228		
										11625	16	1	38.5	84.2	90	90	81	239	85.2	90	90	82	241		
	460-3-60	8.5	66.1	13		1.3	3.4	0.5	8.6	None	-	-	-	17.5	20	25	18	99	18	20	25	18	100		
										10646	6	1	7.2	26.5	30	30	26	106	27	30	30	27	107		
										11146	11.5	1	13.8	34.8	35	35	34	112	35.3	40	40	34	114		
										11446	14	1	16.8	38.5	40	40	37	115	39	40	40	38	117		
08 (7.5)	575-3-60	6.3	55.3	10		1.1	2.8	0.4	8.6	None	-	-	-	13.5	15	15	14	81	13.9	15	15	14	82		
										None	-	-	-	45.2	50	50	48	203	47.4	50	60	50	208		
										11725	12	1	33.3	86.8	90	90	86	236	89	90	90	89	241		
										12525	18.6	1	51.6	109.7	110	110	107	254	111.9	125	125	110	259		
	230-3-60	13.8	83.1	22	13.8	83.1	22	2.3	5.2	1.1	8.6	None	-	-	-	45.2	50	50	48	206	47.2	50	60	50	210
										11725	16	1	38.5	93.3	100	100	92	244	95.3	100	100	95	249		
										12525	24.8	1	59.7	119.8	125	125	117	265	121.8	125	125	119	270		
										13225	32	1	77	141.5	150	150	137	283	143.5	150	150	139	287		
	460-3-60	6.2	41	10	6.2	41	10	1.3	2.6	0.5	8.6	None	-	-	-	21.4	25	25	23	102	22.4	25	25	24	105
										11746	16.5	1	19.8	46.2	50	50	46	122	47.2	50	50	47	124		
										12846	27.8	1	33.4	63.2	70	70	61	136	64.2	70	70	62	138		
										13346	33	1	39.7	71	80	80	68	142	72	80	80	70	144		
09 (8.5)	575-3-60	4.9	33	8	4.9	33	8	1.1	2	0.4	8.6	None	-	-	-	46.7	50	60	50	232	48.9	50	60	52	237
										11725	12	1	33.3	88.3	90	90	88	266	90.5	100	100	90	271		
										12525	18.6	1	51.6	111.2	125	125	109	284	113.4	125	125	111	289		
										13225	24	1	66.6	130	150	150	126	299	132.2	150	150	129	304		
	230-3-60	14.5	98	23	14.5	98	23	2.3	5.2	1.1	8.6	None	-	-	-	46.7	50	60	50	235	48.7	50	60	52	240
										11725	16	1	38.5	94.8	100	100	94	274	96.8	100	100	96	278		
										12525	24.8	1	59.7	121.3	125	125	118	295	123.3	125	125	121	300		
										13225	32	1	77	143	150	150	138	312	145	150	150	140	317		
	460-3-60	6.3	55	10	6.3	55	10	1.3	2.6	0.5	8.6	None	-	-	-	21.6	25	25	23	130	22.6	25	25	24	133
										11746	16.5	1	19.8	46.4	50	50	46	150	47.4	50	50	47	152		
										12846	27.8	1	33.4	63.4	70	70	61	164	64.4	70	70	63	166		
										13346	33	1	39.7	71.2	80	80	69	170	72.2	80	80	70	172		
09 (8.5)	575-3-60	6	41	9	6	41	9	1.1	2	0.4	8.6	None	-	-	-	19.4	20	25	21	98	20.2	25	25	22	100
										11758	17	1	16.4	39.9	40	40	39	115	40.7	45	45	40	117		
										13458	34	1	32.7	60.3	70	70	58	131	61.1	70	70	59	133		

XXEA7-12 Medium Indoor Blower - With Powered Convenience Outlet (Continued)

Size (Tons)	Nominal Unit Voltage	Compressor 1		Compressor 2		OD Fan Motors (each)	Supply Blower Motor	Pwr Exh Motor	Pwr Conv Outlet	Electric Heat Field Installed Kit 2EK045*			MCA ¹ (Amps)	Min Fuse ² / Breaker ³ Size (Amps)	Max Fuse ² / Breaker ³ Size (Amps)	Min Disconnect Rating ⁴	MCA ¹ w/Pwr Exh (Amps)	Min Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Max Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Min Disconnect Rating ⁴ / Pwr Exh					
		RLA	LRA	MCC	RLA	LRA	MCC			Model	kW	Stages	Amps	FLA	LRA	FLA	LRA	FLA	LRA						
With VFD																									
A7 (6)	208-3-60	17.6	136	27		2.3	8.9	1.1	8.6	None	-	-	-	37.5	40	50	38	222	38.6	40	50	39	224		
										10625	4.9	1	13.6	54.5	60	60	54	236	55.6	60	60	55	238		
										11125	7.9	1	21.9	64.9	70	70	63	244	66	70	70	65	246		
										11625	12	1	33.3	79.1	80	80	76	255	80.2	90	90	90	258		
	230-3-60	17.6	136	27		2.3	8.2	1	8.6	None	-	-	-	36.8	40	50	37	224	37.8	40	50	38	227		
										10625	6.5	1	15.6	56.3	60	70	55	240	57.3	60	70	56	242		
08 (7.5)	230-3-60	17.6	136	27		2.3	8.2	1	8.6	None	-	-	-	18.2	20	25	19	111	18.7	20	25	19	112		
										10646	6	1	7.2	27.2	30	30	27	118	27.7	30	30	27	119		
										11146	11.5	1	13.8	35.5	40	40	34	124	36	40	40	35	126		
										11446	14	1	16.8	39.2	40	40	38	127	39.7	40	40	38	129		
										575-3-60	6.3	55.3	10		1.1	3.2	0.4	8.6	None	-	-	13.9	15	20	
																		20	14	85	14.3	15	20	15	86
	460-3-60	8.5	66.1	13		1.3	8.2	0.5	8.6	None	-	-	-	47	50	60	50	240	49.2	50	60	53	245		
										11725	12	1	33.3	88.6	90	90	88	274	90.8	100	100	91	279		
										12525	18.6	1	51.6	111.5	125	125	109	292	113.7	125	125	125	297		
										13225	24	1	66.6	130.3	150	150	127	307	132.5	150	150	150	312		
										14225	31.8	2	88.3	124.5	125	125	118	299	127.3	150	150	150	304		
										None	-	-	-	47.2	50	60	50	242	49.2	50	60	53	247		
09 (8.5)	230-3-60	13.8	83.1	22	13.8	83.1	22	2.3	7	1.1	8.6	None	-	-	-	17.2	20	25	24	121	23.4	25	25	25	123
										11725	16	1	38.5	95.3	100	100	95	281	97.3	100	100	97	285		
										12525	24.8	1	59.7	121.8	125	125	119	302	123.8	125	125	125	307		
										13225	32	1	77	143.5	150	150	139	319	145.5	150	150	150	324		
										14225	42.4	2	102	141.9	150	150	129	310	144.4	150	150	150	315		
										None	-	-	-	22.4	25	25	24	121	23.4	25	25	25	123		
	460-3-60	6.2	41	10	6.2	41	10	1.3	3.6	0.5	8.6	11746	16.5	1	19.8	47.2	50	50	47	141	48.2	50	50	48	143
										12846	27.8	1	33.4	64.2	70	70	62	154	65.2	70	70	63	156		
										13346	33	1	39.7	72	80	80	70	161	73	80	80	71	163		
										14246	41.7	2	50.2	69.9	70	70	62	154	71.2	80	80	63	156		
										None	-	-	-	17.4	20	20	19	90	18.2	20	20	20	92		
										11758	17	1	16.4	37.9	40	40	37	107	38.7	40	40	38	108		
										13458	34	1	32.7	58.3	60	60	56	123	59.1	60	60	57	125		

XXEA7-12 Medium Indoor Blower - With Powered Convenience Outlet (Continued)

Size (Tons)	Nominal Unit Voltage	Compressor 1		Compressor 2		OD Fan Motors (each)	Supply Blower Motor	Pwr Exh Motor	Pwr Conv Outlet	Electric Heat Field Installed Kit 2EK045*				MCA ¹ (Amps)	Min Fuse ² / Breaker ³ Size (Amps)	Max Fuse ² / Breaker ³ Size (Amps)	Min Disconnect Rating ⁴	MCA ¹ w/Pwr Exh (Amps)	Min Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Max Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Min Disconnect Rating ⁴ / Pwr Exh				
		Model	kW	Stages	Amps					FLA	LRA														
		RLA	LRA	MCC	RLA	LRA	MCC											FLA	LRA						
12 (10)	208-3-60	15.6	110	24	16	110	25	5.8	9.9	1.1	8.6	None	-	-	-	55.6	60	70	59	319	57.8	60	70	62	324
												11725	12	1	33.3	97.2	100	100	98	352	99.4	100	100	100	357
												12525	18.6	1	51.6	120.1	125	125	119	370	122.3	125	125	125	375
												13225	24	1	66.6	138.9	150	150	136	385	141.1	150	150	150	390
												14225	31.8	2	88.3	129.5	150	150	127	378	131.7	150	150	150	383
	230-3-60	15.6	110	24	16	110	25	5.2	9.4	1	8.6	None	-	-	-	54.5	60	70	58	324	56.5	60	70	60	329
												11725	16	1	38.5	102.6	110	110	102	362	104.6	110	110	105	367
												12525	24.8	1	59.7	129.1	150	150	127	384	131.1	150	150	129	388
												13225	32	1	77	150.8	175	175	147	401	152.8	175	175	149	406
												14225	42.4	2	102	144.6	150	150	136	392	147.1	150	150	139	397
	460-3-60	7.8	52	12	7.8	52	12	2.9	4.7	0.5	8.6	None	-	-	-	27.4	30	35	29	157	28.4	30	35	30	160
												11746	16.5	1	19.8	52.2	60	60	52	177	53.2	60	60	53	179
												12846	27.8	1	33.4	69.2	70	70	68	191	70.2	80	80	69	193
												13346	33	1	39.7	77	80	80	75	197	78	80	80	76	199
												14246	41.7	2	50.2	71.3	80	80	68	191	72.6	80	80	69	193
	575-3-60	5.8	38.9	9	5.7	38.9	9	2.2	4.3	0.4	8.6	None	-	-	-	21.2	25	25	23	131	22	25	25	24	133
												11758	17	1	16.4	41.7	45	45	42	147	42.5	45	45	42	149
												13458	34	1	32.7	62.1	70	70	60	164	62.9	70	70	61	165

1. Minimum Circuit Ampacity.
2. Dual Element, Time Delay Type.
3. HACR type per NEC.
4. Non-fused Disconnect, Verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

XXEA7-12 High Indoor Blower - Without Powered Convenience Outlet

Size (Tons)	Nominal Unit Voltage	Compressor 1		Compressor 2		OD Fan Motors (each)	Supply Blower Motor	Pwr Exh Motor	Pwr Conv Outlet	Electric Heat Field Installed Kit 2EK045*			MCA ¹ (Amps)	Min Fuse ² / Breaker ³ Size (Amps)	Max Fuse ² / Breaker ³ Size (Amps)	Min Disconnect Rating ⁴		MCA ¹ w/Pwr Exh (Amps)	Min Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Max Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Min Disconnect Rating ⁴ / Pwr Exh		
		RLA	LRA	MCC	RLA	LRA	MCC	Model	kW	Stages	Amps	FLA	LRA										
		RLA	LRA	MCC	RLA	LRA	MCC																
A7 (6)	208-3-60	17.6	136	27		2.3	10.2	1.1		None	-	-	-	34.5	35	50	35	204	35.6	40	50	36 207	
									10625	4.9	1	13.6	51.5	60	60	50	218	52.6	60	60	52 220		
									11125	7.9	1	21.9	61.9	70	70	60	226	63	70	70	61 228		
									11625	12	1	33.3	76.1	80	80	73	237	77.2	80	80	74 240		
	230-3-60	17.6	136	27		2.3	10.2	1		None	-	-	-	34.5	35	50	35	210	35.5	40	50	36 212	
									10625	6.5	1	15.6	54	60	60	53	226	55	60	60	54 228		
									11125	10.5	1	25.3	66.1	70	70	64	235	67.1	70	70	65 238		
									11625	16	1	38.5	82.6	90	90	79	249	83.6	90	90	80 251		
	460-3-60	8.5	66.1	13		1.3	4.8	0.5		None	-	-	-	16.7	20	25	17	104	17.2	20	25	17 105	
									10646	6	1	7.2	25.7	30	30	25	111	26.2	30	30	26 112		
									11146	11.5	1	13.8	34	35	35	33	117	34.5	35	35	33 118		
									11446	14	1	16.8	37.7	40	40	36	120	38.2	40	40	37 121		
08 (7.5)	575-3-60	6.3	55.3	10		1.1	3.4	0.4		None	-	-	-	12.4	15	15	12	85	12.8	15	15	13 86	
									None	-	-	-	45.9	50	50	49	239	48.1	50	60	51 244		
									11725	12	1	33.3	87.5	90	90	87	272	89.7	90	90	90 277		
									12525	18.6	1	51.6	110.4	125	125	108	291	112.6	125	125	111 296		
	230-3-60	13.8	83.1	22	13.8	83.1	22	2.3	10.2	1.1	None	-	-	-	45.9	50	50	49	245	47.9	50	60	51 250
									11725	16	1	38.5	94	100	100	93	284	96	100	100	95 288		
									12525	24.8	1	59.7	120.5	125	125	117	305	122.5	125	125	120 310		
									13225	32	1	77	142.2	150	150	137	322	144.2	150	150	140 327		
	460-3-60	6.2	41	10	6.2	41	10	1.3	4.8	0.5	None	-	-	-	21.4	25	25	23	122	22.4	25	25	24 125
									11746	16.5	1	19.8	46.2	50	50	46	142	47.2	50	50	47 144		
									12846	27.8	1	33.4	63.2	70	70	61	156	64.2	70	70	62 158		
									13346	33	1	39.7	71	80	80	68	162	72	80	80	70 164		
09 (8.5)	575-3-60	4.9	33	8	4.9	33	8	1.1	3.4	0.4	None	-	-	-	16.6	20	20	18	98	17.4	20	20	19 100
									11758	17	1	16.4	37.1	40	40	37	115	37.9	40	40	37 117		
									13458	34	1	32.7	57.5	60	60	55	131	58.3	60	60	56 133		
									None	-	-	-	47.4	50	60	50	269	49.6	50	60	53 274		
	208-3-60	14.5	98	23	14.5	98	23	2.3	10.2	1.1	None	-	-	-	33.3	89	90	89	302	91.2	100	100	91 307
									12525	18.6	1	51.6	111.9	125	125	110	320	114.1	125	125	125 325		
									13225	24	1	66.6	130.7	150	150	127	335	132.9	150	150	150 340		
									14225	31.8	2	88.3	123.1	125	125	118	328	125.9	150	150	150 333		
09 (8.5)	230-3-60	14.5	98	23	14.5	98	23	2.3	10.2	1	None	-	-	-	47.4	50	60	50	275	49.4	50	60	53 280
									11725	16	1	38.5	95.5	100	100	95	314	97.5	100	100	97 318		
									12525	24.8	1	59.7	122	125	125	119	335	124	125	125	121 339		
									13225	32	1	77	143.7	150	150	139	352	145.7	150	150	141 357		
	460-3-60	6.3	55	10	6.3	55	10	1.3	4.8	0.5	None	-	-	-	21.6	25	25	23	150	22.6	25	25	24 153
									11746	16.5	1	19.8	46.4	50	50	46	170	47.4	50	50	47 172		
									12846	27.8	1	33.4	63.4	70	70	61	184	64.4	70	70	63 186		
									13346	33	1	39.7	71.2	80	80	69	190	72.2	80	80	70 192		
	575-3-60	6	41	9	6	41	9	1.1	3.4	0.4	None	-	-	-	19.1	20	25	20	114	19.9	20	25	21 116
									11758	17	1	16.4	39.6	40	40	39	131	40.4	45	45	40 133		
									13458	34	1	32.7	60	60	60	58	147	60.8	70	70	59 149		

XXEA7-12 High Indoor Blower - Without Powered Convenience Outlet (Continued)

Size (Tons)	Nominal Unit Voltage	Compressor 1		Compressor 2		OD Fan Motors (each)	Supply Blower Motor	Pwr Exh Motor	Pwr Conv Outlet	Electric Heat Field Installed Kit 2EK045*				MCA ¹ (Amps)	Min Fuse ² / Breaker ³ Size (Amps)	Max Fuse ² / Breaker ³ Size (Amps)	Min Disconnect Rating ⁴	MCA ¹ w/Pwr Exh (Amps)	Min Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Max Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Min Disconnect Rating ⁴ / Pwr Exh				
		RLA	LRA	MCC	RLA	LRA	MCC			Model	kW	Stages	Amps												
With VFD																									
A7 (6)	208-3-60	17.6	136	27				2.3	9.9	1.1		None	-	-	-	34.2	35	50	34	213	35.3	40	50	36	216
												10625	4.9	1	13.6	51.2	60	60	50	227	52.3	60	60	51	229
												11125	7.9	1	21.9	61.6	70	70	59	235	62.7	70	70	61	238
												11625	12	1	33.3	75.8	80	80	73	247	76.9	80	80	74	249
	230-3-60	17.6	136	27				2.3	9.4	1		None	-	-	-	33.7	35	50	34	222	34.7	35	50	35	224
												10625	6.5	1	15.6	53.2	60	60	52	237	54.2	60	60	53	240
												11125	10.5	1	25.3	65.3	70	70	63	247	66.3	70	70	64	249
												11625	16	1	38.5	81.8	90	90	78	260	82.8	90	90	79	262
	460-3-60	8.5	66.1	13				1.3	9.4	0.5		None	-	-	-	16.6	20	25	17	109	17.1	20	25	17	110
												10646	6	1	7.2	25.6	30	30	25	117	26.1	30	30	26	118
												11146	11.5	1	13.8	33.9	35	35	33	123	34.4	35	35	33	124
												11446	14	1	16.8	37.6	40	40	36	126	38.1	40	40	37	127
	575-3-60	6.3	55.3	10				1.1	4.3	0.4		None	-	-	-	13.3	15	15	13	98	13.7	15	15	14	99
08 (7.5)	208-3-60	13.8	83.1	22	13.8	83.1	22	2.3	9.9	1.1		None	-	-	-	45.6	50	50	48	248	47.8	50	60	51	253
												11725	12	1	33.3	87.2	90	90	87	282	89.4	90	90	89	287
												12525	18.6	1	51.6	110.1	125	125	108	300	112.3	125	125	110	305
												13225	24	1	66.6	128.9	150	150	125	315	131.1	150	150	128	320
	230-3-60	13.8	83.1	22	13.8	83.1	22	2.3	9.4	1		None	-	-	-	45.1	50	50	48	257	47.1	50	60	50	261
												11725	16	1	38.5	93.2	100	100	92	295	95.2	100	100	94	300
												12525	24.8	1	59.7	119.7	125	125	116	317	121.7	125	125	119	321
												13225	32	1	77	141.4	150	150	136	334	143.4	150	150	139	338
	460-3-60	6.2	41	10	6.2	41	10	1.3	4.7	0.5		None	-	-	-	21.3	25	25	23	128	22.3	25	25	24	130
												11746	16.5	1	19.8	46.1	50	50	45	148	47.1	50	50	47	150
												12846	27.8	1	33.4	63.1	70	70	61	162	64.1	70	70	62	164
												13346	33	1	39.7	70.9	80	80	68	168	71.9	80	80	69	170
	575-3-60	4.9	33	8	4.9	33	8	1.1	4.3	0.4		None	-	-	-	17.5	20	20	19	111	18.3	20	20	20	113
												11758	17	1	16.4	38	40	40	38	127	38.8	40	40	39	129
												13458	34	1	32.7	58.4	60	60	56	143	59.2	60	60	57	145
												None	-	-	-	47.1	50	60	50	278	49.3	50	60	53	283
09 (8.5)	208-3-60	14.5	98	23	14.5	98	23	2.3	9.9	1.1		None	-	-	-	46.6	50	60	49	287	48.6	50	60	52	291
												11725	16	1	38.5	94.7	100	100	94	325	96.7	100	100	96	330
												12525	24.8	1	59.7	121.2	125	125	118	346	123.2	125	125	120	351
												13225	32	1	77	142.9	150	150	138	364	144.9	150	150	140	368
	230-3-60	14.5	98	23	14.5	98	23	2.3	9.4	1		None	-	-	-	46.6	50	60	49	287	48.6	50	60	52	359
												11725	16	1	38.5	94.7	100	100	94	325	96.7	100	100	96	330
												12525	24.8	1	59.7	121.2	125	125	118	346	123.2	125	125	120	351
												13225	32	1	77	142.9	150	150	138	364	144.9	150	150	140	368
	460-3-60	6.3	55	10	6.3	55	10	1.3	4.7	0.5		None	-	-	-	21.5	25	25	23	156	22.5	25	25	24	158
												11746	16.5	1	19.8	46.3	50	50	46	176	47.3	50	50	47	178
												12846	27.8	1	33.4	63.3	70	70	61	190	64.3	70	70	62	192
												13346	33	1	39.7	71.1	80	80	69	196	72.1	80	80	70	198
	575-3-60	6	41	9	6	41	9	1.1	4.3	0.4		None	-	-	-	20	25	25	21	127	20.8	25	25	22	129
												11758	17	1	16.4	40.5	45	45	40	143	41.3	45	45	41	145
												13458	34	1	32.7	60.9	70	70	59	159	61.7	70	70	60	161

XXEA7-12 High Indoor Blower - Without Powered Convenience Outlet (Continued)

Size (Tons)	Nominal Unit Voltage	Compressor 1		Compressor 2		OD Fan Motors (each)	Supply Blower Motor	Pwr Exh Motor	Pwr Conv Outlet	Electric Heat Field Installed Kit 2EK045*				MCA ¹ (Amps)	Min Fuse ² / Breaker ³ Size (Amps)	Max Fuse ² / Breaker ³ Size (Amps)	Min Disconnect Rating ⁴	MCA ¹ w/Pwr Exh (Amps)	Min Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Max Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Min Disconnect Rating ⁴ / Pwr Exh			
		Model	kW	Stages	Amps					FLA	LRA													
		RLA	LRA	MCC	RLA	LRA	MCC	FLA	LRA	FLA	LRA													
12 (10)	208-3-60	15.6	110	24	16	110	25	5.8	13.5	1.1	None	-	-	-	54.9	60	70	59	345	57.1	60	70	61	350
											11725	12	1	33.3	96.5	100	100	97	378	98.7	100	100	99	383
											12525	18.6	1	51.6	119.4	125	125	118	396	121.6	125	125	125	401
											13225	24	1	66.6	138.2	150	150	135	411	140.4	150	150	150	416
											14225	31.8	2	88.3	128.8	150	150	127	404	131	150	150	150	409
	230-3-60	15.6	110	24	16	110	25	5.2	13.4	1	None	-	-	-	54.2	60	70	58	341	56.2	60	70	60	346
											11725	16	1	38.5	102.3	110	110	102	380	104.3	110	110	104	384
											12525	24.8	1	59.7	128.8	150	150	126	401	130.8	150	150	129	405
											13225	32	1	77	150.5	175	175	146	418	152.5	175	175	149	423
											14225	42.4	2	102	144.3	150	150	136	409	146.8	150	150	138	414
	460-3-60	7.8	52	12	7.8	52	12	2.9	6.7	0.5	None	-	-	-	27.2	30	30	29	166	28.2	30	30	30	168
											11746	16.5	1	19.8	52	60	60	52	186	53	60	60	53	188
											12846	27.8	1	33.4	69	70	70	67	199	70	70	70	69	202
											13346	33	1	39.7	76.8	80	80	75	206	77.8	80	80	76	208
											14246	41.7	2	50.2	71.1	80	80	67	199	72.4	80	80	69	202
	575-3-60	5.8	38.9	9	5.7	38.9	9	2.2	5.4	0.4	None	-	-	-	20.6	25	25	22	129	21.4	25	25	23	131
											11758	17	1	16.4	41.1	45	45	41	146	41.9	45	45	42	147
											13458	34	1	32.7	61.5	70	70	60	162	62.3	70	70	60	164

1. Minimum Circuit Ampacity.
2. Dual Element, Time Delay Type.
3. HACR type per NEC.
4. Non-fused Disconnect, Verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

XXEA7-12 High Indoor Blower - With Powered Convenience Outlet

Size (Tons)	Nominal Unit Voltage	Compressor 1			Compressor 2			OD Fan Motors (each)	Supply Blower Motor	Pwr Exh Motor	Pwr Conv Outlet	Electric Heat Field Installed Kit 2EK045*				MCA ¹ (Amps)	Min Fuse ² / Breaker ³ Size (Amps)	Max Fuse ² / Breaker ³ Size (Amps)	Min Disconnect Rating ⁴	MCA ¹ w/Pwr Exh (Amps)	Min Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Max Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Min Disconnect Rating ⁴ Pwr Exh		
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps		FLA	LRA							
A7 (6)	208-3-60	17.6	136	27				2.3	10.2	1.1	8.6	None	-	-	-	38.8	40	50	40	208	39.9	40	50	41	211
												10625	4.9	1	13.6	55.8	60	70	55	222	56.9	60	70	56	224
												11125	7.9	1	21.9	66.2	70	70	65	230	67.3	70	70	66	233
												11625	12	1	33.3	80.4	90	90	78	242	81.5	90	90	79	244
	230-3-60	17.6	136	27				2.3	10.2	1	8.6	None	-	-	-	38.8	40	50	40	214	39.8	40	50	41	217
												10625	6.5	1	15.6	58.3	60	70	58	230	59.3	60	70	59	232
												11125	10.5	1	25.3	70.4	80	80	69	240	71.4	80	80	70	242
												11625	16	1	38.5	86.9	90	90	84	253	87.9	90	90	85	255
	460-3-60	8.5	66.1	13				1.3	4.8	0.5	8.6	None	-	-	-	18.9	20	25	19	106	19.4	20	25	20	107
												10646	6	1	7.2	27.9	30	30	28	113	28.4	30	30	28	114
												11146	11.5	1	13.8	36.2	40	40	35	119	36.7	40	40	36	121
												11446	14	1	16.8	39.9	40	40	39	122	40.4	45	45	39	124
08 (7.5)	208-3-60	6.3	55.3	10				1.1	3.4	0.4	8.6	None	-	-	-	14.1	15	20	14	87	14.5	15	20	15	88
												11725	12	1	33.3	91.8	100	100	92	277	94	100	100	95	282
												12525	18.6	1	51.6	114.7	125	125	113	295	116.9	125	125	116	300
												13225	24	1	66.6	133.5	150	150	130	310	135.7	150	150	133	315
	230-3-60	13.8	83.1	22	13.8	83.1	22	2.3	10.2	1.1	8.6	None	-	-	-	50.2	60	60	54	250	52.2	60	60	56	254
												11725	16	1	38.5	98.3	100	100	98	288	100.3	110	110	100	293
												12525	24.8	1	59.7	124.8	125	125	122	309	126.8	150	150	125	314
												13225	32	1	77	146.5	150	150	142	327	148.5	150	150	145	331
	460-3-60	6.2	41	10	6.2	41	10	1.3	4.8	0.5	8.6	None	-	-	-	23.6	25	25	25	124	24.6	25	25	26	127
												11746	16.5	1	19.8	48.4	50	50	48	144	49.4	50	50	49	146
												12846	27.8	1	33.4	65.4	70	70	64	158	66.4	70	70	65	160
												13346	33	1	39.7	73.2	80	80	71	164	74.2	80	80	72	166
09 (8.5)	575-3-60	4.9	33	8	4.9	33	8	1.1	3.4	0.4	8.6	None	-	-	-	18.3	20	20	20	100	19.1	20	20	21	102
												11758	17	1	16.4	38.8	40	40	39	116	39.6	40	40	39	118
												13458	34	1	32.7	59.2	60	60	57	133	60	60	60	58	135
												None	-	-	-	51.7	60	60	55	273	53.9	60	60	58	278
	208-3-60	14.5	98	23	14.5	98	23	2.3	10.2	1.1	8.6	None	-	-	-	33.3	100	100	94	306	95.5	100	100	96	311
												12525	18.6	1	51.6	116.2	125	125	115	325	118.4	125	125	117	330
												13225	24	1	66.6	135	150	150	132	340	137.2	150	150	134	345
												14225	31.8	2	88.3	128.5	150	150	123	332	131.3	150	150	126	337
09 (8.5)	230-3-60	14.5	98	23	14.5	98	23	2.3	10.2	1	8.6	None	-	-	-	51.7	60	60	55	279	53.7	60	60	58	284
												11725	16	1	38.5	99.8	100	100	100	318	101.8	110	110	102	322
												12525	24.8	1	59.7	126.3	150	150	124	339	128.3	150	150	126	344
												13225	32	1	77	148	150	150	144	356	150	150	150	146	361
	460-3-60	6.3	55	10	6.3	55	10	1.3	4.8	0.5	8.6	None	-	-	-	23.8	25	25	26	152	24.8	25	30	27	155
												11746	16.5	1	19.8	48.6	50	50	48	172	49.6	50	50	49	174
												12846	27.8	1	33.4	65.6	70	70	64	186	66.6	70	70	65	188
												13346	33	1	39.7	73.4	80	80	71	192	74.4	80	80	72	194
575-3-60	6	41	9	6	41	9	1.1	3.4	0.4	8.6	None	-	-	-	20.8	25	25	22	116	21.6	25	25	23	118	
											11758	17	1	16.4	41.3	45	45	41	132	42.1	45	45	42	134	
											13458	34	1	32.7	61.7	70	70	60	149	62.5	70	70	61	151	

XXEA7-12 High Indoor Blower - With Powered Convenience Outlet (Continued)

Size (Tons)	Nominal Unit Voltage	Compressor 1		Compressor 2		OD Fan Motors (each)	Supply Blower Motor	Pwr Exh Motor	Pwr Conv Outlet	Electric Heat Field Installed Kit 2EK045*			MCA ¹ (Amps)	Min Fuse ² / Breaker ³ Size (Amps)	Max Fuse ² / Breaker ³ Size (Amps)	Min Disconnect Rating ⁴	MCA ¹ w/Pwr Exh (Amps)	Min Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Max Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Min Disconnect Rating ⁴ / Pwr Exh					
		RLA	LRA	MCC	RLA	LRA	MCC			Model	kW	Stages													
With VFD																									
A7 (6)	208-3-60	17.6	136	27		2.3	9.9	1.1	8.6	None	-	-	-	38.5	40	50	39	218	39.6	40	50	40	220		
										10625	4.9	1	13.6	55.5	60	60	55	231	56.6	60	70	56	234		
										11125	7.9	1	21.9	65.9	70	70	64	240	67	70	70	66	242		
										11625	12	1	33.3	80.1	90	90	78	251	81.2	90	90	79	253		
A7 (6)	230-3-60	17.6	136	27		2.3	9.4	1	8.6	None	-	-	-	38	40	50	39	226	39	40	50	40	228		
										10625	6.5	1	15.6	57.5	60	70	57	242	58.5	60	70	58	244		
										11125	10.5	1	25.3	69.6	70	80	68	251	70.6	80	80	69	254		
										11625	16	1	38.5	86.1	90	90	83	264	87.1	90	90	84	267		
A7 (6)	460-3-60	8.5	66.1	13		1.3	9.4	0.5	8.6	None	-	-	-	18.8	20	25	19	111	19.3	20	25	20	113		
										10646	6	1	7.2	27.8	30	30	27	119	28.3	30	30	28	120		
										11146	11.5	1	13.8	36.1	40	40	35	125	36.6	40	40	36	126		
										11446	14	1	16.8	39.8	40	40	39	128	40.3	45	45	39	129		
A7 (6)	575-3-60	6.3	55.3	10		1.1	4.3	0.4	8.6	None	-	-	-	15	20	20	15	99	15.4	20	20	16	100		
										None	-	-	-	49.9	50	60	53	253	52.1	60	60	56	258		
										11725	12	1	33.3	91.5	100	100	92	286	93.7	100	100	94	291		
										12525	18.6	1	51.6	114.4	125	125	113	304	116.6	125	125	115	309		
08 (7.5)	208-3-60	13.8	83.1	22	13.8	83.1	22	2.3	9.9	1.1	8.6	None	-	-	-	49.4	50	60	53	261	51.4	60	60	55	266
										11725	16	1	38.5	97.5	100	100	97	300	99.5	100	100	99	304		
										12525	24.8	1	59.7	124	125	125	121	321	126	150	150	150	124	325	
										13225	32	1	77	145.7	150	150	141	338	147.7	150	150	150	144	343	
08 (7.5)	460-3-60	6.2	41	10	6.2	41	10	1.3	4.7	0.5	8.6	None	-	-	-	23.5	25	25	25	130	24.5	25	25	26	132
										11746	16.5	1	19.8	48.3	50	50	48	150	49.3	50	50	49	152		
										12846	27.8	1	33.4	65.3	70	70	64	164	66.3	70	70	65	166		
										13346	33	1	39.7	73.1	80	80	71	170	74.1	80	80	72	172		
08 (7.5)	575-3-60	4.9	33	8	4.9	33	8	1.1	4.3	0.4	8.6	None	-	-	-	19.2	20	20	20	112	20	20	20	22	114
										11758	17	1	16.4	39.7	40	40	40	129	40.5	45	45	40	131		
										13458	34	1	32.7	60.1	70	70	58	145	60.9	70	70	59	147		
										None	-	-	-	51.4	60	60	55	282	53.6	60	60	58	287		
09 (8.5)	208-3-60	14.5	98	23	14.5	98	23	2.3	9.9	1.1	8.6	None	-	-	-	51.4	60	60	55	291	52.9	60	60	57	296
										11725	12	1	33.3	93	100	100	93	316	95.2	100	100	96	321		
										12525	18.6	1	51.6	115.9	125	125	114	334	118.1	125	125	117	339		
										13225	24	1	66.6	134.7	150	150	132	349	136.9	150	150	134	354		
09 (8.5)	230-3-60	14.5	98	23	14.5	98	23	2.3	9.4	1	8.6	None	-	-	-	50.9	60	60	54	291	52.9	60	60	57	296
										11725	16	1	38.5	99	100	100	99	329	101	110	110	101	334		
										12525	24.8	1	59.7	125.5	150	150	123	351	127.5	150	150	125	355		
										13225	32	1	77	147.2	150	150	143	368	149.2	150	150	145	373		
09 (8.5)	460-3-60	6.3	55	10	6.3	55	10	1.3	4.7	0.5	8.6	None	-	-	-	23.7	25	25	25	158	24.7	25	25	27	160
										11746	16.5	1	19.8	48.5	50	50	48	178	49.5	50	50	49	180		
										12846	27.8	1	33.4	65.5	70	70	64	192	66.5	70	70	65	194		
										13346	33	1	39.7	73.3	80	80	71	198	74.3	80	80	72	200		
09 (8.5)	575-3-60	6	41	9	6	41	9	1.1	4.3	0.4	8.6	None	-	-	-	21.7	25	25	23	128	22.5	25	25	24	130
										11758	17	1	16.4	42.2	45	45	42	145	43	45	45	43	147		
										13458	34	1	32.7	62.6	70	70	61	161	63.4	70	70	62</td			

XXEA7-12 High Indoor Blower - With Powered Convenience Outlet (Continued)

Size (Tons)	Nominal Unit Voltage	Compressor 1		Compressor 2		OD Fan Motors (each)	Supply Blower Motor	Pwr Exh Motor	Pwr Conv Outlet	Electric Heat Field Installed Kit 2EK045*				MCA ¹ (Amps)	Min Fuse ² / Breaker ³ Size (Amps)	Max Fuse ² / Breaker ³ Size (Amps)	Min Disconnect Rating ⁴	MCA ¹ w/Pwr Exh (Amps)	Min Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Max Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Min Disconnect Rating ⁴ / Pwr Exh				
		RLA	LRA	MCC	RLA	LRA	MCC			Model	kW	Stages	Amps				FLA	LRA							
										None	-	-	-	59.2	60	70	63	349	61.4	70	70	66	354		
12 (10)	208-3-60	15.6	110	24	16	110	25	5.8	13.5	1.1	8.6	None	- - -	59.2	60	70	63	349	61.4	70	70	66	354		
												11725	12	1	33.3	100.8	110	110	102	382	103	110	110	104	387
												12525	18.6	1	51.6	123.7	125	125	123	401	125.9	150	150	125	406
												13225	24	1	66.6	142.5	150	150	140	416	144.7	150	150	143	421
												14225	31.8	2	88.3	133.1	150	150	131	408	135.4	150	150	134	413
	230-3-60	15.6	110	24	16	110	25	5.2	13.4	1	8.6	None	- - -	58.5	60	70	63	345	60.5	70	70	65	350		
												11725	16	1	38.5	106.6	110	110	107	384	108.6	110	110	109	388
												12525	24.8	1	59.7	133.1	150	150	131	405	135.1	150	150	134	410
												13225	32	1	77	154.8	175	175	151	422	156.8	175	175	154	427
												14225	42.4	2	102	149.6	150	150	141	413	152.1	175	175	143	418
	460-3-60	7.8	52	12	7.8	52	12	2.9	6.7	0.5	8.6	None	- - -	29.4	30	35	32	168	30.4	35	35	33	170		
												11746	16.5	1	19.8	54.2	60	60	54	188	55.2	60	60	55	190
												12846	27.8	1	33.4	71.2	80	80	70	202	72.2	80	80	71	204
												13346	33	1	39.7	79	80	80	77	208	80	80	80	78	210
												14246	41.7	2	50.2	73.8	80	80	70	202	75.1	80	80	71	204
	575-3-60	5.8	38.9	9	5.7	38.9	9	2.2	5.4	0.4	8.6	None	- - -	22.3	25	25	24	131	23.1	25	25	25	133		
												11758	17	1	16.4	42.8	45	45	43	147	43.6	45	45	44	149
												13458	34	1	32.7	63.2	70	70	62	164	64	70	70	62	165

1. Minimum Circuit Ampacity.
2. Dual Element, Time Delay Type.
3. HACR type per NEC.
4. Non-fused Disconnect, Verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

XQE04-06 Standard Indoor Blower - Without Powered Convenience Outlet

Size (Tons)	Nominal Unit Voltage	Compressor 1		Compressor 2		OD Fan Motors (each)	Supply Blower Motor	Pwr Exh Motor	Pwr Conv Outlet	Electric Heat Field Installed Kit 2EK045*			MCA ¹ (Amps)	Min Fuse ² / Breaker ³ Size (Amps)	Max Fuse ² / Breaker ³ Size (Amps)	Min Disconnect Rating ⁴		MCA ¹ w/Pwr Exh (Amps)	Min Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Max Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Min Discon-nect Rating ⁴ / Pwr Exh					
										Model	kW	Stages				FLA	LRA				FLA	LRA				
		RLA	LRA	MCC	RLA	LRA	MCC																			
04 (3)	208-1-60	15.4	83.9	24				2.3	6.6	1.5			None	-	-	-	28.2	30	40	28	91	29.7	30	45	30	94
											10625	4.9	1	23.6	57.7	60	60	55	114	59.2	60	60	57	118		
											11125	7.9	1	38	75.7	80	80	72	129	77.2	80	80	73	132		
	230-1-60	15.4	83.9	24				2.3	6	1.3			None	-	-	-	27.6	30	40	27	91	28.9	30	40	29	94
											10625	6.5	1	27.1	61.5	70	70	58	118	62.8	70	70	60	121		
											11125	10.5	1	43.8	82.4	90	90	78	135	83.7	90	90	79	138		
	208-3-60	10.4	73	16				2.3	6.6	1.1			None	-	-	-	21.9	25	30	22	80	23	25	30	23	82
											10625	4.9	1	13.6	38.9	40	45	38	93	40	40	45	39	96		
											11125	7.9	1	21.9	49.3	50	50	47	102	50.4	60	60	49	104		
											11625	12	1	33.3	63.5	70	70	60	113	64.6	70	70	62	116		
	230-3-60	10.4	73	16				2.3	6	1			None	-	-	-	21.3	25	30	22	80	22.3	25	30	23	82
											10625	6.5	1	15.6	40.8	45	45	39	96	41.8	45	45	41	98		
05 (4)	460-3-60	5.8	38	9				1.3	3.2	0.5			None	-	-	-	11.8	15	15	12	43	12.3	15	15	12	44
											10646	6	1	7.2	20.8	25	25	20	50	21.3	25	25	21	51		
											11146	11.5	1	13.8	29.1	30	30	28	57	29.6	30	30	28	58		
											11446	14	1	16.8	32.8	35	35	31	60	33.3	35	35	32	61		
	575-3-60	3.8	36.5	6				1.1	6	0.4			None	-	-	-	8.3	15	15	8	40	8.7	15	15	9	41
											11058	9.2	1	8.9	19.4	20	20	19	49	19.8	20	20	19	49		
											11458	13.8	1	13.3	24.9	25	25	24	53	25.3	30	30	24	54		
	208-1-60	19.6	130	31				2.3	8.4	1.5			None	-	-	-	35.2	40	50	35	137	36.7	40	50	37	140
											10625	4.9	1	23.6	64.7	70	70	62	160	66.2	70	70	64	164		
											11125	7.9	1	38	82.7	90	90	79	175	84.2	90	90	80	178		
	230-1-60	19.6	130	31				2.3	7.6	1.3			None	-	-	-	34.4	35	50	34	137	35.7	40	50	35	140
											10625	6.5	1	27.1	68.3	70	80	65	164	69.6	70	80	67	167		
											11125	10.5	1	43.8	89.2	90	90	84	181	90.5	100	100	86	184		
	208-3-60	13.7	83.1	21				2.3	8.4	1.1			None	-	-	-	27.8	30	40	28	90	28.9	30	40	29	92
											10625	4.9	1	13.6	44.8	45	50	44	104	45.9	50	50	45	106		
											11125	7.9	1	21.9	55.2	60	60	53	112	56.3	60	60	55	114		
											11625	12	1	33.3	69.4	70	70	66	123	70.5	80	80	68	126		
	230-3-60	13.7	83.1	21				2.3	7.6	1			None	-	-	-	27	30	40	27	90	28	30	40	28	92
											10625	6.5	1	15.6	46.5	50	50	45	106	47.5	50	50	46	108		
											11125	10.5	1	25.3	58.6	60	60	56	115	59.6	60	60	57	118		
											11625	16	1	38.5	75.1	80	80	71	129	76.1	80	80	73	131		
	460-3-60	6.2	41	10				1.3	4	0.5			None	-	-	-	13.1	15	15	13	46	13.6	15	15	14	47
											10646	6	1	7.2	22.1	25	25	22	53	22.6	25	25	22	54		
											11146	11.5	1	13.8	30.4	35	35	29	60	30.9	35	35	30	61		
											11446	14	1	16.8	34.1	35	35	33	63	34.6	35	35	33	64		
	575-3-60	4.8	33	8				1.1	7.6	0.4			None	-	-	-	10.1	15	15	10	36	10.5	15	15	11	37
											11058	9.2	1	8.9	21.2	25	25	20	45	21.6	25	25	21	46		
											11458	13.8	1	13.3	26.7	30	30	26	49	27.1	30	30	26	50		

XQE04-06 Standard Indoor Blower - Without Powered Convenience Outlet (Continued)

Size (Tons)	Nominal Unit Voltage	Compressor 1			Compressor 2			OD Fan Motors (each)	Supply Blower Motor	Pwr Exh Motor	Pwr Conv Outlet	Electric Heat Field Installed Kit 2EK045*				MCA ¹ (Amps)	Min Fuse ² / Breaker ³ Size (Amps)	Max Fuse ² / Breaker ³ Size (Amps)	Min Disconnect Rating ⁴		MCA ¹ w/Pwr Exh (Amps)	Min Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Max Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Min Discon-nect Rating ⁴ / Pwr Exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps				FLA	LRA			FLA	LRA	
06 (5)	208-1-60	24.4	144. 2	38				2.3	8.4	1.5		None	-	-	-	41.2	45	60	40	151	42.7	45	60	42	154
												10625	4.9	1	23.6	70.7	80	80	68	175	72.2	80	90	69	178
												11125	7.9	1	38	88.7	90	100	84	189	90.2	100	100	86	192
	230-1-60	24.4	144. 2	38				2.3	7.6	1.3		None	-	-	-	40.4	45	60	39	151	41.7	45	60	41	154
												10625	6.5	1	27.1	74.3	80	90	71	178	75.6	80	90	72	181
												11125	10.5	1	43.8	95.2	100	100	90	195	96.5	100	100	91	198
	208-3-60	16	110	25				2.3	8.4	1.1		None	-	-	-	30.7	35	45	31	117	31.8	35	45	32	119
												10625	4.9	1	13.6	47.7	50	60	46	130	48.8	50	60	48	133
												11125	7.9	1	21.9	58.1	60	60	56	139	59.2	60	60	57	141
	230-3-60	16	110	25				2.3	7.6	1		None	-	-	-	29.9	30	45	30	117	30.9	35	45	31	119
												10625	6.5	1	15.6	49.4	50	60	48	133	50.4	60	60	49	135
												11125	10.5	1	25.3	61.5	70	70	59	142	62.5	70	70	60	145
	460-3-60	7.8	52	12				1.3	4	0.5		None	-	-	-	15.1	20	20	15	57	15.6	20	20	16	58
												10646	6	1	7.2	24.1	25	30	23	64	24.6	25	30	24	65
												11146	11.5	1	13.8	32.4	35	35	31	71	32.9	35	35	32	72
	575-3-60	5.7	38.9	9				1.1	7.6	0.4		None	-	-	-	11.2	15	15	11	42	11.6	15	15	12	43
												11458	13.8	1	13.3	27.8	30	30	27	55	28.2	30	30	27	56
												12358	23	1	22.1	38.8	40	40	37	64	39.2	40	40	37	65

1. Minimum Circuit Ampacity.
2. Dual Element, Time Delay Type.
3. HACR type per NEC.
4. Non-fused Disconnect, Verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

XQE04-06 Standard Indoor Blower - With Powered Convenience Outlet

Size (Tons)	Nominal Unit Voltage	Compressor 1		Compressor 2		OD Fan Motors (each)	Supply Blower Motor	Pwr Exh Motor	Pwr Conv Outlet	Electric Heat Field Installed Kit 2EK045*			MCA ¹ (Amps)	Min Fuse ² / Breaker ³ Size (Amps)	Max Fuse ² / Breaker ³ Size (Amps)	Min Disconnect Rating ⁴		MCA ¹ w/Pwr Exh (Amps)	Min Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Max Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Min Discon-nect Rating ⁴ / Pwr Exh				
										Model	kW	Stages				FLA	LRA				FLA	LRA			
		RLA	LRA	MCC	RLA	LRA	MCC																		
04 (3)	208-1-60	15.4	83.9	24				2.3	6.6	1.5	8.6	None	-	-	-	32.5	35	45	33	95	34	35	45	35	98
												10625	4.9	1	23.6	62	70	70	60	119	63.5	70	70	62	122
												11125	7.9	1	38	80	80	80	77	133	81.5	90	90	78	136
	230-1-60	15.4	83.9	24				2.3	6	1.3	8.6	None	-	-	-	31.9	35	45	32	95	33.2	35	45	34	98
												10625	6.5	1	27.1	65.8	70	70	63	122	67.1	70	70	65	125
												11125	10.5	1	43.8	86.7	90	90	83	139	88	90	90	84	142
	208-3-60	10.4	73	16				2.3	6.6	1.1	8.6	None	-	-	-	26.2	30	35	27	84	27.3	30	35	28	87
												10625	4.9	1	13.6	43.2	45	50	43	98	44.3	45	50	44	100
												11125	7.9	1	21.9	53.6	60	60	52	106	54.7	60	60	54	109
												11625	12	1	33.3	67.8	70	70	65	117	68.9	70	70	67	120
	230-3-60	10.4	73	16				2.3	6	1	8.6	None	-	-	-	25.6	30	35	26	84	26.6	30	35	28	87
												10625	6.5	1	15.6	45.1	50	50	44	100	46.1	50	50	46	102
05 (4)	460-3-60	5.8	38	9				1.3	3.2	0.5	8.6	None	-	-	-	14	15	15	14	45	14.5	15	15	15	46
												10646	6	1	7.2	23	25	25	23	52	23.5	25	25	23	53
												11146	11.5	1	13.8	31.3	35	35	30	59	31.8	35	35	31	60
												11446	14	1	16.8	35	35	35	34	62	35.5	40	40	34	63
	575-3-60	3.8	36.5	6				1.1	6	0.4	8.6	None	-	-	-	10	15	15	10	41	10.4	15	15	11	42
												11058	9.2	1	8.9	21.1	25	25	21	50	21.5	25	25	21	51
												11458	13.8	1	13.3	26.6	30	30	26	55	27	30	30	26	56
	208-1-60	19.6	130	31				2.3	8.4	1.5	8.6	None	-	-	-	39.5	40	50	40	141	41	45	60	42	145
												10625	4.9	1	23.6	69	70	80	67	165	70.5	80	80	69	168
												11125	7.9	1	38	87	90	90	83	179	88.5	90	90	85	183
	230-1-60	19.6	130	31				2.3	7.6	1.3	8.6	None	-	-	-	38.7	40	50	39	141	40	40	50	40	144
												10625	6.5	1	27.1	72.6	80	80	70	168	73.9	80	80	72	171
												11125	10.5	1	43.8	93.5	100	100	89	185	94.8	100	100	91	188
	208-3-60	13.7	83.1	21				2.3	8.4	1.1	8.6	None	-	-	-	32.1	35	45	33	94	33.2	35	45	34	97
												10625	4.9	1	13.6	49.1	50	50	49	108	50.2	60	60	50	110
												11125	7.9	1	21.9	59.5	60	60	58	116	60.6	70	70	59	119
												11625	12	1	33.3	73.7	80	80	71	128	74.8	80	80	73	130
	230-3-60	13.7	83.1	21				2.3	7.6	1	8.6	None	-	-	-	31.3	35	45	32	94	32.3	35	45	33	97
												10625	6.5	1	15.6	50.8	60	60	50	110	51.8	60	60	51	112
												11125	10.5	1	25.3	62.9	70	70	61	120	63.9	70	70	62	122
												11625	16	1	38.5	79.4	80	80	76	133	80.4	90	90	78	135
	460-3-60	6.2	41	10				1.3	4	0.5	8.6	None	-	-	-	15.3	20	20	16	48	15.8	20	20	16	49
												10646	6	1	7.2	24.3	25	25	24	55	24.8	25	25	25	56
												11146	11.5	1	13.8	32.6	35	35	32	62	33.1	35	35	32	63
												11446	14	1	16.8	36.3	40	40	35	65	36.8	40	40	36	66
	575-3-60	4.8	33	8				1.1	7.6	0.4	8.6	None	-	-	-	11.9	15	15	12	38	12.3	15	15	13	39
												11058	9.2	1	8.9	23	25	25	23	47	23.4	25	25	23	48
												11458	13.8	1	13.3	28.5	30	30	28	51	28.9	30	30	28	52

XQE04-06 Standard Indoor Blower - With Powered Convenience Outlet (Continued)

Size (Tons)	Nominal Unit Voltage	Compressor 1			Compressor 2			OD Fan Motors (each)	Supply Blower Motor	Pwr Exh Motor	Pwr Conv Outlet	Electric Heat Field Installed Kit 2EK045*				MCA ¹ (Amps)	Min Fuse ² / Breaker ³ Size (Amps)	Max Fuse ² / Breaker ³ Size (Amps)	Min Disconnect Rating ⁴		MCA ¹ w/Pwr Exh (Amps)	Min Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Max Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Min Discon-nect Rating ⁴ / Pwr Exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps				FLA	LRA			FLA	LRA	
06 (5)	208-1-60	24.4	144. 2	38				2.3	8.4	1.5	8.6	None	-	-	-	45.5	50	60	45	155	47	50	70	47	159
												10625	4.9	1	23.6	75	80	90	72	179	76.5	80	90	74	182
												11125	7.9	1	38	93	100	100	89	193	94.5	100	100	91	197
	230-1-60	24.4	144. 2	38				2.3	7.6	1.3	8.6	None	-	-	-	44.7	45	60	44	156	46	50	70	46	158
												10625	6.5	1	27.1	78.6	80	90	76	183	79.9	80	90	77	186
												11125	10.5	1	43.8	99.5	100	110	95	199	100.8	110	110	96	202
	208-3-60	16	110	25				2.3	8.4	1.1	8.6	None	-	-	-	35	35	50	36	121	36.1	40	50	37	124
												10625	4.9	1	13.6	52	60	60	51	135	53.1	60	60	53	137
												11125	7.9	1	21.9	62.4	70	70	61	143	63.5	70	70	62	146
	230-3-60	16	110	25				2.3	7.6	1	8.6	None	-	-	-	34.2	35	50	35	121	35.2	40	50	36	124
												10625	6.5	1	15.6	53.7	60	60	53	137	54.7	60	60	54	139
												11125	10.5	1	25.3	65.8	70	70	64	147	66.8	70	70	65	149
	460-3-60	7.8	52	12				1.3	4	0.5	8.6	None	-	-	-	17.3	20	25	18	59	17.8	20	25	18	60
												10646	6	1	7.2	26.3	30	30	26	66	26.8	30	30	26	67
												11146	11.5	1	13.8	34.6	35	35	33	73	35.1	40	40	34	74
	575-3-60	5.7	38.9	9				1.1	7.6	0.4	8.6	None	-	-	-	13	15	15	13	44	13.4	15	15	14	45
												11458	13.8	1	13.3	29.6	30	30	29	57	30	30	30	29	58
												12358	23	1	22.1	40.6	45	45	39	66	41	45	45	39	67

1. Minimum Circuit Ampacity.
2. Dual Element, Time Delay Type.
3. HACR type per NEC.
4. Non-fused Disconnect, Verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

XQE04-06 Medium Indoor Blower - Without Powered Convenience Outlet

Size (Tons)	Nominal Unit Voltage	Compressor 1		Compressor 2		OD Fan Motors (each)	Supply Blower Motor	Pwr Exh Motor	Pwr Conv Outlet	Electric Heat Field Installed Kit 2EK045*			MCA ¹ (Amps)	Min Fuse ² / Breaker ³ Size (Amps)	Max Fuse ² / Breaker ³ Size (Amps)	Min Disconnect Rating ⁴		MCA ¹ w/Pwr Exh (Amps)	Min Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Max Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Min Discon-nect Rating ⁴ / Pwr Exh				
										Model	kW	Stages				FLA	LRA				FLA	LRA			
		RLA	LRA	MCC	RLA	LRA	MCC																		
04 (3)	208-1-60	15.4	83.9	24				2.3	7.6	1.5		None	-	-	-	29.2	30	40	29	122	30.7	35	45	31	125
												10625	4.9	1	23.6	58.7	60	60	56	145	60.2	70	70	58	149
	230-1-60	15.4	83.9	24				2.3	7	1.3		None	-	-	-	28.6	30	40	28	124	29.9	30	45	30	127
												10625	6.5	1	27.1	62.5	70	70	60	152	63.8	70	70	61	154
	208-3-60	10.4	73	16				2.3	5.2	1.1		None	-	-	-	20.5	25	30	21	100	21.6	25	30	22	103
												10625	4.9	1	13.6	37.5	40	40	36	114	38.6	40	45	37	116
	230-3-60	10.4	73	16				2.3	5.2	1		11125	7.9	1	21.9	47.9	50	50	46	122	49	50	50	47	125
												11625	12	1	33.3	62.1	70	70	59	134	63.2	70	70	60	136
	460-3-60	5.8	38	9				1.3	2.6	0.5		None	-	-	-	20.5	25	30	21	103	21.5	25	30	22	105
												10625	6.5	1	15.6	40	40	45	39	119	41	45	45	40	121
	575-3-60	3.8	36.5	6				1.1	2	0.4		11125	10.5	1	25.3	52.1	60	60	50	128	53.1	60	60	51	131
												11625	16	1	38.5	68.6	70	70	65	142	69.6	70	70	66	144
05 (4)	208-1-60	19.6	130	31				2.3	7.6	1.5		None	-	-	-	34.4	35	50	34	168	35.9	40	50	36	171
												10625	4.9	1	23.6	63.9	70	70	61	191	65.4	70	70	63	195
	230-1-60	19.6	130	31				2.3	7	1.3		11125	7.9	1	38	81.9	90	90	78	206	83.4	90	90	79	209
	208-3-60	13.7	83.1	21				2.3	5.2	1.1		None	-	-	-	33.8	35	50	33	171	35.1	40	50	35	173
												10625	6.5	1	27.1	67.7	70	80	64	198	69	70	80	66	201
	230-3-60	13.7	83.1	21				2.3	5.2	1		11125	10.5	1	43.8	88.6	90	90	84	214	89.9	90	90	85	217
	460-3-60	6.2	41	10				1.3	2.6	0.5		None	-	-	-	24.6	25	35	24	110	25.7	30	35	26	113
												10625	4.9	1	13.6	41.6	45	50	40	124	42.7	45	50	41	126
	575-3-60	4.8	33	8				1.1	2	0.4		11125	7.9	1	21.9	52	60	60	50	132	53.1	60	60	51	135
												11625	12	1	33.3	66.2	70	70	63	144	67.3	70	70	64	146
	208-1-60	19.6	130	31				2.3	7.6	1.5		None	-	-	-	24.6	25	35	24	113	25.6	30	35	26	115
												10625	6.5	1	15.6	44.1	45	50	42	129	45.1	50	50	43	131
	230-3-60	13.7	83.1	21				2.3	5.2	1		11125	10.5	1	25.3	56.2	60	60	53	138	57.2	60	60	55	141
	460-3-60	6.2	41	10				1.3	2.6	0.5		None	-	-	-	11.7	15	15	12	56	12.2	15	15	12	58
												10646	6	1	7.2	20.7	25	25	20	64	21.2	25	25	20	65
	575-3-60	4.8	33	8				1.1	2	0.4		11146	11.5	1	13.8	29	30	30	27	70	29.5	30	30	28	71
												11446	14	1	16.8	32.7	35	35	31	73	33.2	35	35	32	74

XQE04-06 Medium Indoor Blower - Without Powered Convenience Outlet (Continued)

Size (Tons)	Nominal Unit Voltage	Compressor 1			Compressor 2			OD Fan Motors (each)	Supply Blower Motor	Pwr Exh Motor	Pwr Conv Outlet	Electric Heat Field Installed Kit 2EK045*				MCA ¹ (Amps)	Min Fuse ² / Breaker ³ Size (Amps)	Max Fuse ² / Breaker ³ Size (Amps)	Min Disconnect Rating ⁴		MCA ¹ w/Pwr Exh (Amps)	Min Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Max Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Min Discon-nect Rating ⁴ / Pwr Exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps	FLA	LRA				FLA	LRA			
		208-1-60	24.4	144. 2	38			2.3	6.8	1.5		None	-	-	-	39.6	40	60	39	182	41.1	45	60	40	185
06 (5)	208-1-60											10625	4.9	1	23.6	69.1	70	80	66	205	70.6	80	80	67	209
												11125	7.9	1	38	87.1	90	100	82	220	88.6	90	100	84	223
												None	-	-	-	39	40	60	38	182	40.3	45	60	39	185
	230-1-60	24.4	144. 2	38				2.3	6.2	1.3		10625	6.5	1	27.1	72.9	80	90	69	209	74.2	80	90	70	212
												11125	10.5	1	43.8	93.8	100	100	88	226	95.1	100	100	90	229
												None	-	-	-	29.3	30	45	29	175	30.4	35	45	30	177
	208-3-60	16	110	25				2.3	7	1.1		10625	4.9	1	13.6	46.3	50	50	45	189	47.4	50	60	46	191
												11125	7.9	1	21.9	56.7	60	60	54	197	57.8	60	60	56	199
												11625	12	1	33.3	70.9	80	80	67	208	72	80	80	69	211
	230-3-60	16	110	25				2.3	7.2	1		None	-	-	-	29.5	30	45	29	177	30.5	35	45	30	179
												10625	6.5	1	15.6	49	50	60	47	192	50	50	60	48	195
												11125	10.5	1	25.3	61.1	70	70	58	202	62.1	70	70	60	204
	460-3-60	7.8	52	12				1.3	3.6	0.5		11625	16	1	38.5	77.6	80	80	74	215	78.6	80	80	75	218
												None	-	-	-	14.7	15	20	15	86	15.2	20	20	15	87
												10646	6	1	7.2	23.7	25	25	23	93	24.2	25	25	23	94
	575-3-60											11146	11.5	1	13.8	32	35	35	30	100	32.5	35	35	31	101
												11446	14	1	16.8	35.7	40	40	34	103	36.2	40	40	35	104
												None	-	-	-	10.7	15	15	11	59	11.1	15	15	11	60
	575-3-60	5.7	38.9	9				1.1	2.5	0.4		11458	13.8	1	13.3	27.3	30	30	26	72	27.7	30	30	26	73
												12358	23	1	22.1	38.3	40	40	36	81	38.7	40	40	37	82

1. Minimum Circuit Ampacity.
2. Dual Element, Time Delay Type.
3. HACR type per NEC.
4. Non-fused Disconnect, Verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

XQE04-06 Medium Indoor Blower - With Powered Convenience Outlet

Size (Tons)	Nominal Unit Voltage	Compressor 1			Compressor 2			OD Fan Motors (each)	Supply Blower Motor	Pwr Exh Motor	Pwr Conv Outlet	Electric Heat Field Installed Kit 2EK045*			MCA ¹ (Amps)	Min Fuse ² / Breaker ³ Size (Amps)	Max Fuse ² / Breaker ³ Size (Amps)	Min Disconnect Rating ⁴		MCA ¹ w/Pwr Exh (Amps)	Min Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Max Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Min Discon-nect Rating ⁴ / Pwr Exh		
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps			FLA	LRA						
																		FLA	LRA						
04 (3)	208-1-60	15.4	83.9	24				2.3	7.6	1.5	8.6	None	-	-	-	33.5	35	45	34	126	35	50	36	129	
												10625	4.9	1	23.6	63	70	70	61	150	64.5	70	70	63	153
												11125	7.9	1	38	81	90	90	78	164	82.5	90	90	79	167
	230-1-60	15.4	83.9	24				2.3	7	1.3	8.6	None	-	-	-	32.9	35	45	33	129	34.2	35	45	35	132
												10625	6.5	1	27.1	66.8	70	70	65	156	68.1	70	70	66	159
												11125	10.5	1	43.8	87.7	90	90	84	173	89	90	90	85	175
	208-3-60	10.4	73	16				2.3	5.2	1.1	8.6	None	-	-	-	24.8	25	35	26	105	25.9	30	35	27	107
												10625	4.9	1	13.6	41.8	45	45	41	118	42.9	45	45	42	121
												11125	7.9	1	21.9	52.2	60	60	51	126	53.3	60	60	52	129
												11625	12	1	33.3	66.4	70	70	64	138	67.5	70	70	65	140
	230-3-60	10.4	73	16				2.3	5.2	1	8.6	None	-	-	-	24.8	25	35	26	107	25.8	30	35	27	110
												10625	6.5	1	15.6	44.3	45	50	43	123	45.3	50	50	45	125
												11125	10.5	1	25.3	56.4	60	60	55	133	57.4	60	60	56	135
												11625	16	1	38.5	72.9	80	80	70	146	73.9	80	80	71	148
05 (4)	460-3-60	5.8	38	9				1.3	2.6	0.5	8.6	None	-	-	-	13.4	15	15	14	56	13.9	15	15	14	57
												10646	6	1	7.2	22.4	25	25	22	63	22.9	25	25	23	64
												11146	11.5	1	13.8	30.7	35	35	30	69	31.2	35	35	30	70
												11446	14	1	16.8	34.4	35	35	33	72	34.9	35	35	34	73
												None	-	-	-	9.6	15	15	10	51	10	15	15	10	51
												11058	9.2	1	8.9	20.7	25	25	20	59	21.1	25	25	21	60
												11458	13.8	1	13.3	26.2	30	30	25	64	26.6	30	30	26	65
	208-1-60	19.6	130	31				2.3	7.6	1.5	8.6	None	-	-	-	38.7	40	50	39	172	40.2	45	50	41	176
												10625	4.9	1	23.6	68.2	70	80	66	196	69.7	70	80	68	199
												11125	7.9	1	38	86.2	90	90	83	210	87.7	90	90	84	214
	230-1-60	19.6	130	31				2.3	7	1.3	8.6	None	-	-	-	38.1	40	50	38	175	39.4	40	50	40	178
												10625	6.5	1	27.1	72	80	80	69	202	73.3	80	80	71	205
												11125	10.5	1	43.8	92.9	100	100	89	219	94.2	100	100	90	222
05 (4)	208-3-60	13.7	83.1	21				2.3	5.2	1.1	8.6	None	-	-	-	28.9	30	40	29	115	30	30	40	31	117
												10625	4.9	1	13.6	45.9	50	50	45	128	47	50	50	46	131
												11125	7.9	1	21.9	56.3	60	60	55	137	57.4	60	60	56	139
												11625	12	1	33.3	70.5	80	80	68	148	71.6	80	80	69	150
												None	-	-	-	28.9	30	40	29	117	29.9	30	40	30	120
												10625	6.5	1	15.6	48.4	50	50	47	133	49.4	50	50	48	135
												11125	10.5	1	25.3	60.5	70	70	58	143	61.5	70	70	60	145
												11625	16	1	38.5	77	80	80	74	156	78	80	80	75	158
												None	-	-	-	13.9	15	20	14	59	14.4	15	20	15	60
												10646	6	1	7.2	22.9	25	25	22	66	23.4	25	25	23	67
												11146	11.5	1	13.8	31.2	35	35	30	72	31.7	35	35	31	73
												11446	14	1	16.8	34.9	35	35	33	75	35.4	40	40	34	76
575-3-60		4.8	33	8				1.1	2	0.4	8.6	None	-	-	-	10.8	15	15	11	47	11.2	15	15	12	48
												11058	9.2	1	8.9	21.9	25	25	21	56	22.3	25	25	22	57
												11458	13.8	1	13.3	27.4	30	30	26	60	27.8	30	30	27	61

XQE04-06 Medium Indoor Blower - With Powered Convenience Outlet (Continued)

Size (Tons)	Nominal Unit Voltage	Compressor 1			Compressor 2			OD Fan Motors (each)	Supply Blower Motor	Pwr Exh Motor	Pwr Conv Outlet	Electric Heat Field Installed Kit 2EK045*				MCA ¹ (Amps)	Min Fuse ² / Breaker ³ Size (Amps)	Max Fuse ² / Breaker ³ Size (Amps)	Min Disconnect Rating ⁴		MCA ¹ w/Pwr Exh (Amps)	Min Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Max Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Min Discon-nect Rating ⁴ / Pwr Exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps				FLA	LRA			FLA	LRA	
06 (5)	208-1-60	24.4	144. 2	38				2.3	6.8	1.5	8.6	None	-	-	-	43.9	45	60	43	186	45.4	50	60	45	189
												10625	4.9	1	23.6	73.4	80	90	71	209	74.9	80	90	72	213
												11125	7.9	1	38	91.4	100	100	87	224	92.9	100	100	89	227
	230-1-60	24.4	144. 2	38				2.3	6.2	1.3	8.6	None	-	-	-	43.3	45	60	43	187	44.6	45	60	44	189
												10625	6.5	1	27.1	77.2	80	90	74	214	78.5	80	90	75	217
												11125	10.5	1	43.8	98.1	100	110	93	230	99.4	100	110	95	233
	208-3-60	16	110	25				2.3	7	1.1	8.6	None	-	-	-	33.6	35	45	34	179	34.7	35	50	35	182
												10625	4.9	1	13.6	50.6	60	60	50	193	51.7	60	60	51	195
												11125	7.9	1	21.9	61	70	70	59	201	62.1	70	70	60	204
	230-3-60	16	110	25				2.3	7.2	1	8.6	None	-	-	-	33.8	35	45	34	181	34.8	35	50	35	183
												10625	6.5	1	15.6	53.3	60	60	52	197	54.3	60	60	53	199
												11125	10.5	1	25.3	65.4	70	70	63	206	66.4	70	70	65	209
	460-3-60	7.8	52	12				1.3	3.6	0.5	8.6	None	-	-	-	16.9	20	20	17	88	17.4	20	20	18	89
												10646	6	1	7.2	25.9	30	30	25	95	26.4	30	30	26	96
												11146	11.5	1	13.8	34.2	35	35	33	102	34.7	35	35	34	103
	575-3-60	5.7	38.9	9				1.1	2.5	0.4	8.6	None	-	-	-	12.4	15	15	13	61	12.8	15	15	13	62
												11458	13.8	1	13.3	29	30	30	28	74	29.4	30	30	28	75
												12358	23	1	22.1	40	40	40	38	83	40.4	45	45	39	84

1. Minimum Circuit Ampacity.
2. Dual Element, Time Delay Type.
3. HACR type per NEC.
4. Non-fused Disconnect, Verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

XQE04-06 High Indoor Blower - Without Powered Convenience Outlet

Size (Tons)	Nominal Unit Voltage	Compressor 1		Compressor 2		OD Fan Motors (each)	Supply Blower Motor	Pwr Exh Motor	Pwr Conv Outlet	Electric Heat Field Installed Kit 2EK045*			MCA ¹ (Amps)	Min Fuse ² / Breaker ³ Size (Amps)	Max Fuse ² / Breaker ³ Size (Amps)	Min Disconnect Rating ⁴		MCA ¹ w/Pwr Exh (Amps)	Min Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Max Fuse ² / Breaker ³ Size w/ Pwr Exh (Amps)	Min Discon-nect Rating ⁴ / Pwr Exh			
		RLA	LRA	MCC	RLA	LRA	MCC			Model	kW	Stages				FLA	LRA				FLA	LRA		
		None	-	-	-	2.3	5.2	1.1		None	-	-	20.5	25	30	21	100	21.6	25	30	22	103		
04 (3)	208-3-60	10.4	73	16						10625	4.9	1	13.6	37.5	40	40	36	114	38.6	40	45	37	116	
		11125	7.9	1	21.9					11125	7.9	1	21.9	47.9	50	50	46	122	49	50	50	47	125	
		11625	12	1	33.3					11625	12	1	33.3	62.1	70	70	59	134	63.2	70	70	70	60	136
	230-3-60	10.4	73	16						None	-	-	-	20.5	25	30	21	103	21.5	25	30	22	105	
		10625	6.5	1	15.6					10625	6.5	1	15.6	40	40	40	45	39	119	41	45	45	40	121
		11125	10.5	1	25.3					11125	10.5	1	25.3	52.1	60	60	50	128	53.1	60	60	60	51	131
		11625	16	1	38.5					11625	16	1	38.5	68.6	70	70	65	142	69.6	70	70	70	66	144
	460-3-60	5.8	38	9						None	-	-	-	11.2	15	15	11	53	11.7	15	15	12	55	
		10646	6	1	7.2					10646	6	1	7.2	20.2	25	25	19	61	20.7	25	25	20	62	
		11146	11.5	1	13.8					11146	11.5	1	13.8	28.5	30	30	27	67	29	30	30	28	68	
		11446	14	1	16.8					11446	14	1	16.8	32.2	35	35	30	70	32.7	35	35	31	71	
05 (4)	575-3-60	3.8	36.5	6						None	-	-	-	7.9	15	15	8	49	8.3	15	15	8	50	
		11058	9.2	1	8.9					11058	9.2	1	8.9	19	20	20	20	18	58	19.4	20	20	19	59
		11458	13.8	1	13.3					11458	13.8	1	13.3	24.5	25	25	23	62	24.9	25	25	24	63	
	208-3-60	13.7	83.1	21						None	-	-	-	24.6	25	35	24	110	25.7	30	35	26	113	
		10625	4.9	1	13.6					10625	4.9	1	13.6	41.6	45	50	40	124	42.7	45	50	41	126	
		11125	7.9	1	21.9					11125	7.9	1	21.9	52	60	60	50	132	53.1	60	60	51	135	
		11625	12	1	33.3					11625	12	1	33.3	66.2	70	70	63	144	67.3	70	70	64	146	
	230-3-60	13.7	83.1	21						None	-	-	-	24.6	25	35	24	113	25.6	30	35	26	115	
		10625	6.5	1	15.6					10625	6.5	1	15.6	44.1	45	50	42	129	45.1	50	50	43	131	
		11125	10.5	1	25.3					11125	10.5	1	25.3	56.2	60	60	53	138	57.2	60	60	55	141	
		11625	16	1	38.5					11625	16	1	38.5	72.7	80	80	69	152	73.7	80	80	70	154	
06 (5)	460-3-60	6.2	41	10						None	-	-	-	11.7	15	15	12	56	12.2	15	15	12	58	
		10646	6	1	7.2					10646	6	1	7.2	20.7	25	25	20	64	21.2	25	25	20	65	
		11146	11.5	1	13.8					11146	11.5	1	13.8	29	30	30	27	70	29.5	30	30	28	71	
		11446	14	1	16.8					11446	14	1	16.8	32.7	35	35	31	73	33.2	35	35	32	74	
	575-3-60	4.8	33	8						None	-	-	-	9.1	15	15	9	45	9.5	15	15	10	46	
		11058	9.2	1	8.9					11058	9.2	1	8.9	20.2	25	25	19	54	20.6	25	25	20	55	
		11458	13.8	1	13.3					11458	13.8	1	13.3	25.7	30	30	24	59	26.1	30	30	25	60	
	208-3-60	16	110	25						None	-	-	-	31.2	35	45	31	192	32.3	35	45	33	194	
		10625	4.9	1	13.6					10625	4.9	1	13.6	48.2	50	60	47	205	49.3	50	60	48	208	
		11125	7.9	1	21.9					11125	7.9	1	21.9	58.6	60	60	56	214	59.7	60	70	58	216	
	230-3-60	16	110	25						None	-	-	-	30.5	35	45	30	194	31.5	35	45	32	196	
06 (5)		10625	6.5	1	15.6					10625	6.5	1	15.6	50	50	60	48	210	51	60	60	50	212	
		11125	10.5	1	25.3					11125	10.5	1	25.3	62.1	70	70	60	219	63.1	70	70	61	222	
		11625	16	1	38.5					11625	16	1	38.5	78.6	80	80	75	233	79.6	80	80	76	235	
	460-3-60	7.8	52	12						None	-	-	-	15.2	20	20	15	89	15.7	20	20	16	91	
		10646	6	1	7.2					10646	6	1	7.2	24.2	25	30	23	97	24.7	25	30	24	98	
		11146	11.5	1	13.8					11146	11.5	1	13.8	32.5	35	35	31	103	33	35	35	32	104	
		11446	14	1	16.8					11446	14	1	16.8	36.2	40	40	35	106	36.7	40	40	35	107	
	575-3-60	5.7	38.9	9						None	-	-	-	11.4	15	15	12	67	11.8	15	15	12	68	
		11458	13.8	1	13.3					11458	13.8	1	13.3	28	30	30	27	81	28.4	30	30	27	82	
		12358	23	1	22.1					12358	23	1	22.1	39	40	40	37	89	39.4	40	40	37	90	

1. Minimum Circuit Ampacity.
2. Dual Element, Time Delay Type.
3. HACR type per NEC.
4. Non-fused Disconnect, Verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.


XQE04-06 High Indoor Blower - With Powered Convenience Outlet

1. Minimum Circuit Ampacity.
 2. Dual Element, Time Delay Type.
 3. HACR type per NEC.
 4. Non-fused Disconnect, Verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.


Typical Wiring Diagrams

XYE04-09, XXEA7-12, XQE04-06 Typical Wiring Diagrams


Typical XYE04-06, XQE04-06 Heat Pump w/o Heat 208/230-1-60 Direct Drive Elementary Diagram Power Circuit

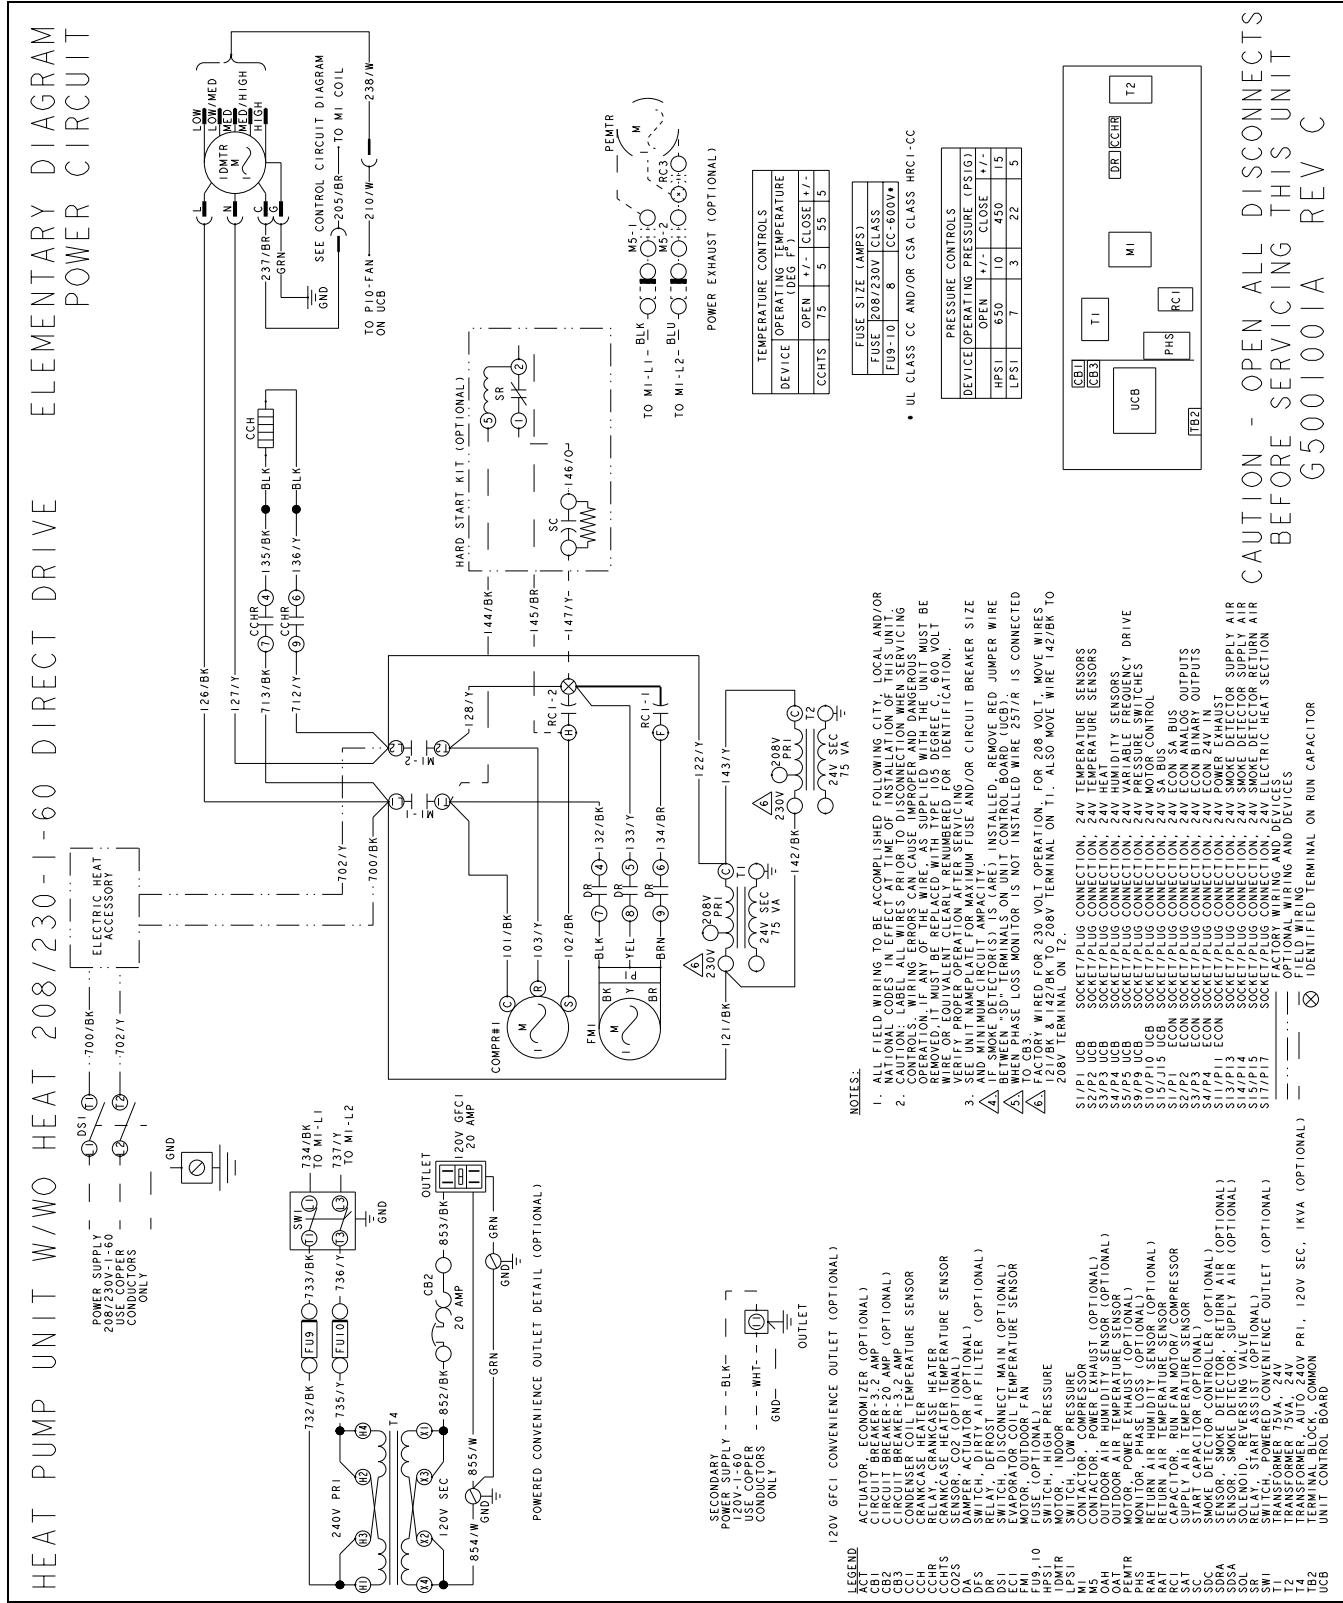


Typical XYE04-06, XQE04-06 Heat Pump w/o Heat 208/230, 460-3-60 Direct Drive Elementary Diagram Power Circuit

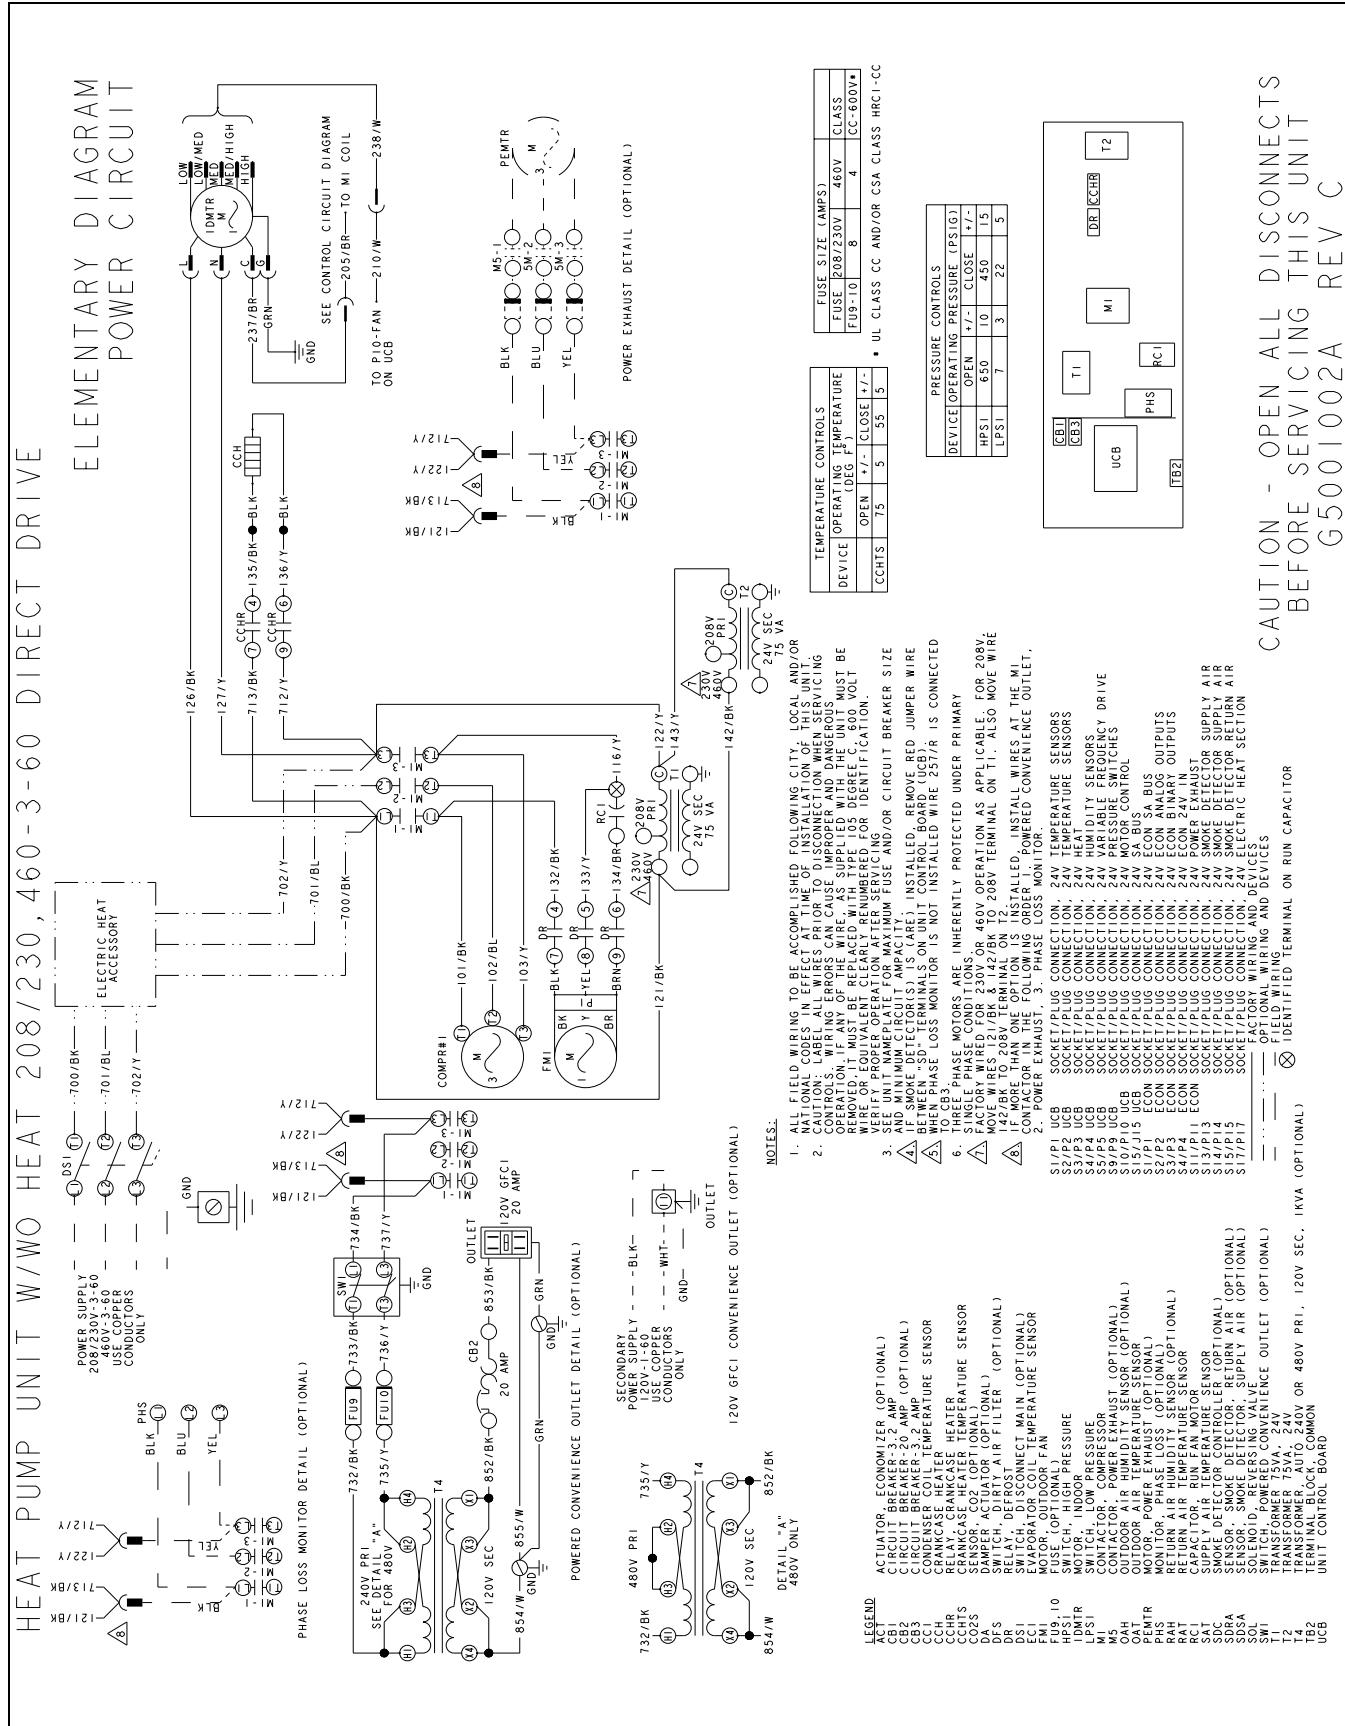


Typical XYE04-06, XQE04-06 Cooling Unit w/o Heat 575-3-60 Direct Drive Elementary Diagram Power Circuit

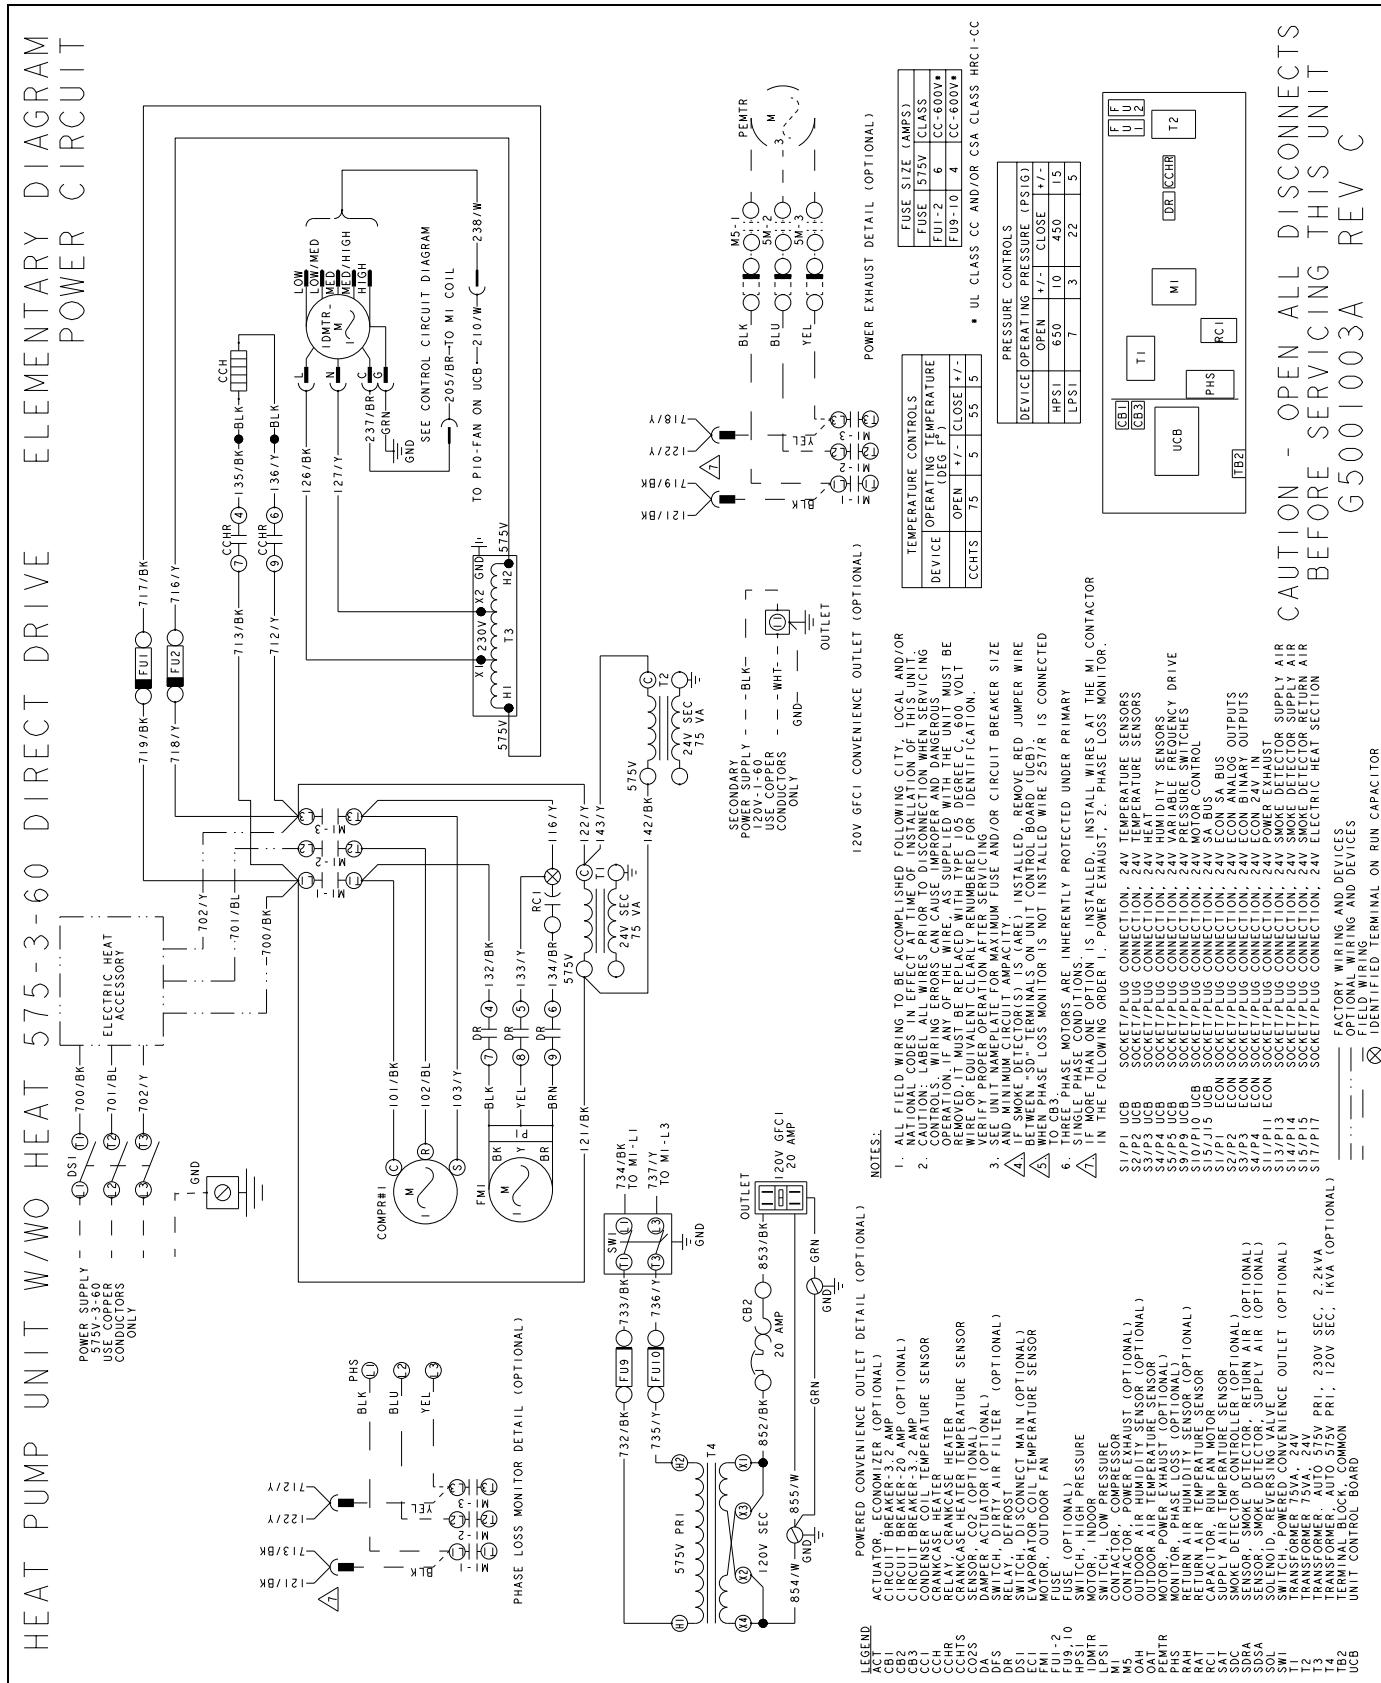


Typical XYE04-06, XQE04-06 Heat Pump Unit w/o Heat 208/230-1-60 Belt Drive Elementary Diagram Power Circuit

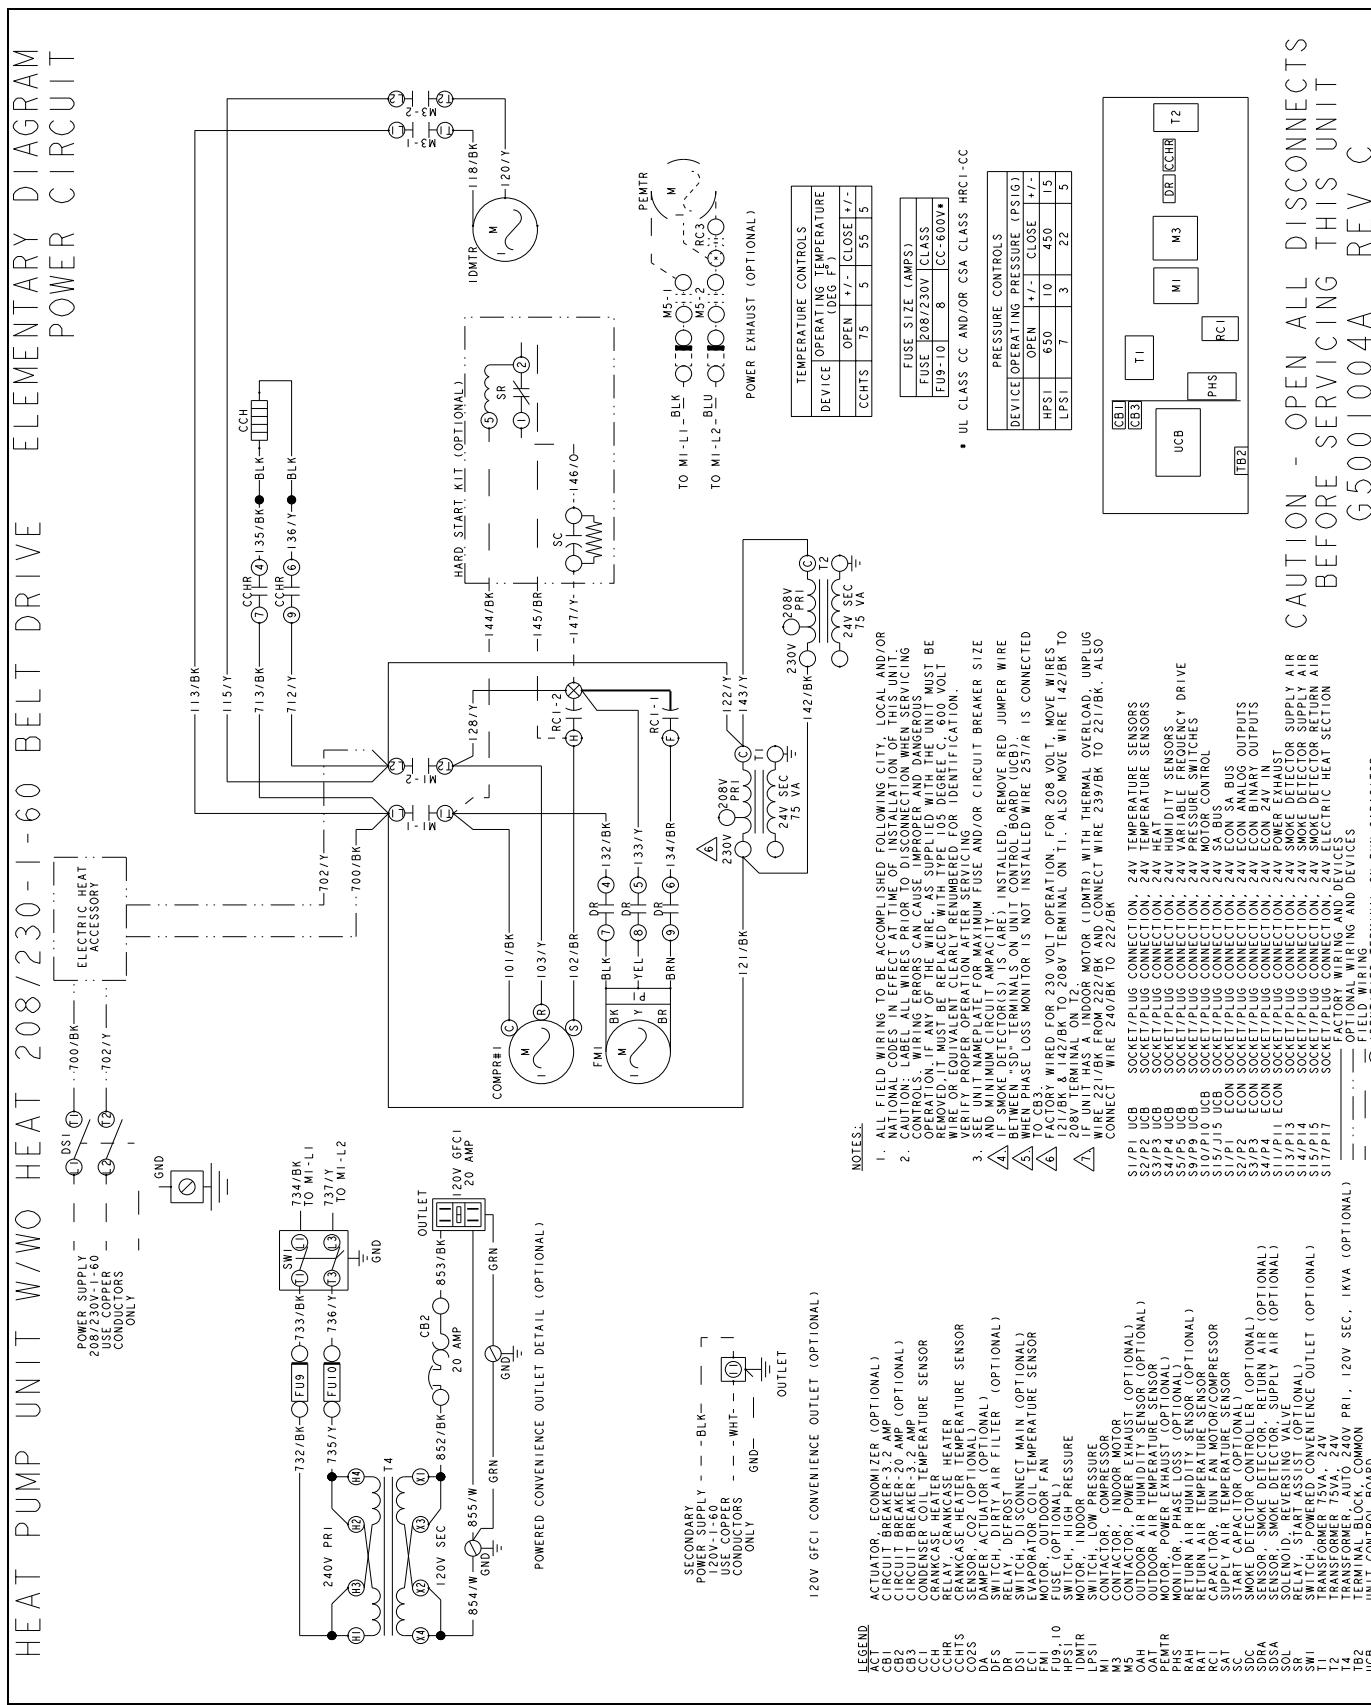


Typical XYE04-06, XQE04-06 Unit w/o Heat 208/230, 460, 575-3-60 Belt Drive Elementary Diagram Power Circuit

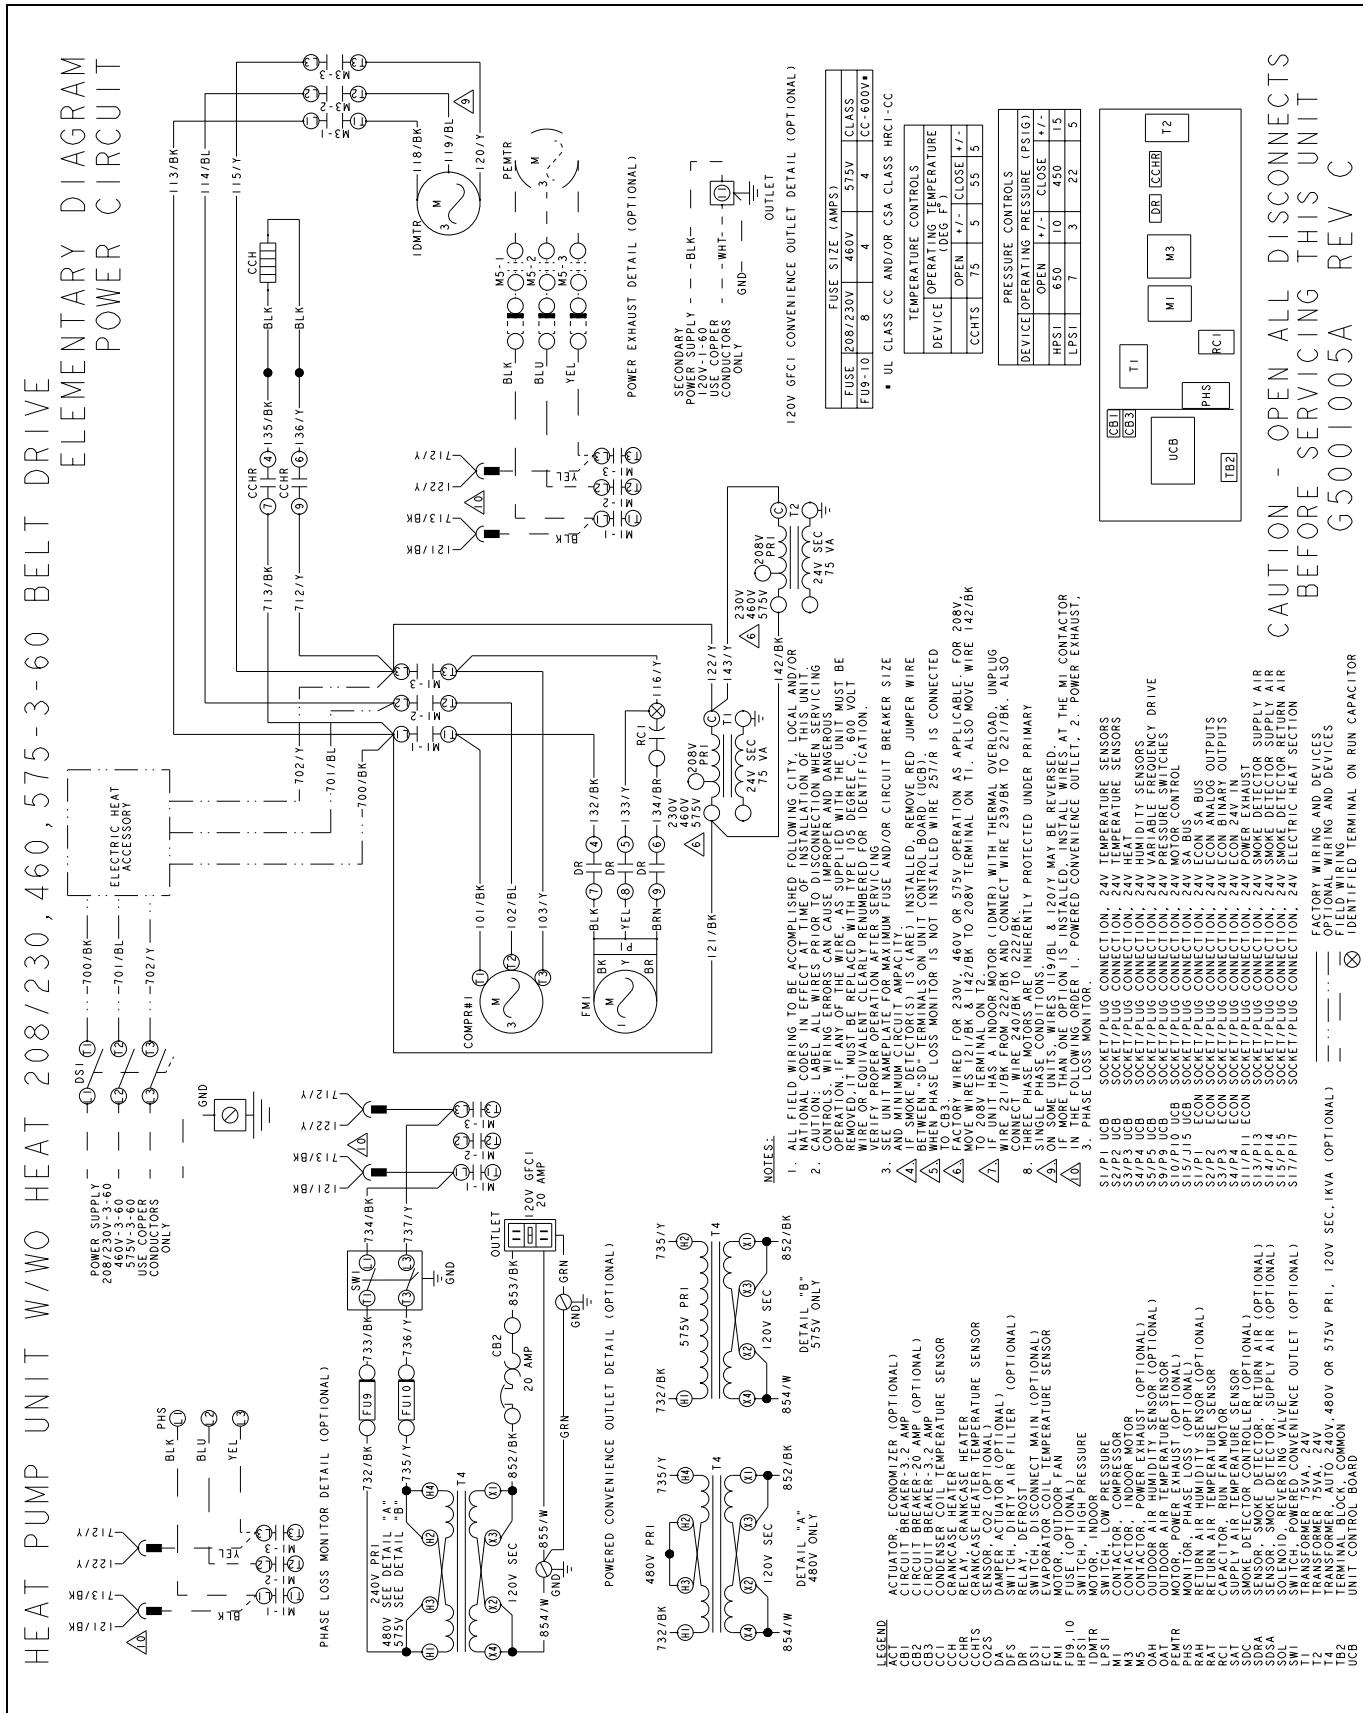


Typical XYE04-06, XQE04-06 Heat Pump Unit Direct Drive Elementary Diagram Control Circuit

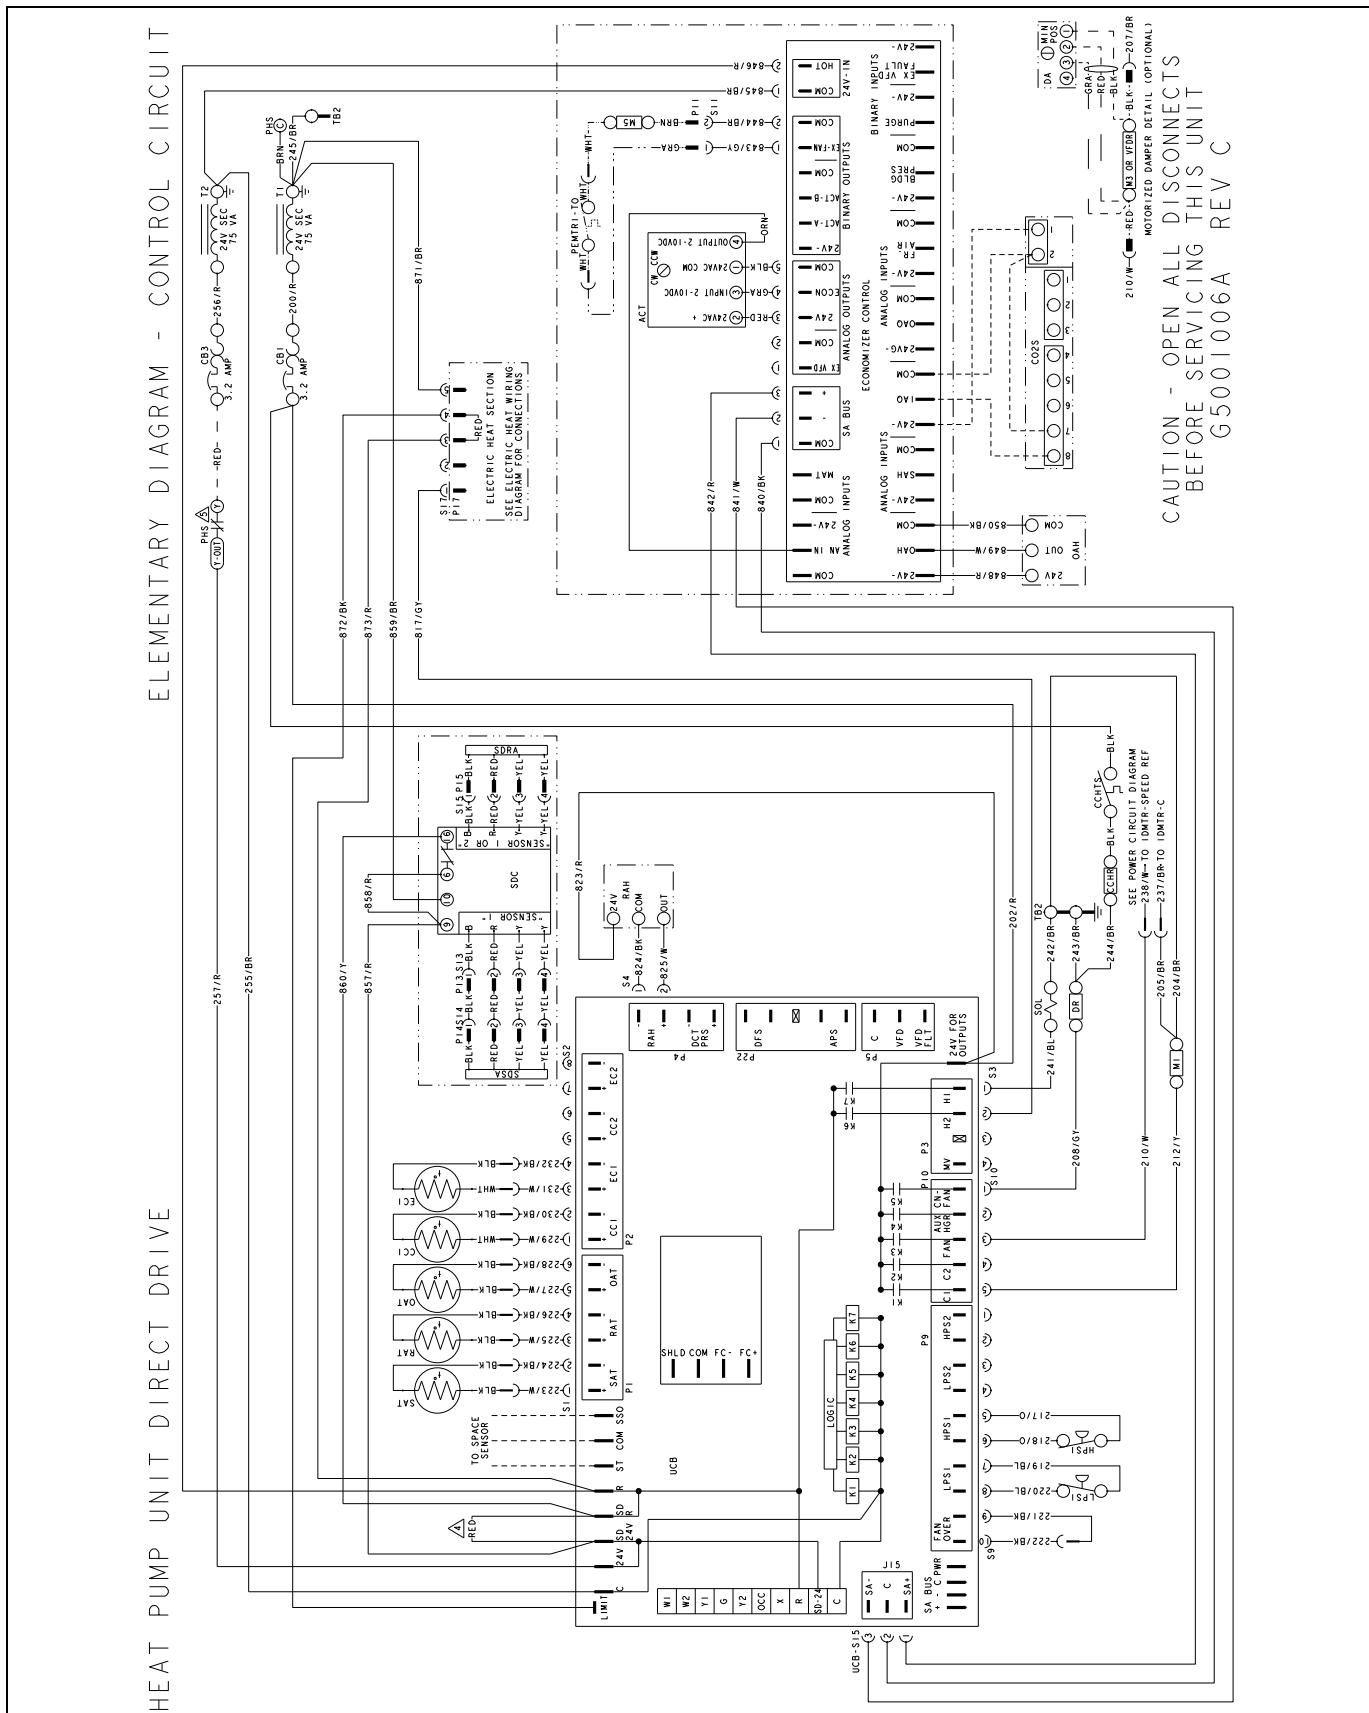


Typical XYE04-06, XXEA7, XQE04-06 Heat Pump Unit Belt Drive Elementary Diagram Control Circuit

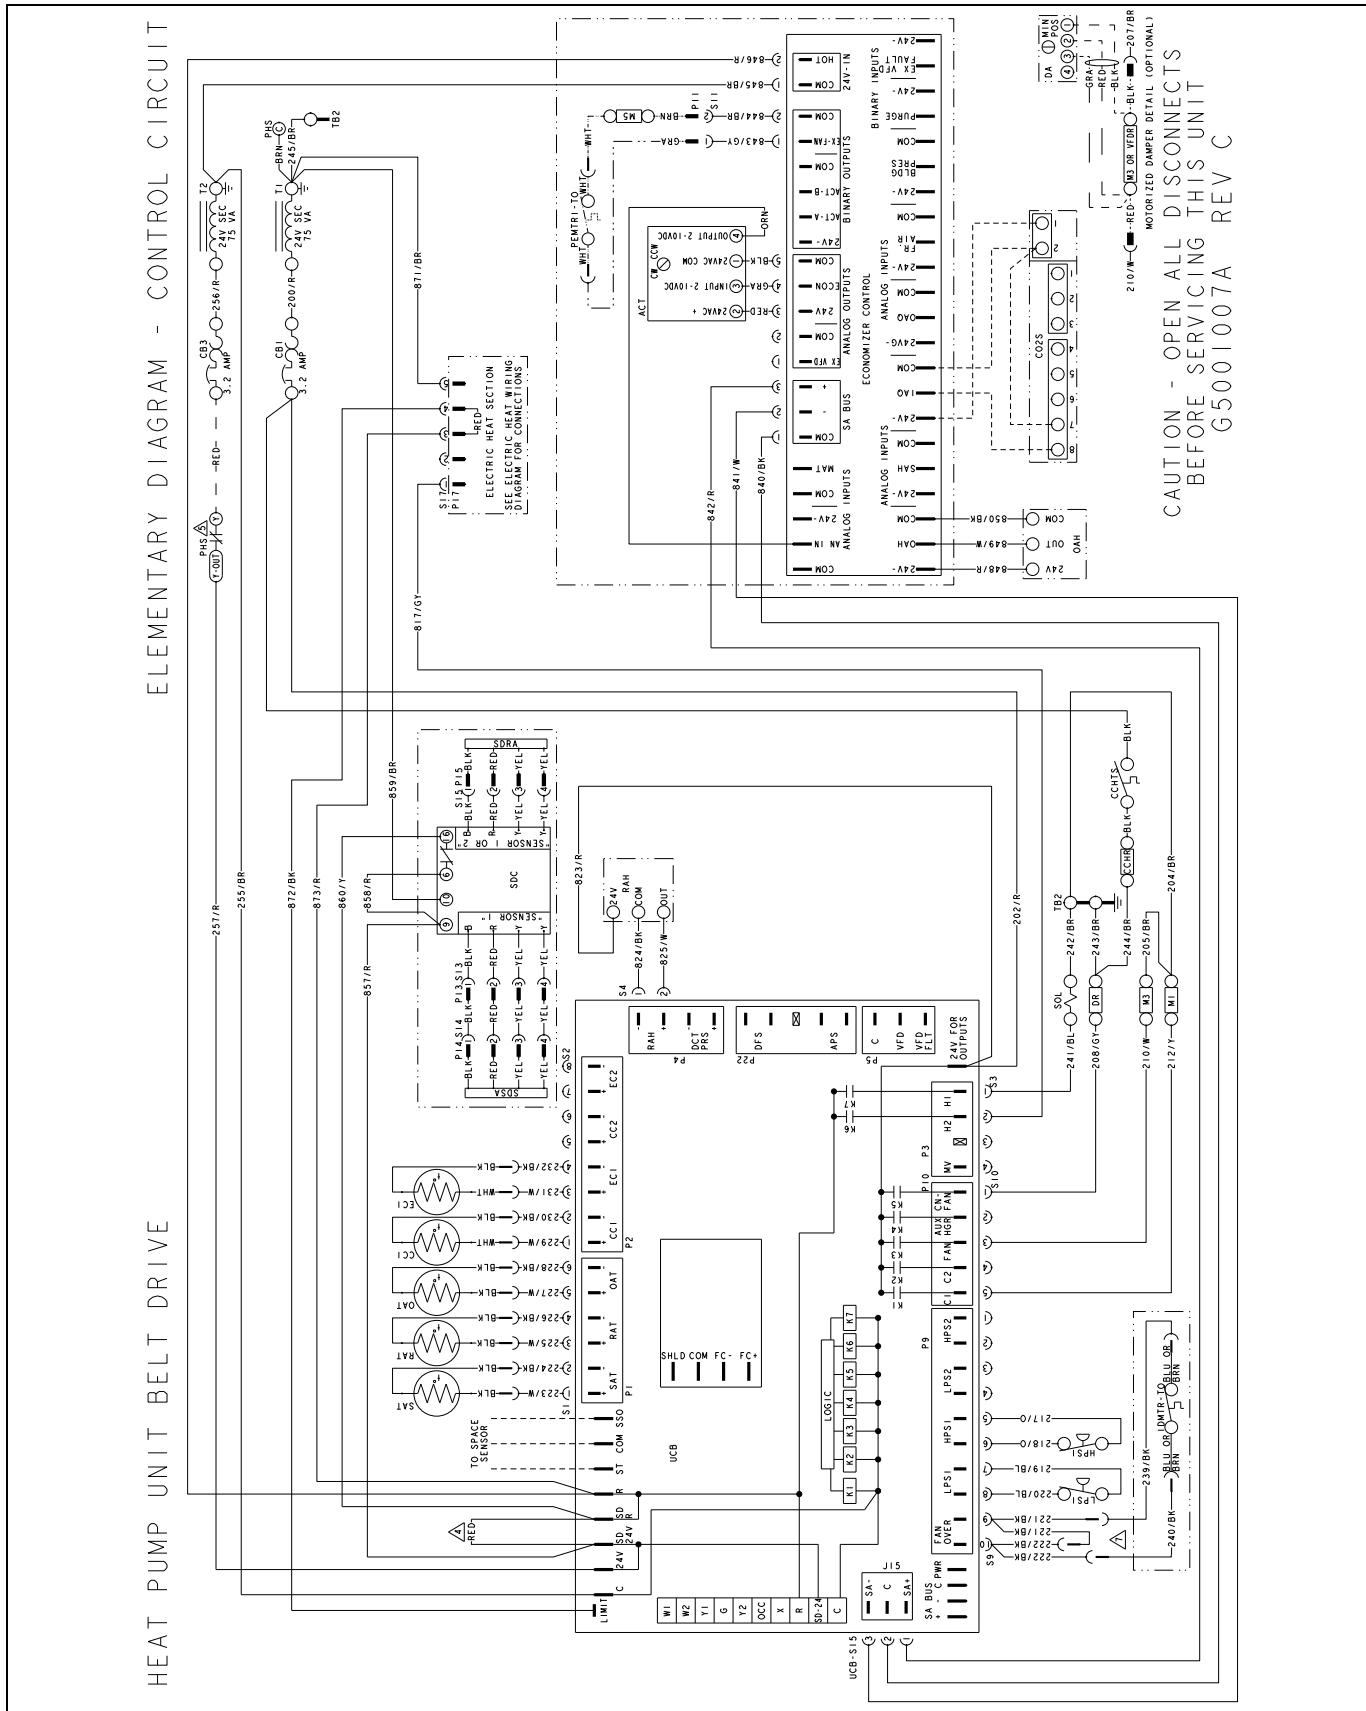


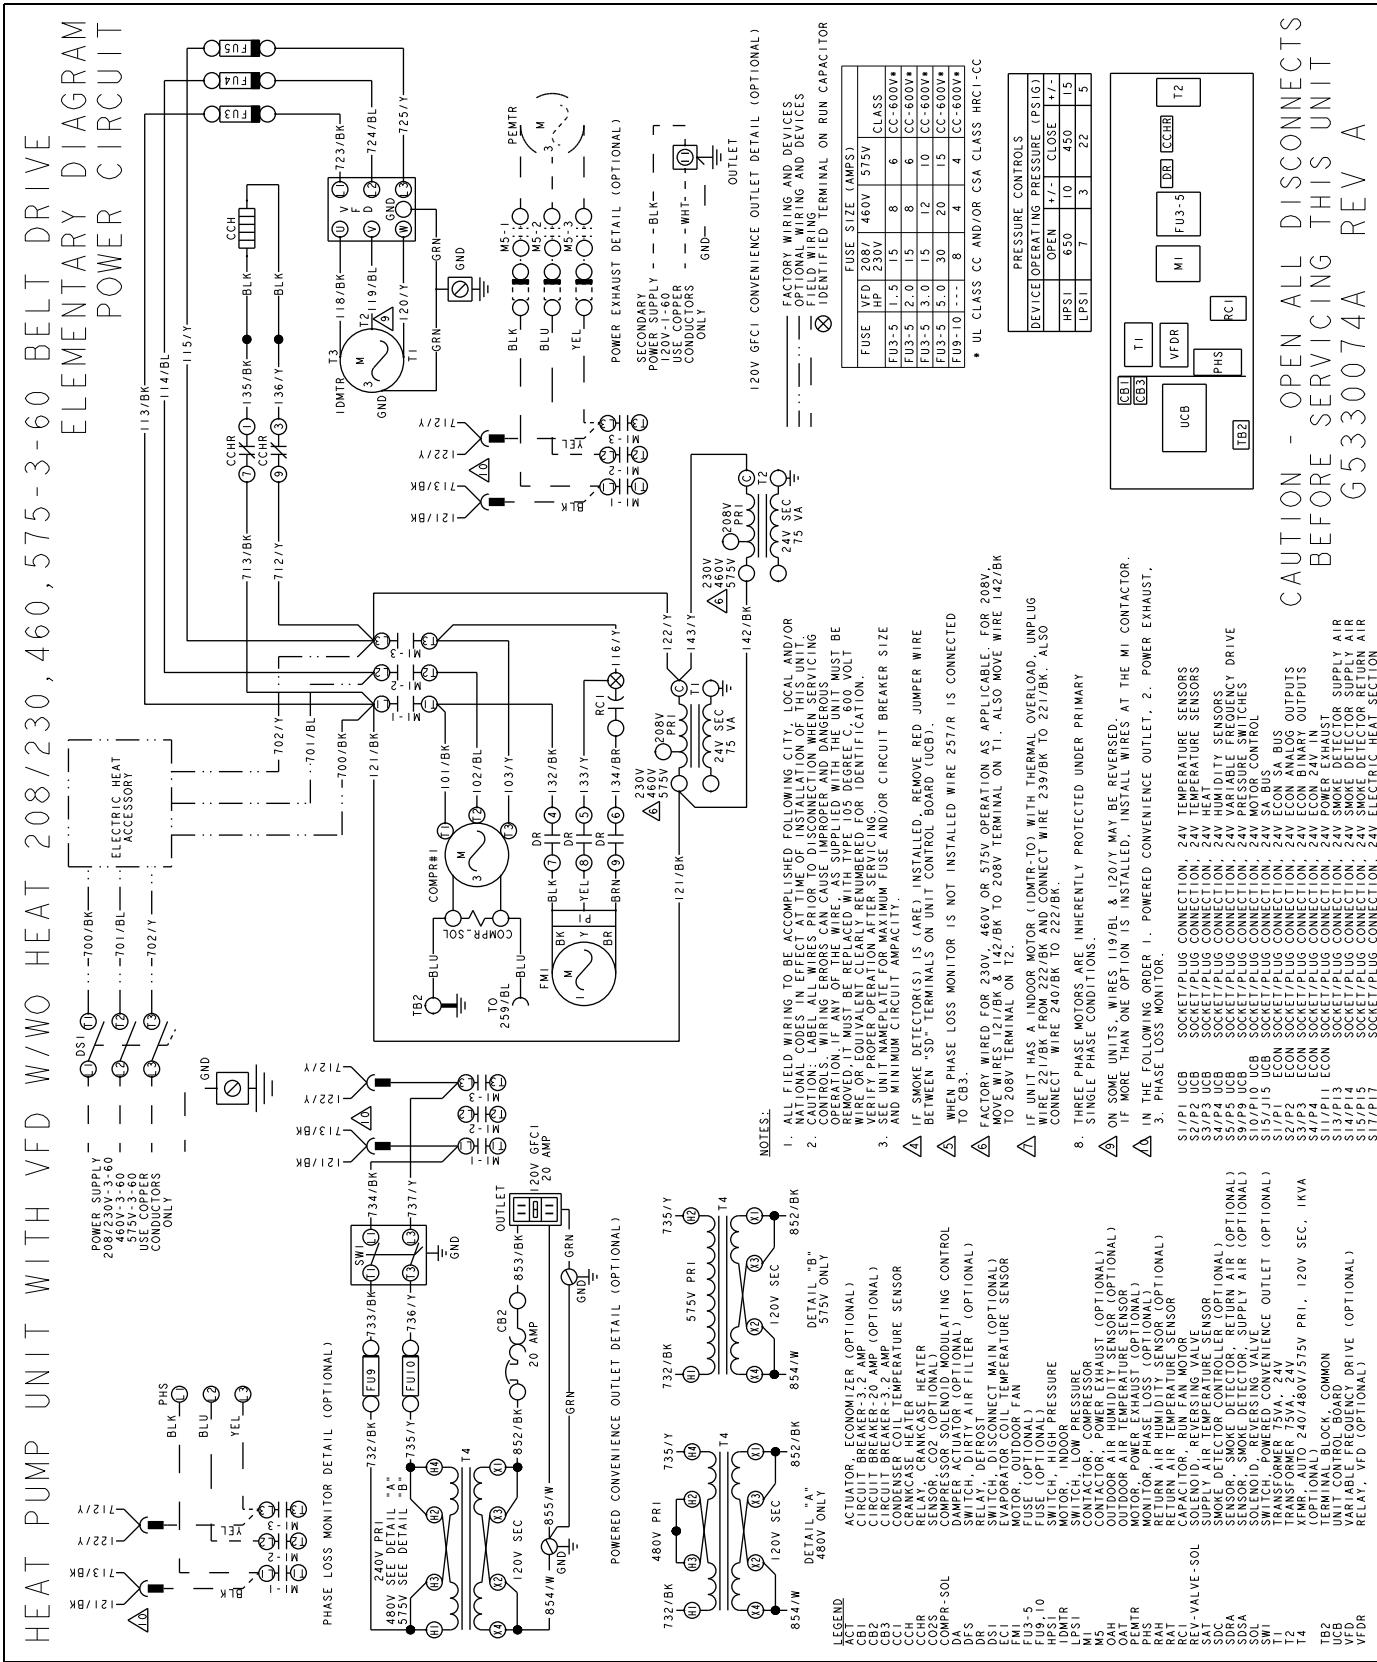Typical XXEA7 Heat Pump Unit w/o heat 208/230, 460, 575-3-60 Belt Drive with VFD Elementary Diagram Power Circuit


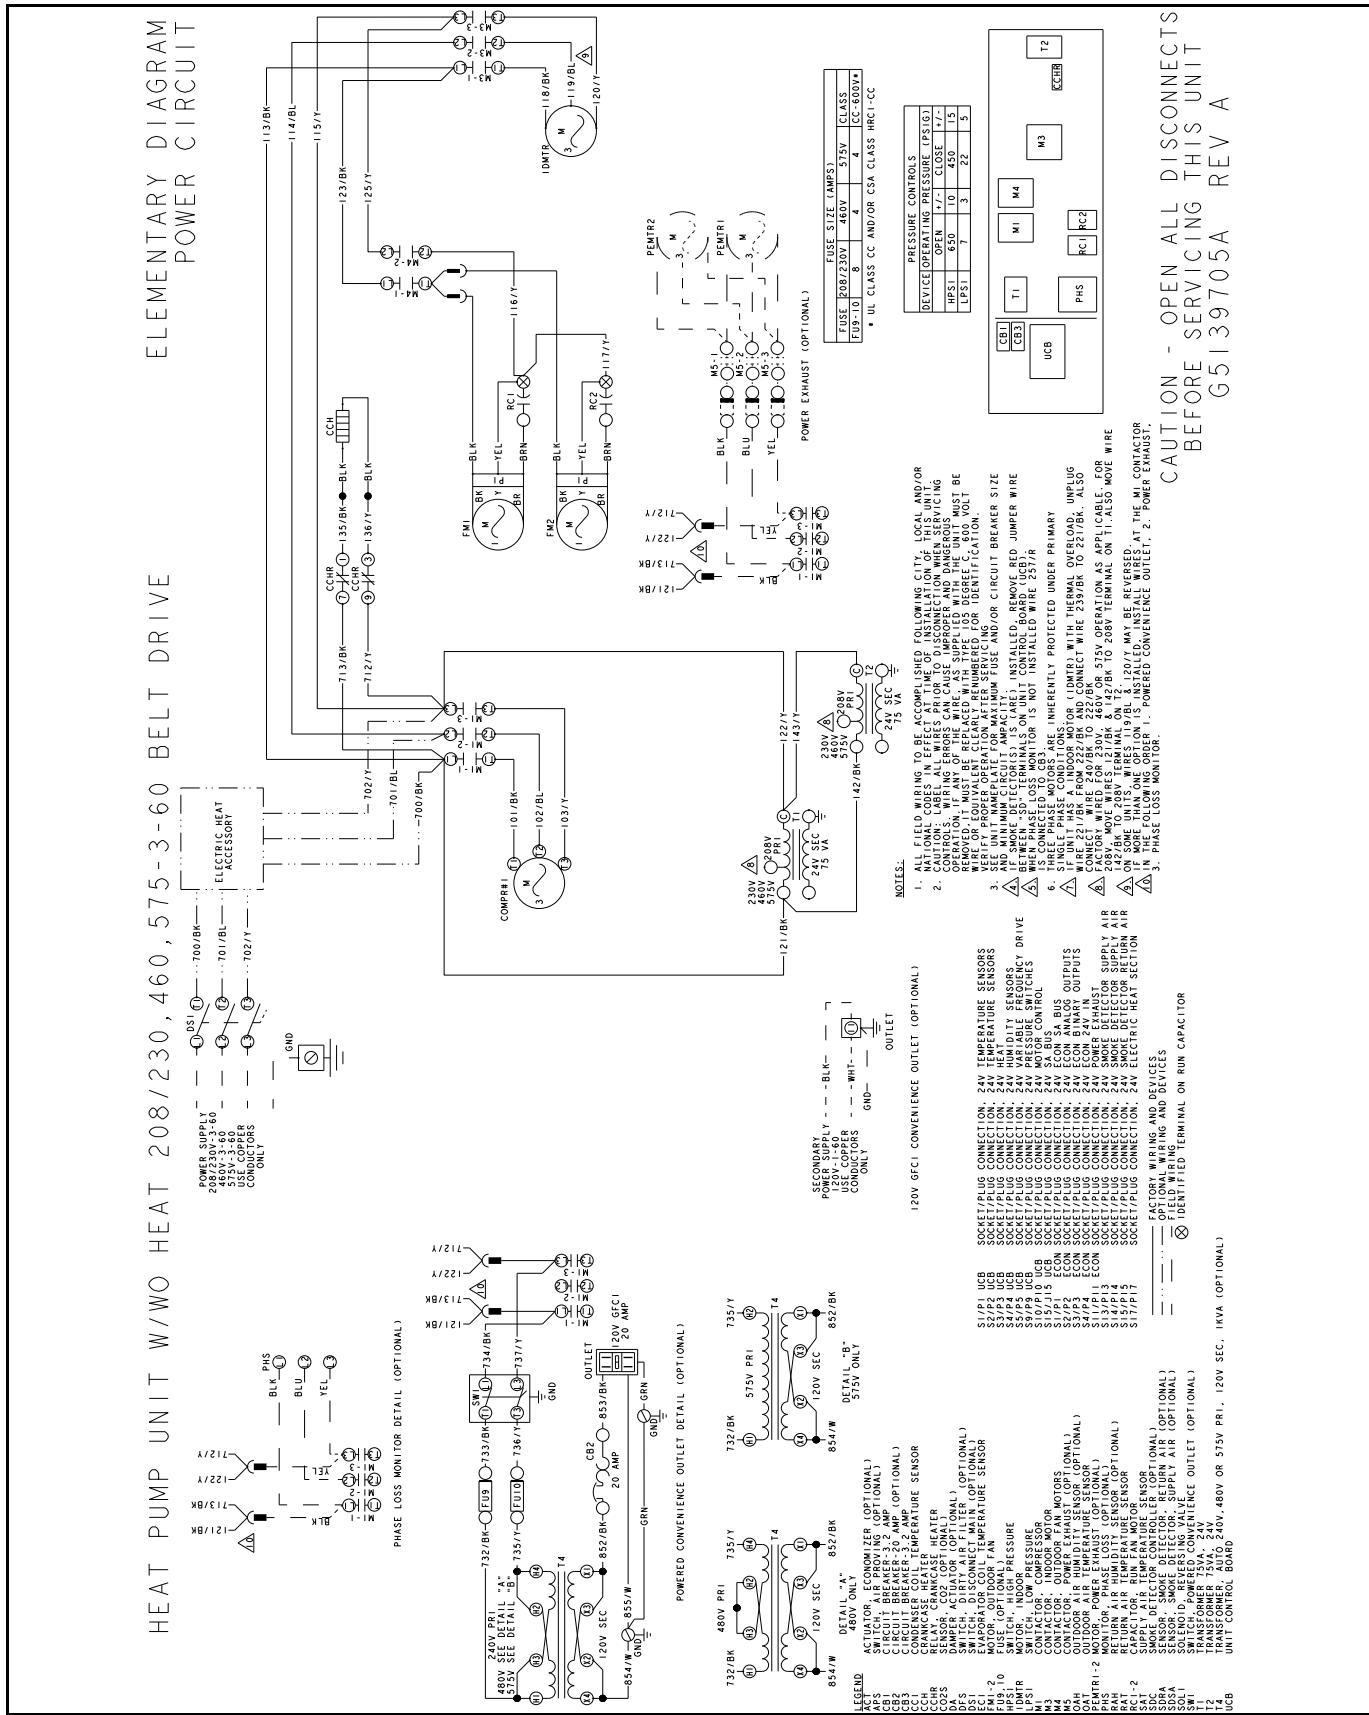
Typical FDD Elementary Wiring Diagram

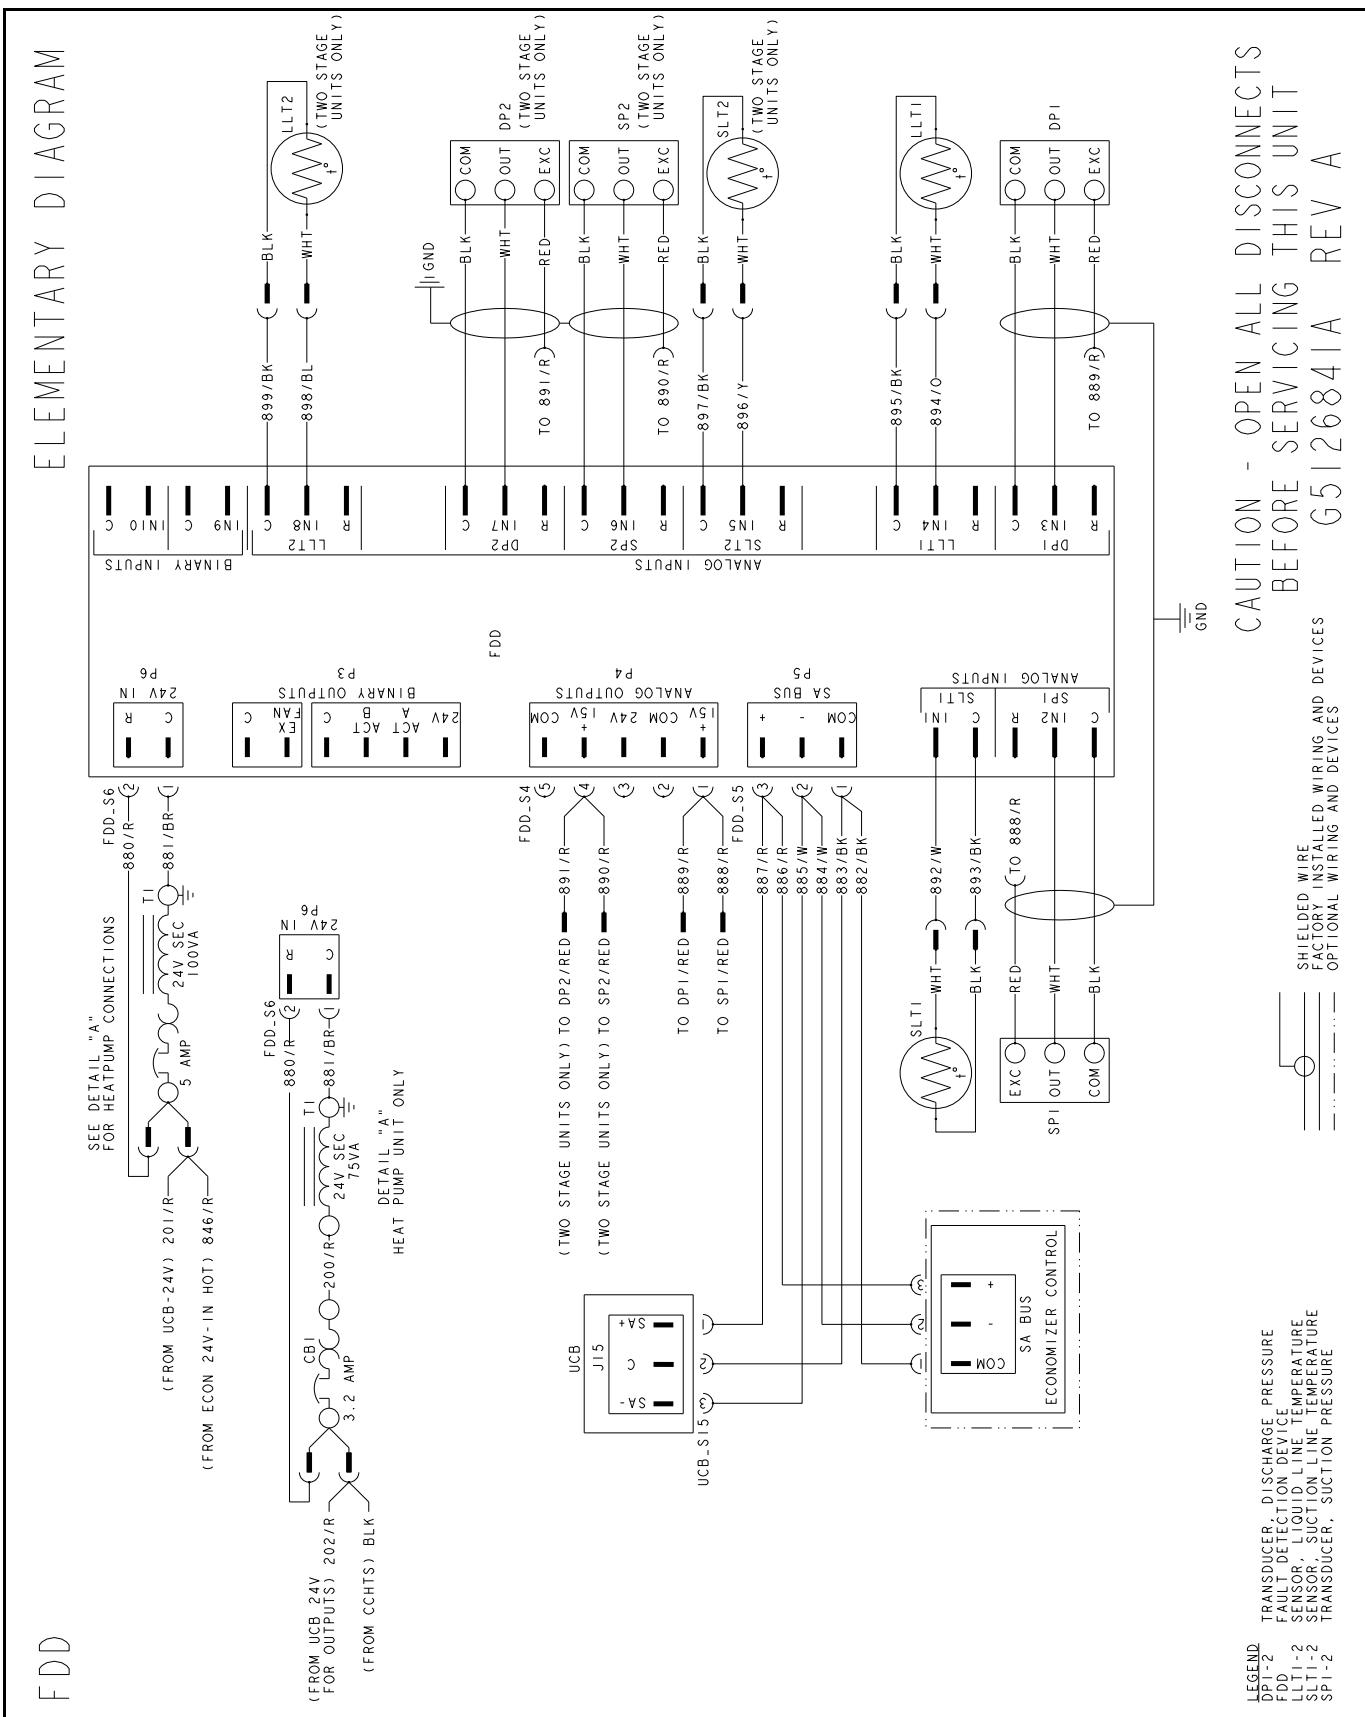


Typical XYE07 Heat Pump Unit w/o Heat 208/230, 460, 575-3-60 Belt Drive Elementary Diagram Power Circuit

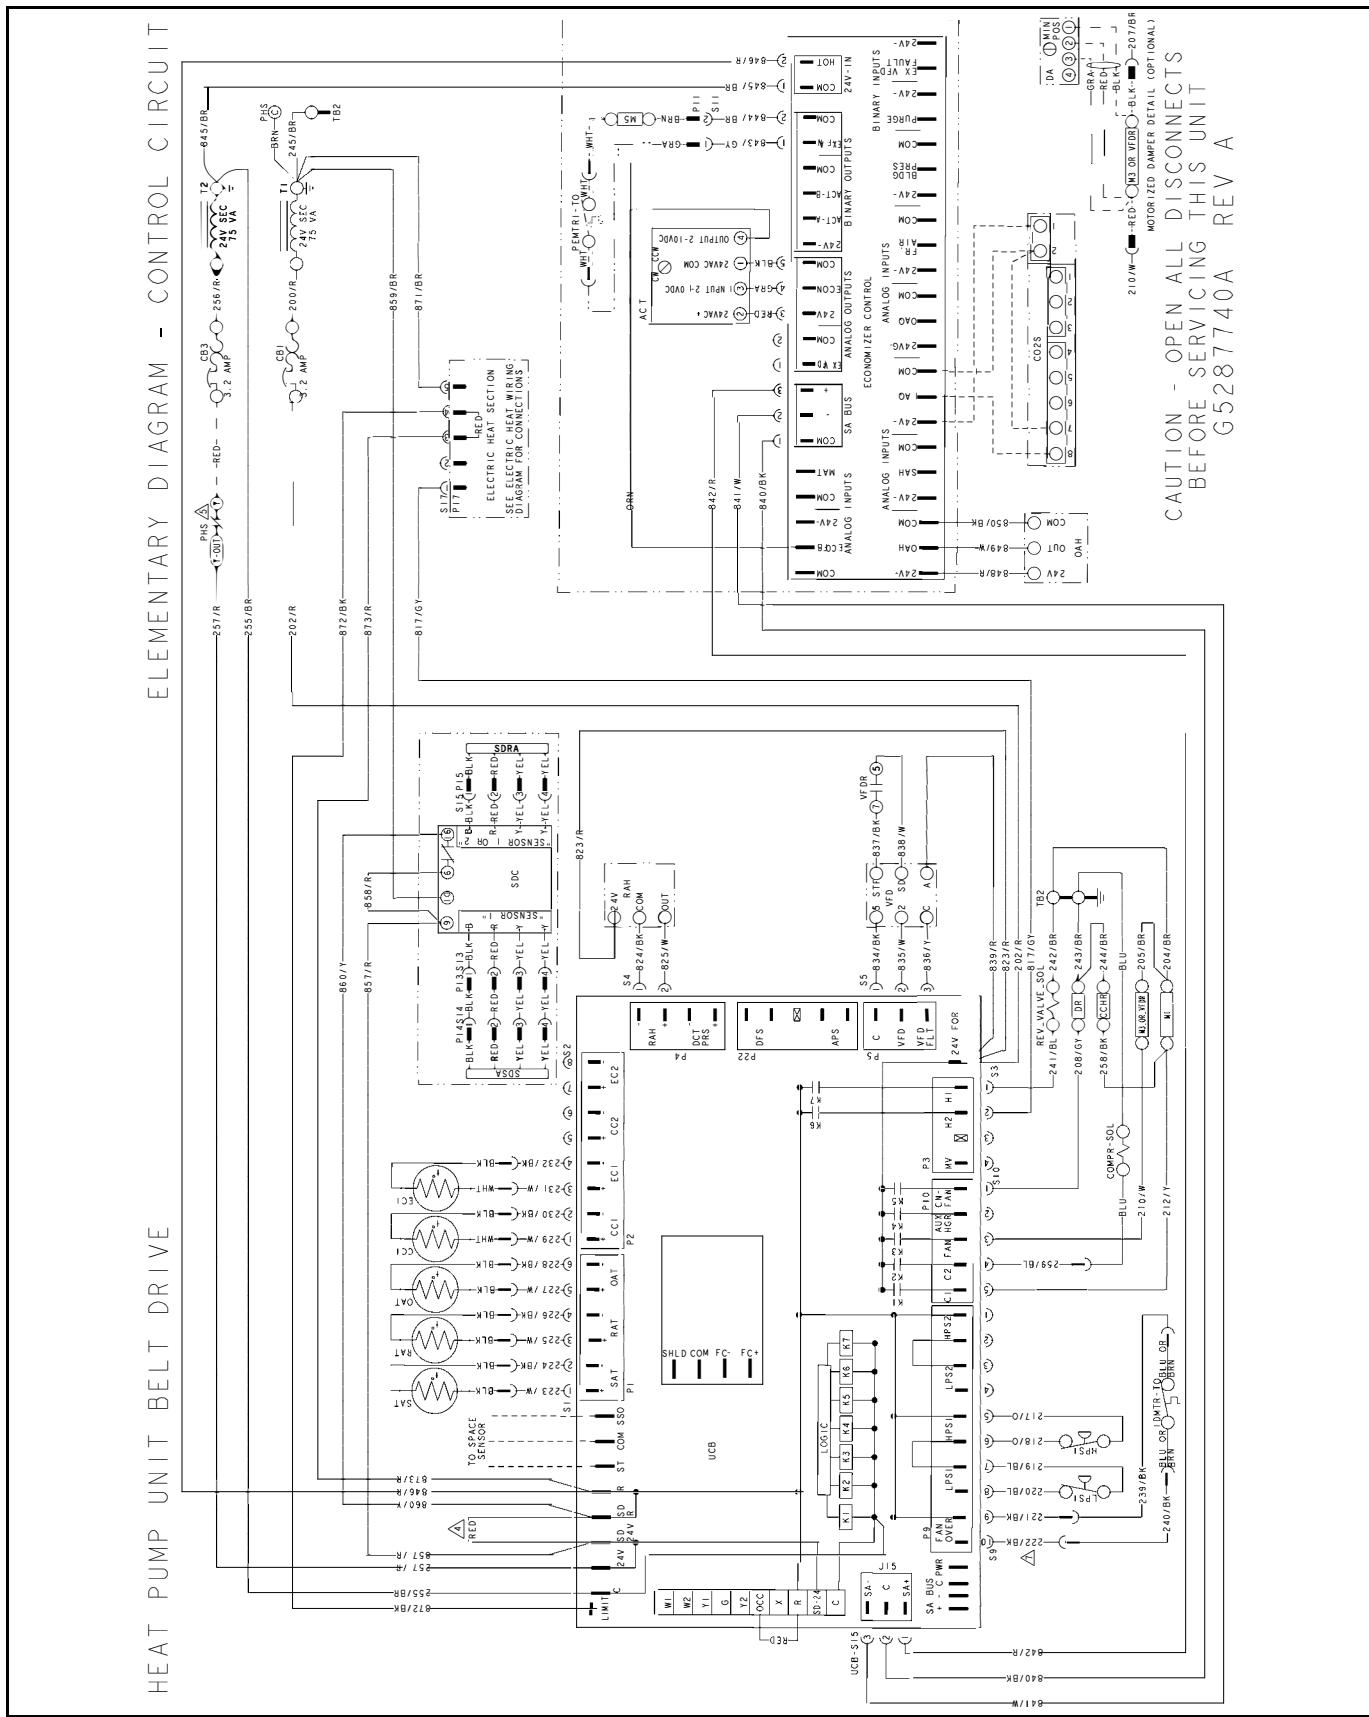


Typical XYE07 Heat Pump Unit w/o Heat 208/230, 460, 575-3-60 Belt Drive Elementary Diagram Power Circuit




Typical XYE07 Heat Pump Unit Belt Drive Elementary Diagram Control Circuit

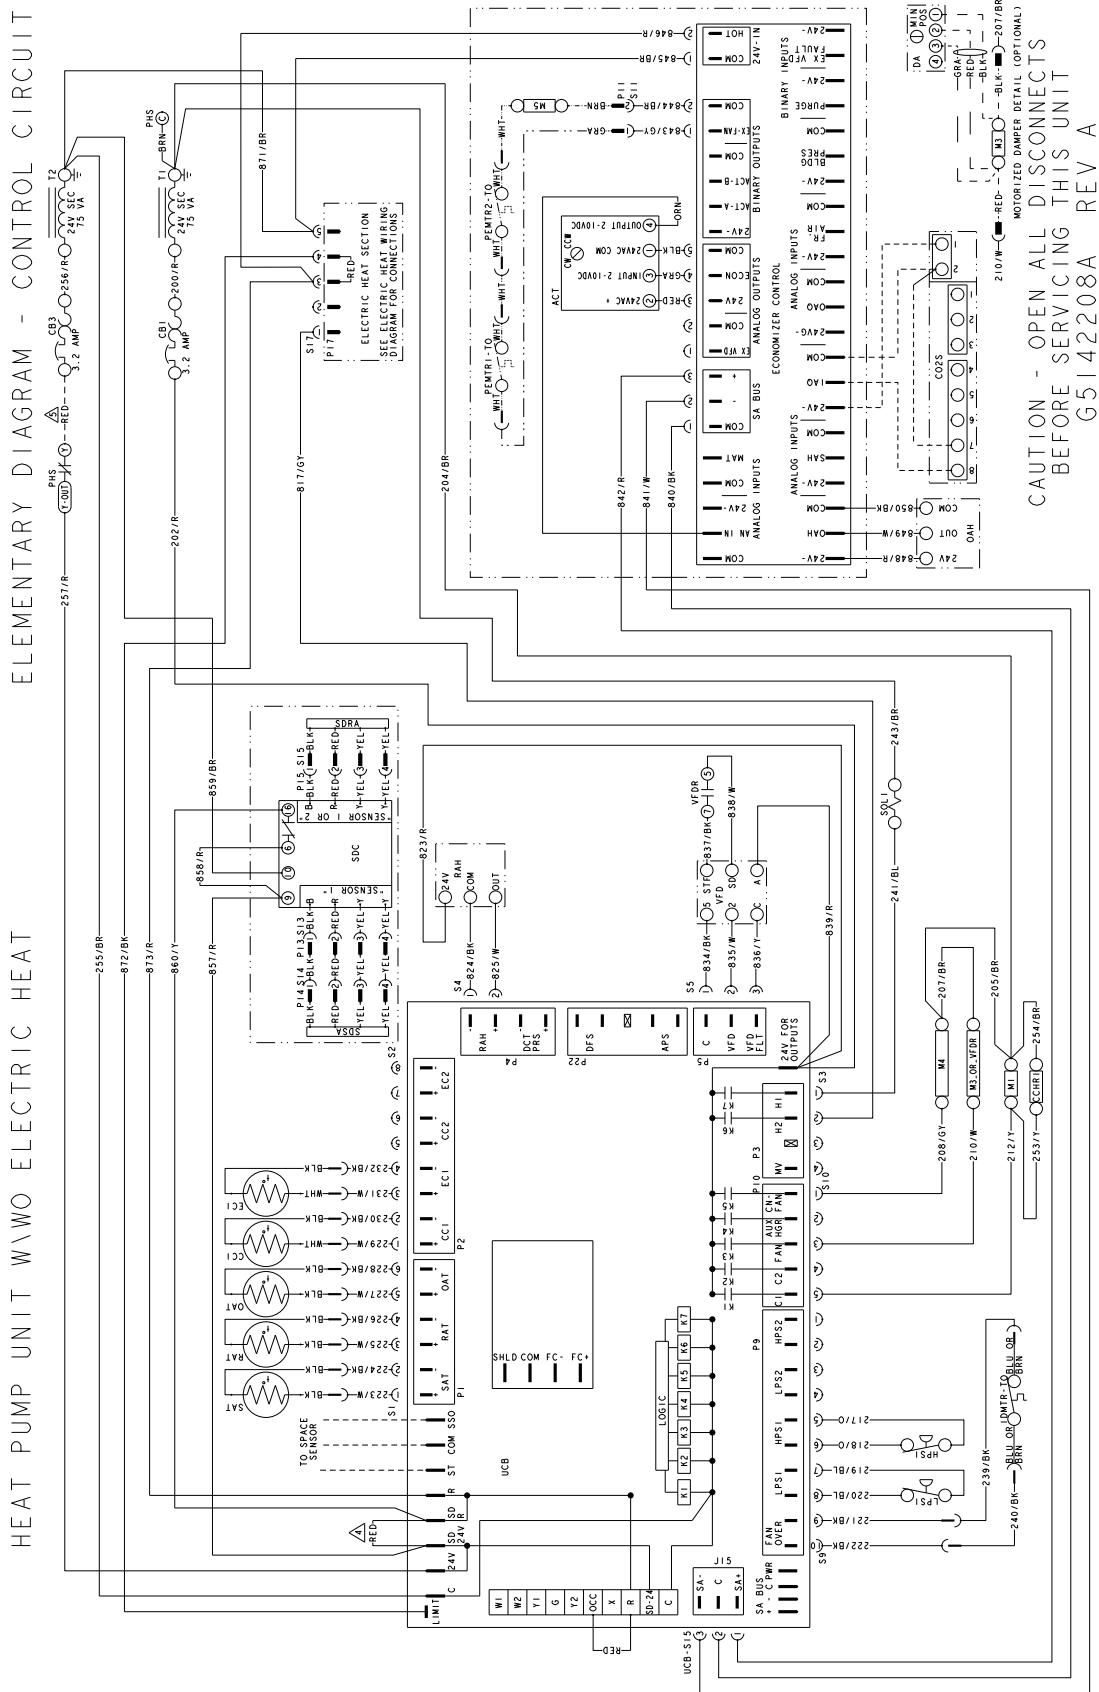


Typical XYE08-09, XXE08-12 Heat Pump Unit w/o Heat 208/230, 460, 575-3-60 Belt Drive Elementary Diagram Power Circuit

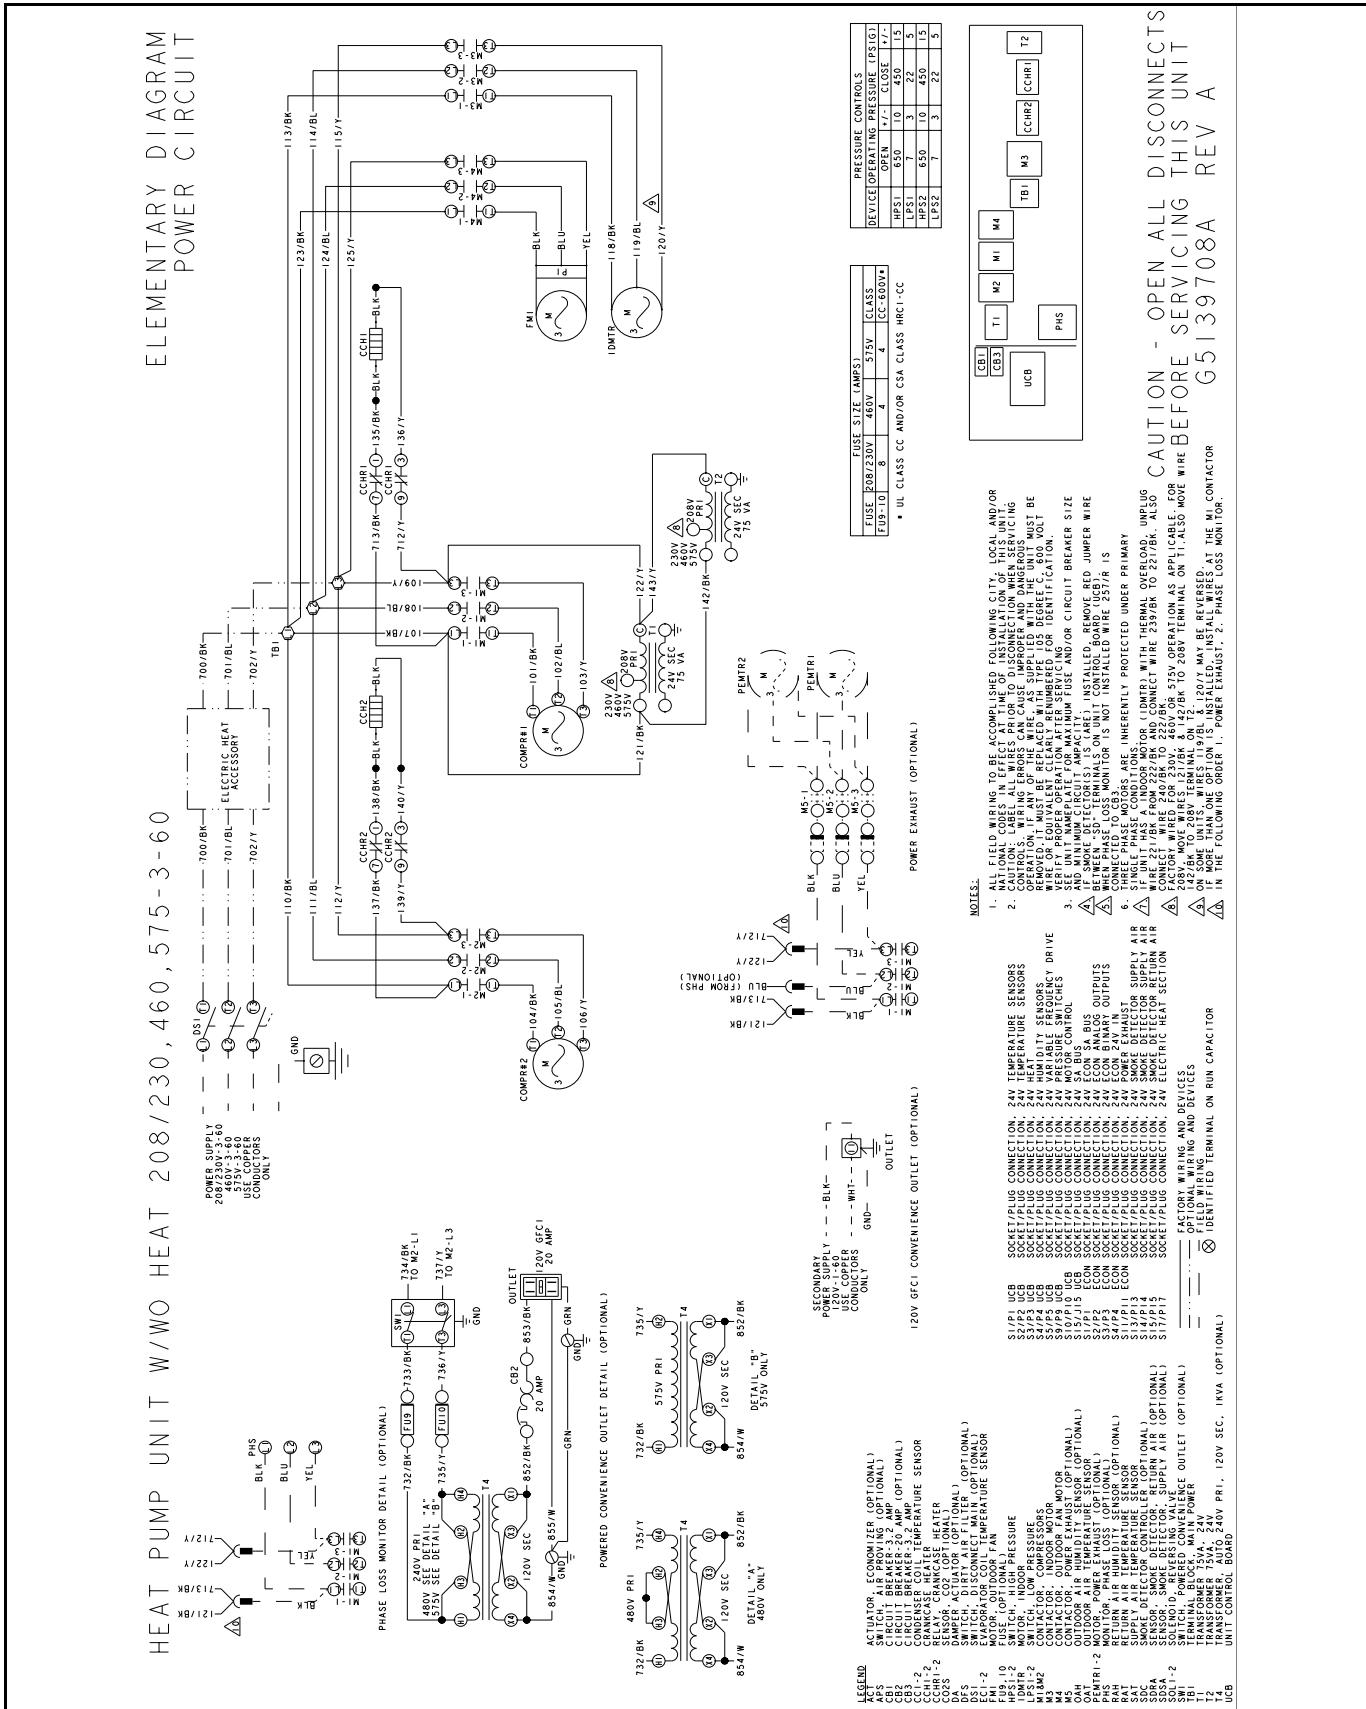

Typical XYE08-09, XXE08-12 Heat Pump Unit w/o Heat 208/230, 460, 575-3-60 Belt Drive with VFD Elementary Diagram Power Circuit

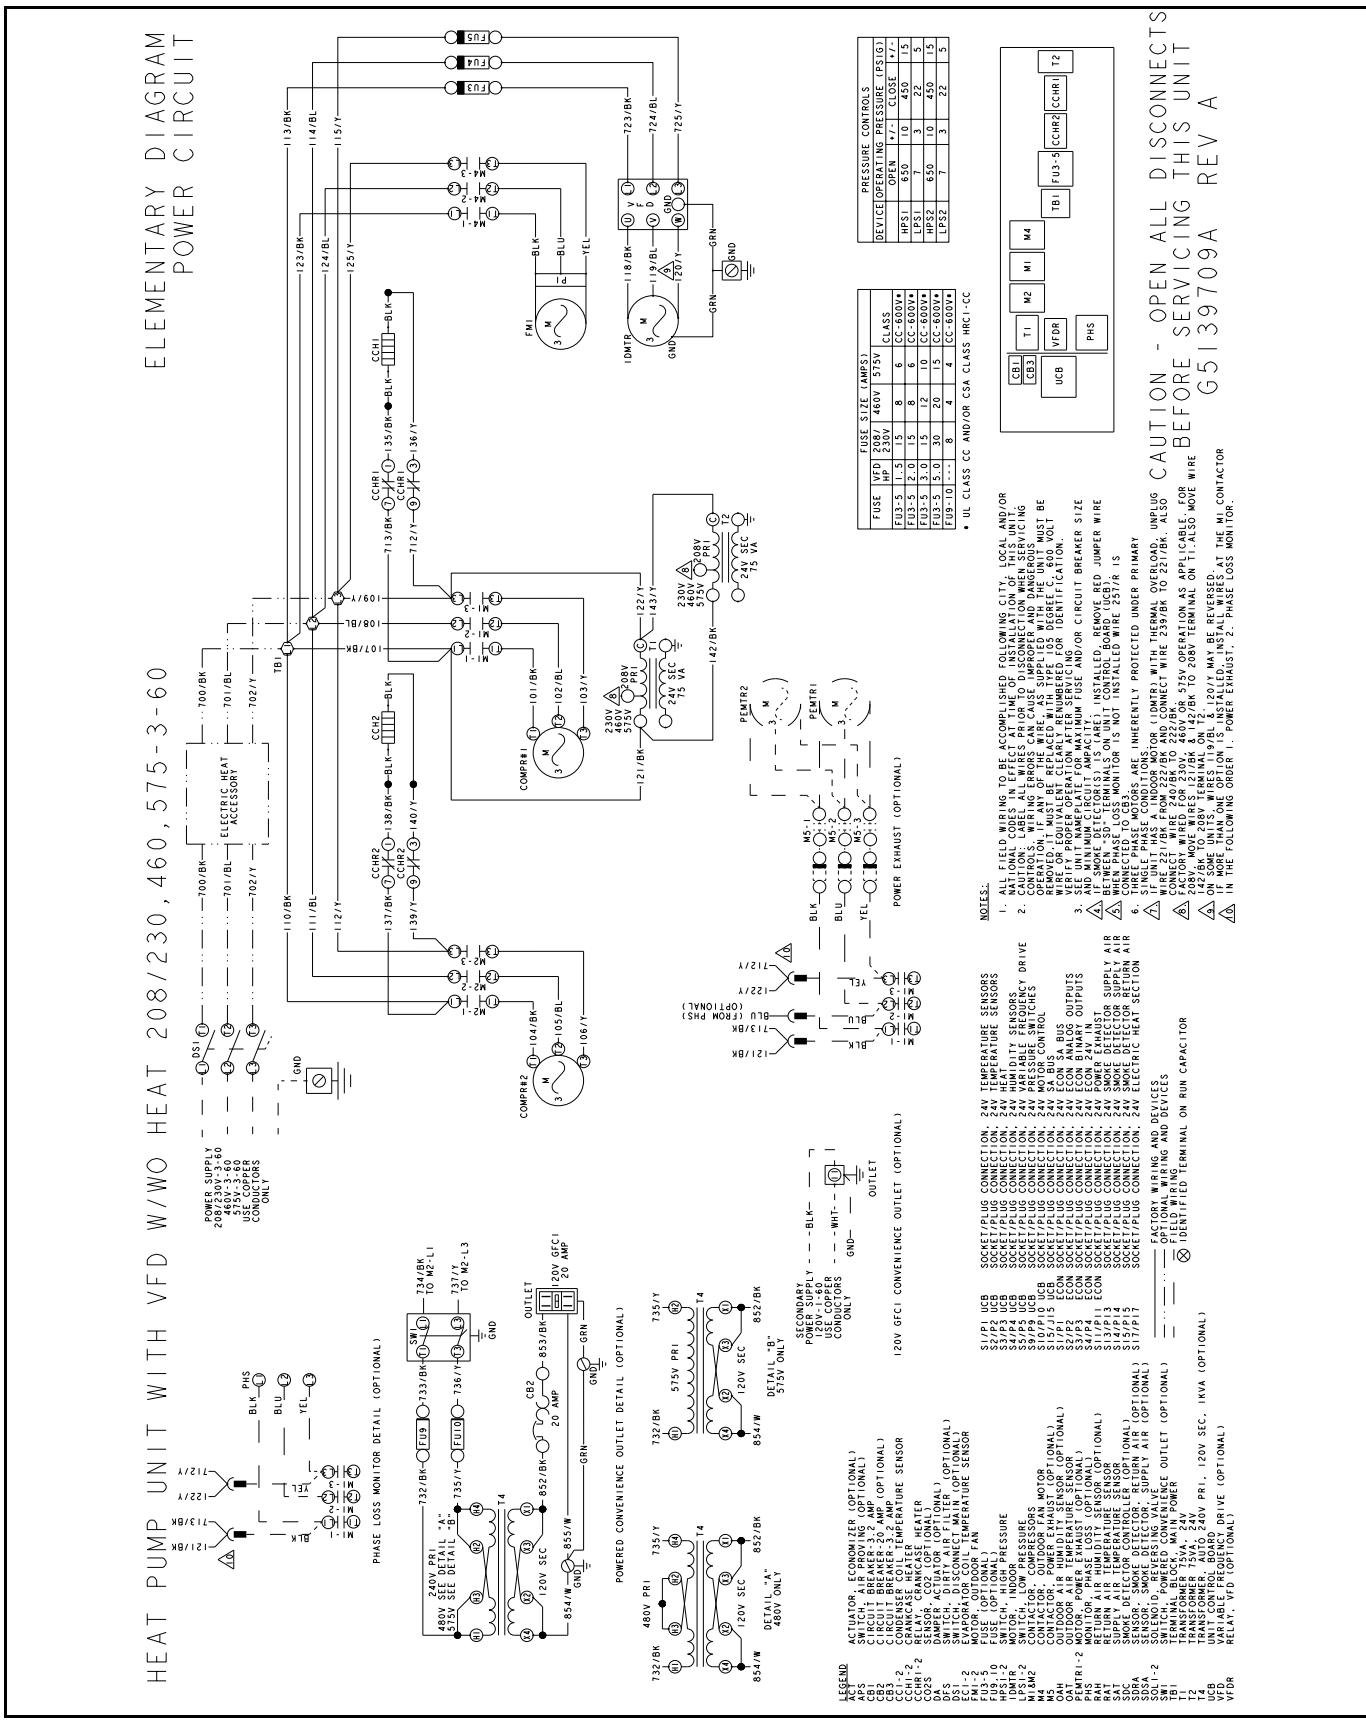


Typical XYE08-09, XXE08-12 Heat Pump Unit Belt Drive Elementary Diagram Control Circuit

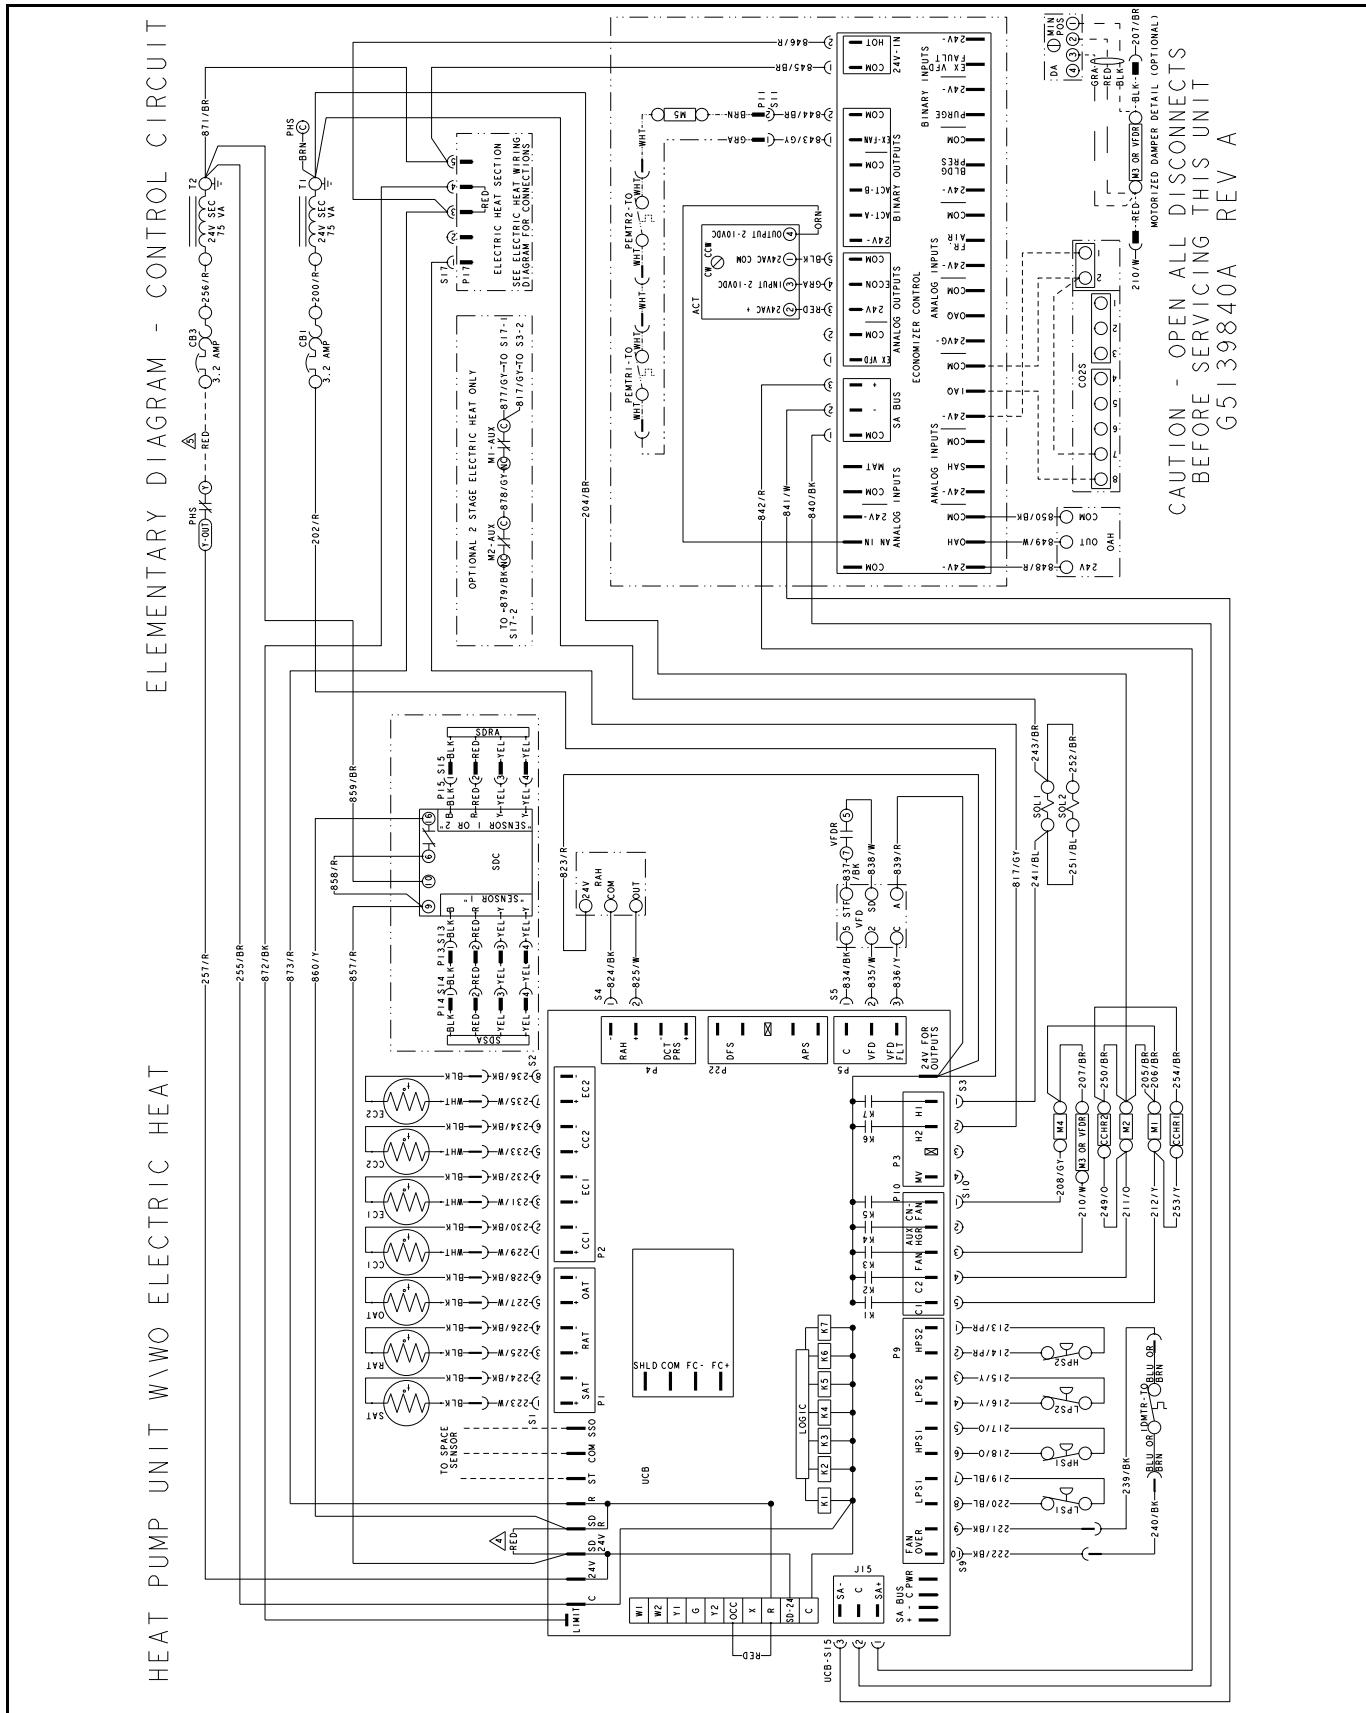


Weights and Dimensions

XYE04-09, XXEA7-12, XQE04-06 Unit Weights


Unit 4 Point Load Weight

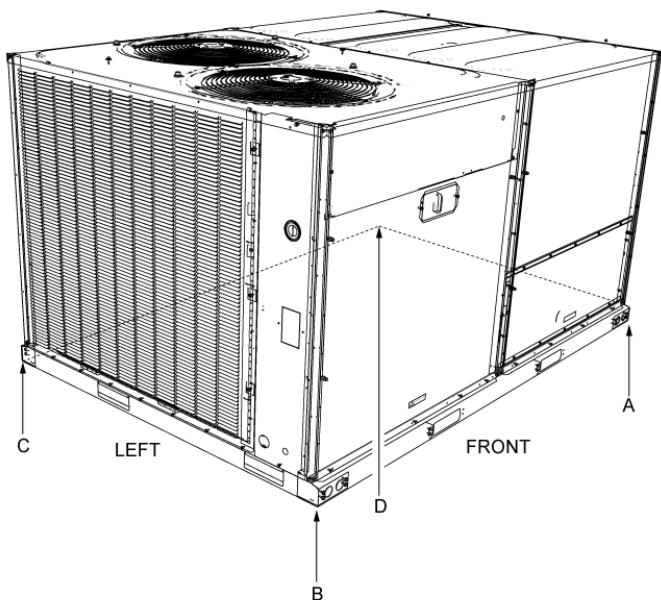

Unit 6 Point Load Weight

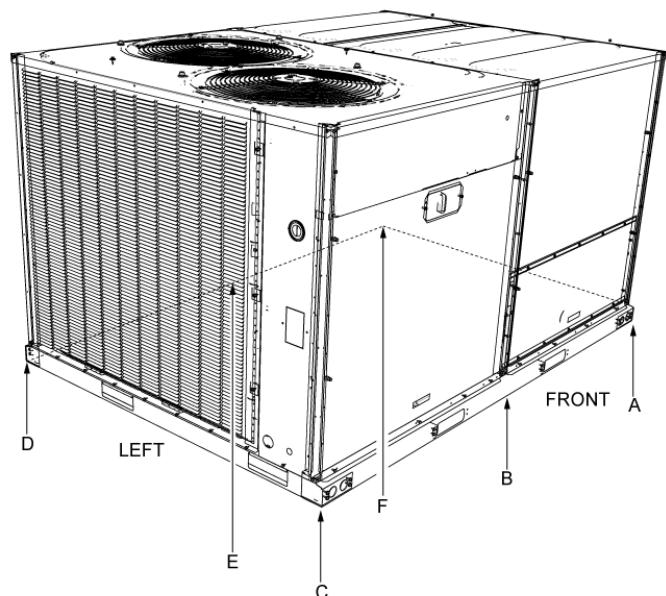

Unit Center Of Gravity

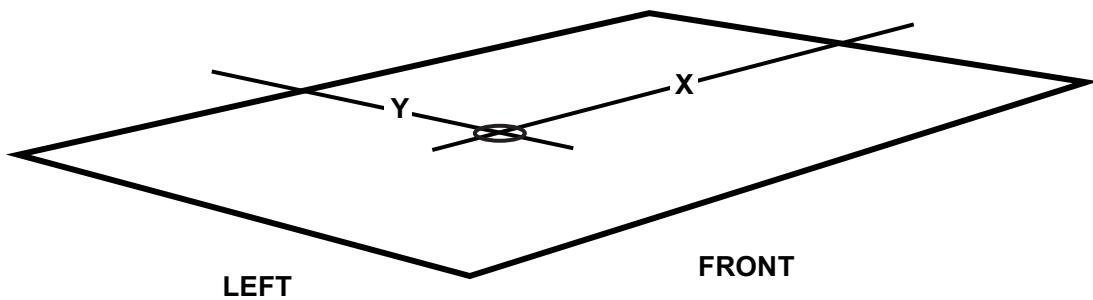

XYE04-09 Corner Weights

Model	Size (Tons)	Weight (lbs.)		Center of Gravity		4 Point Load Location (lbs.)				6 Point Load Location (lbs.)					
		Shipping	Operating	X	Y	A	B	C	D	A	B	C	D	E	F
XYE	04 (3)	563	535	37.4	24.2	130	133	138	135	86	88	89	92	91	89
XYE	05 (4)	643	614	38.1	25.1	151	161	155	146	100	104	109	105	100	96
XYE	06 (5)	682	653	37.4	23.1	151	155	176	171	100	102	104	118	116	114
XYE	07 (6)	891	861	45.6	34.7	231	253	197	180	152	161	171	133	125	118
XYE	08 (7.5)	1090	1060	48.5	34.1	260	326	264	210	167	193	226	183	156	135
XYE	09 (8.5)	1091	1061	48.5	34.1	260	326	264	211	167	193	226	183	156	135

XXEA7-12 Corner Weights

Size (Tons)	Model	Weight (lbs.)		Center of Gravity		4 Point Load Location (lbs.)				6 Point Load Location (lbs.)					
		Shipping	Operating	X	Y	A	B	C	D	A	B	C	D	E	F
A7 (6)	XXE	665	652	35.8	23.9	163	153	163	173	110	105	101	107	112	117
08 (7.5)	XXE	1006	976	46.9	35.7	261	304	221	190	170	187	208	151	136	124
09 (8.5)	XXE	1055	1025	48.0	35.7	267	326	238	194	172	196	225	164	143	125
12 (10)	XXE	1090	1060	49.5	33.3	247	325	277	211	158	188	227	193	160	135

XQE04-06 Corner Weights


Size (Tons)	Model	Weight (lbs.)		Center of Gravity		4 point Load Location (lbs.)				6 point Load Location (lbs.)					
		Shipping	Operating	X	Y	A	B	C	D	A	B	C	D	E	F
04 (3)	XQE	542	529	38.0	24.4	127	135	137	130	84	87	91	92	89	86
05 (4)	XQE	641	628	35.0	24.5	164	148	150	166	111	104	97	98	105	113
06 (5)	XQE	640	627	34.7	24.4	165	146	149	168	112	103	95	97	105	114

XYE04-09, XXEA7-12, XQE04-06 Unit Accessory Weights


Unit Accessory	Weights (lbs.)
Vertical Flow Dry Bulb Economizer Small Footprint	63
Horizontal Flow Dry Bulb Economizer Small Footprint Short	96
Horizontal Flow Dry Bulb Economizer Small Footprint Short	75
Horizontal Flow Dry Bulb Economizer Small Footprint Tall	81
Horizontal Flow Dry Bulb Economizer Large Footprint Short	105
Horizontal Flow Dry Bulb Economizer Large Footprint Tall	102
Power Exhaust Vert Flow Small Footprint	38
Power Exhaust Vert Flow Large Footprint	38
Power Exhaust Horiz Flow Small Footprint	38
Power Exhaust Horiz Flow Large Footprint	38
Hail Guard Kit Small Short Factory Installed	19
Hail Guard Kit Small Tall Factory Installed	24
Hail Guard Kit Large Short Factory Installed	50
Hail Guard Kit Large Tall Factory Installed	50
Curb Rigid 14" Small Footprint	145
Curb Rigid 24" Small Footprint	135
Curb Rigid 14" Large Footprint	135
Curb Rigid 24" Large Footprint	135

XYE04-09, XQE04-06, XXEA7-12 Unit Dimensions


XYE/XQE04

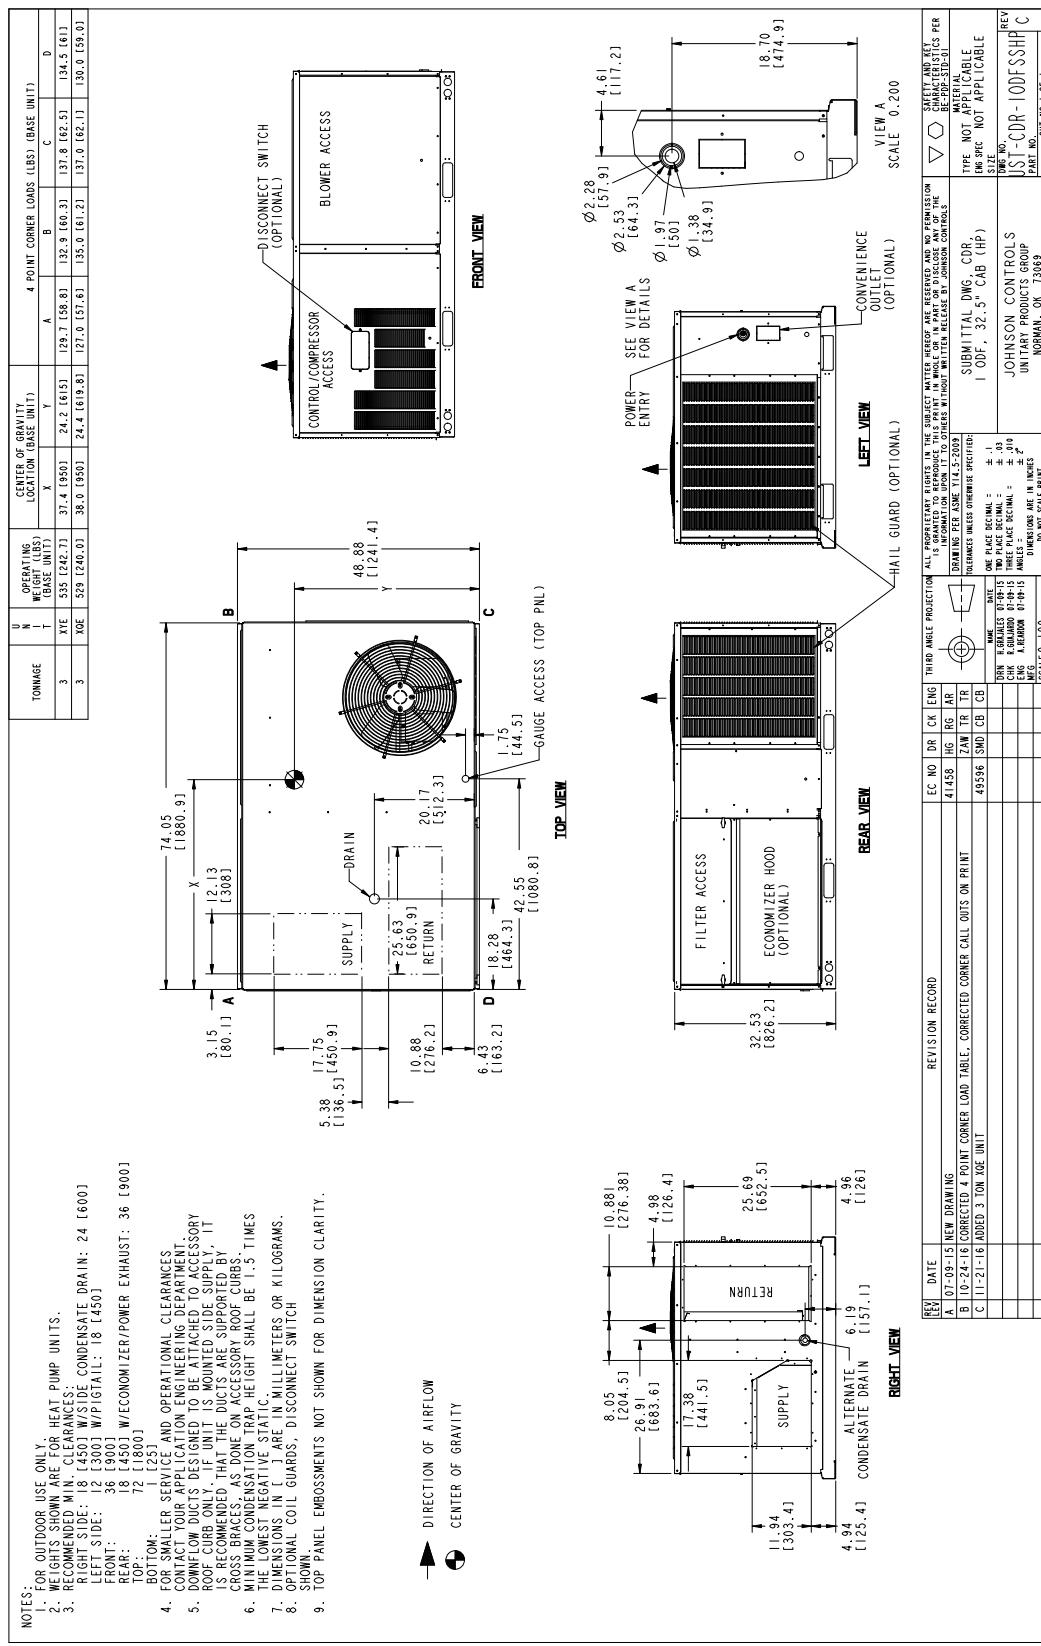


XYE/XQE05 - 06 And XXEA7

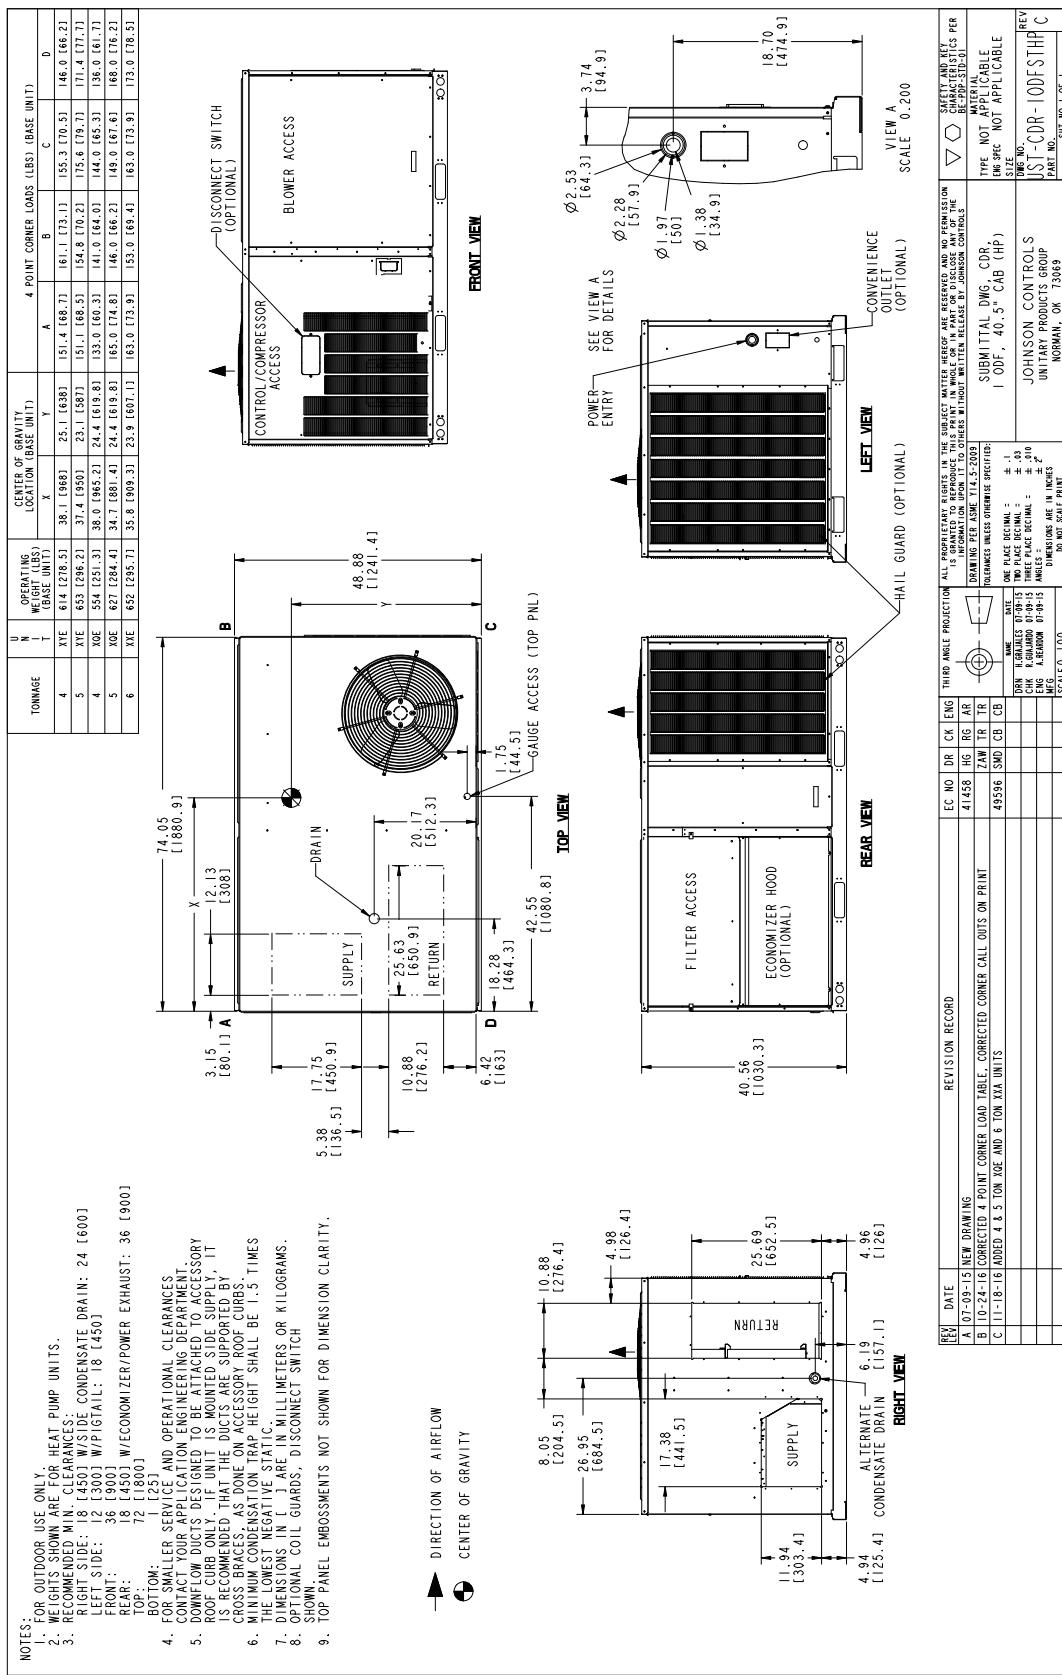


XYE07

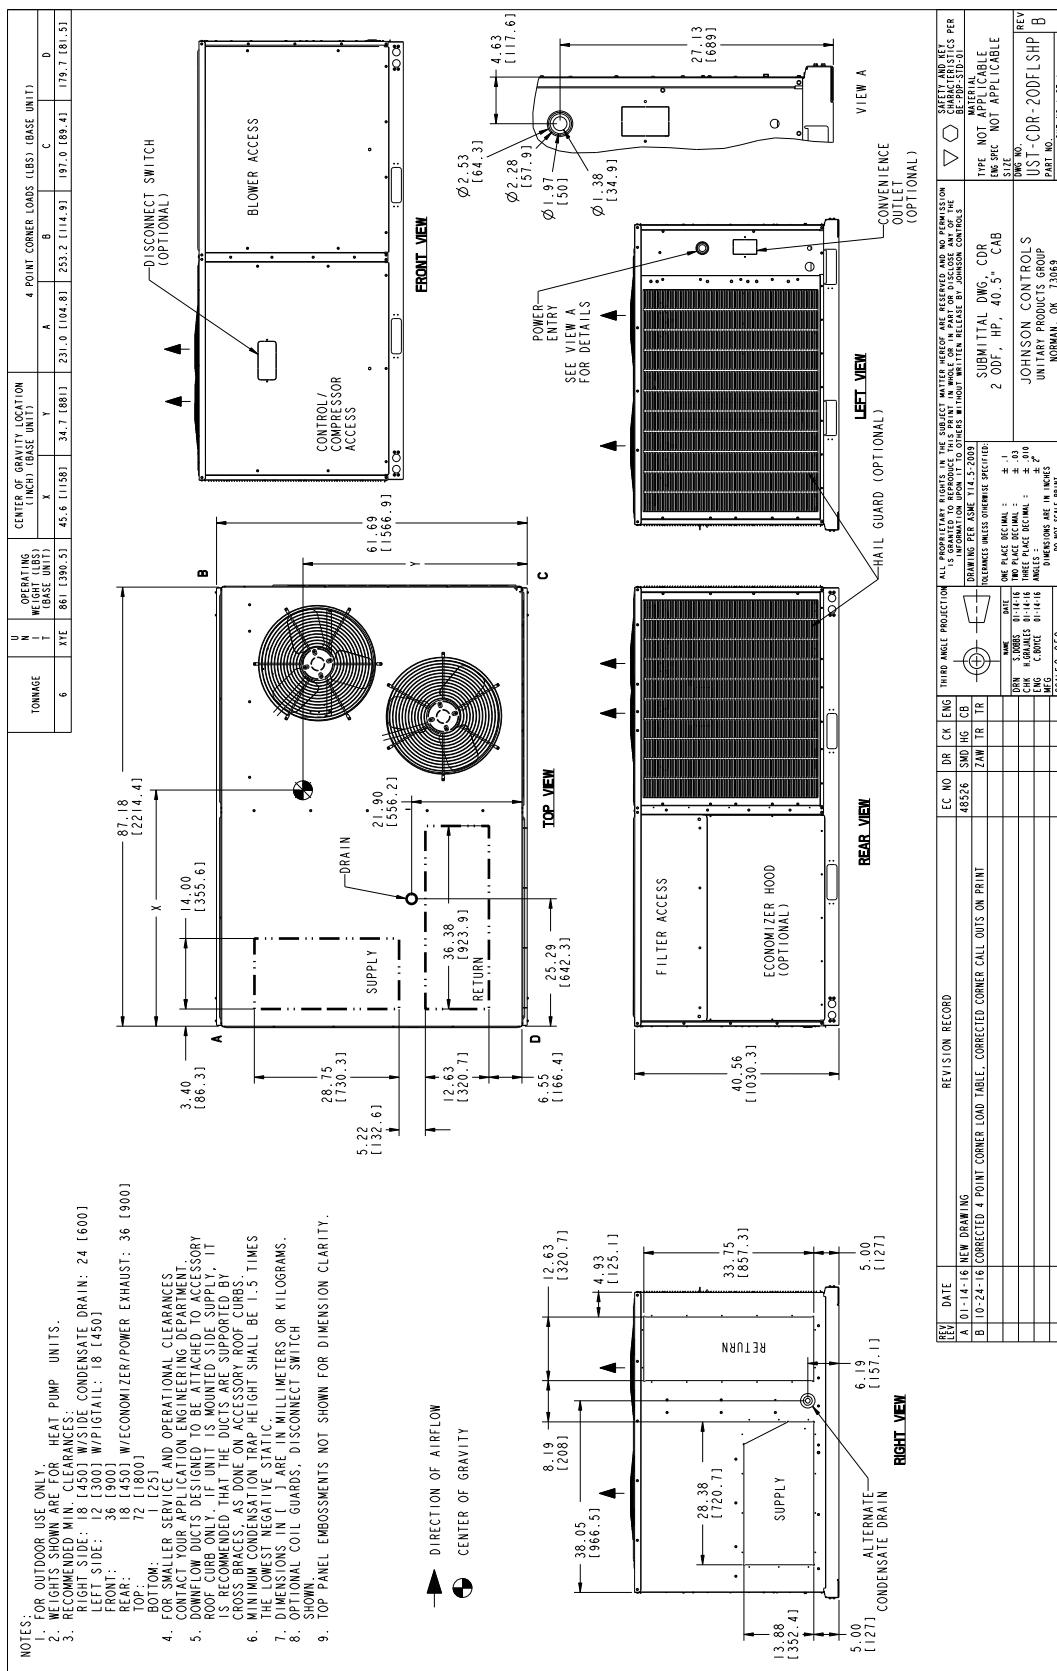

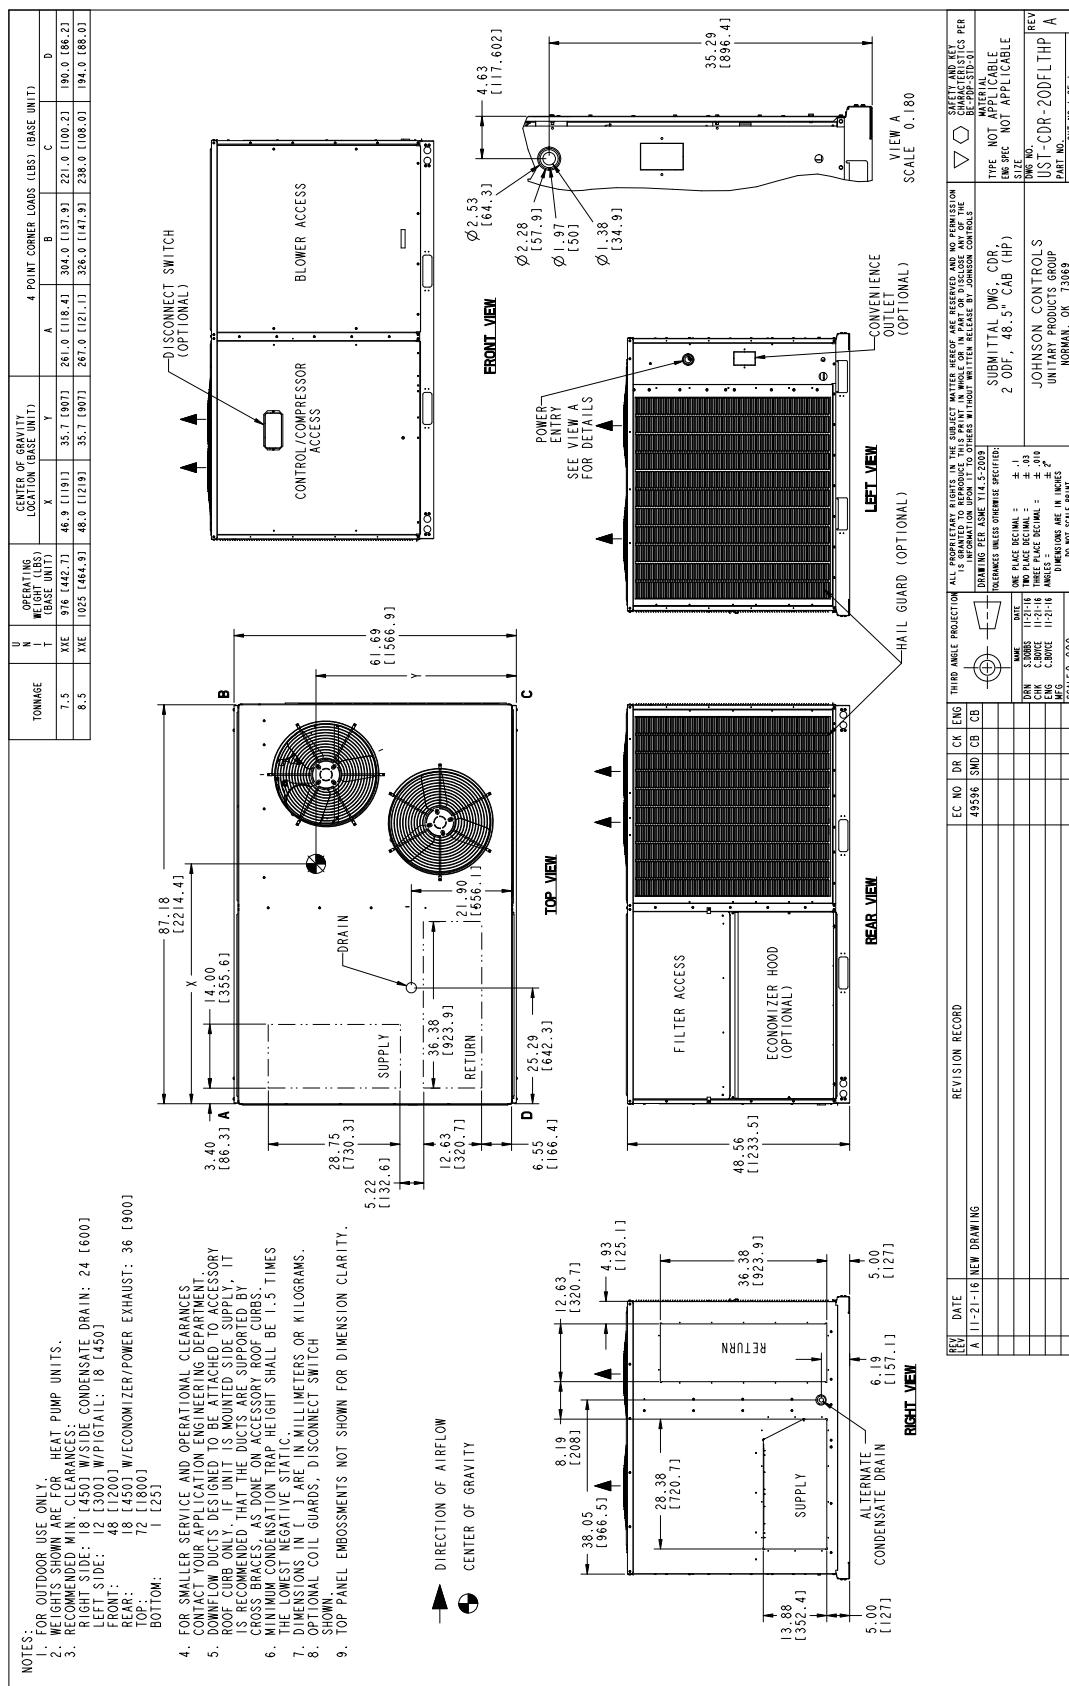





XYE08, 09 and XXE12

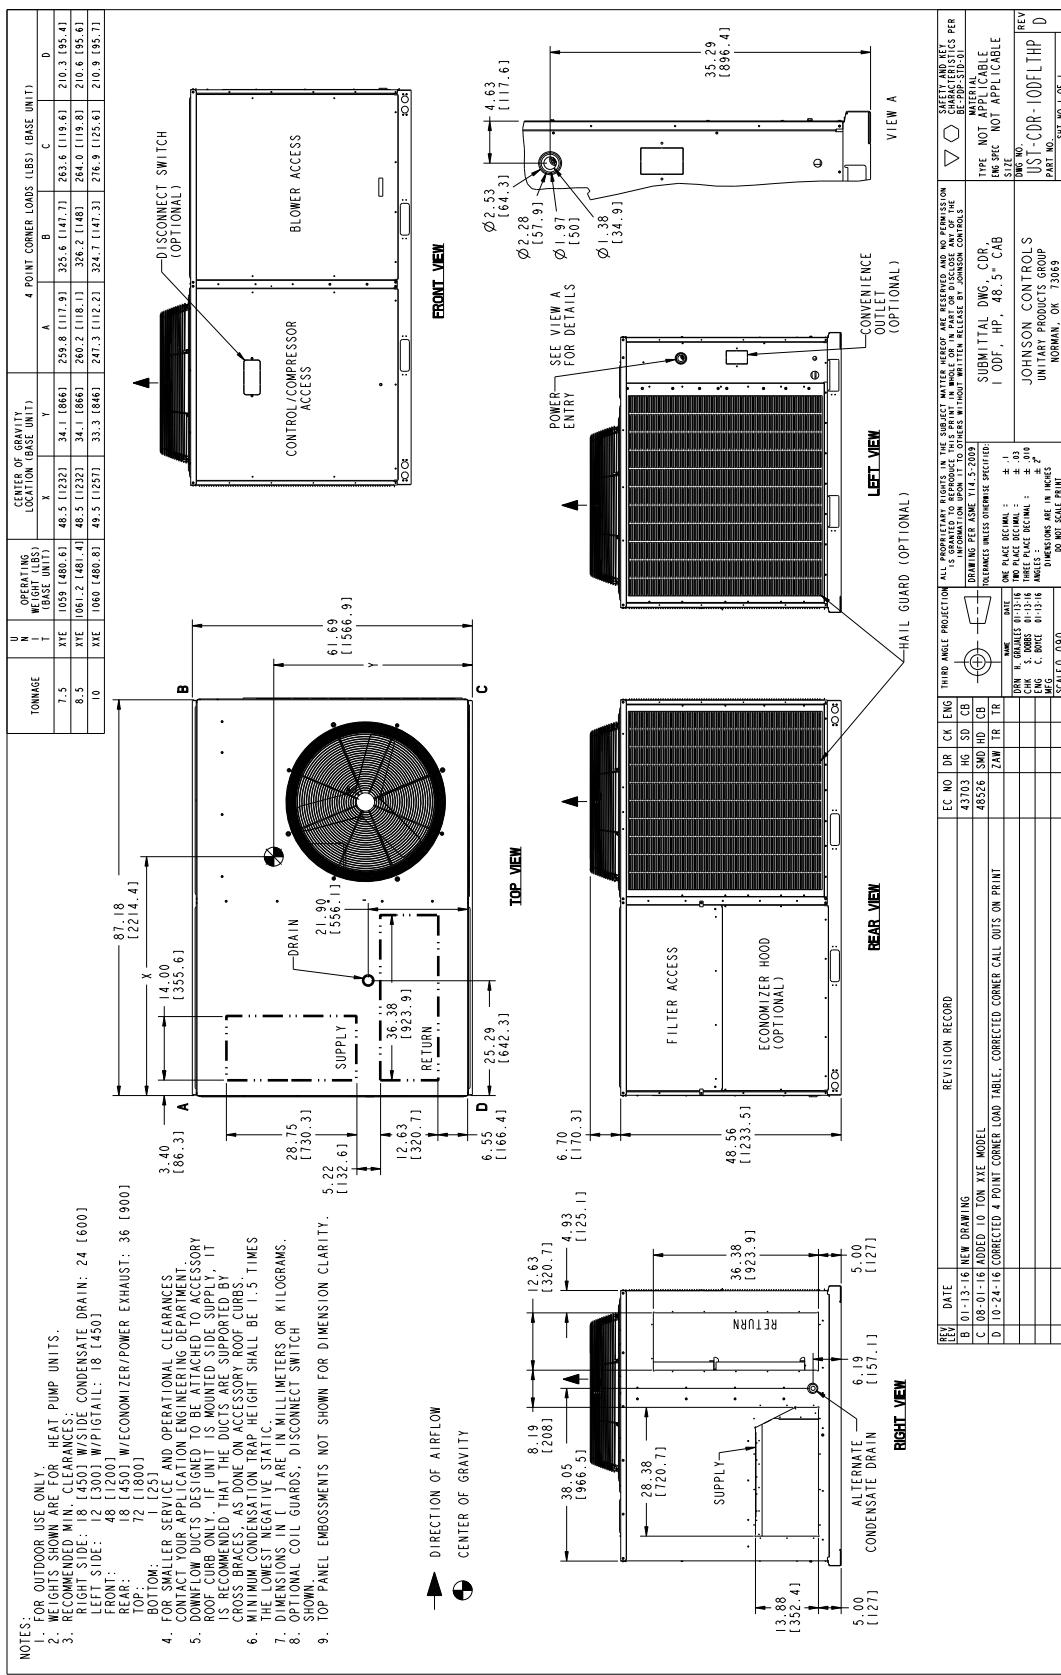

XYE04-06, XXEA7 and XQE04-06 Unit Clearances

Direction	Distance (in.)	Direction	Distance (in.)
Top ¹	72	Right	18
Front	36	Left	12
Rear	18 ² /36 ³	Bottom ⁴	1

1. Units must be installed outdoors. Over hanging structure or shrubs should not obscure condenser air discharge outlet.
2. Units without economizer or power exhaust.
3. Units equipped with an Economizer or Power Exhaust. Flue products must not be discharged within 10 Feet of the rear of the unit.
4. Units may be installed on combustible floors made from wood or class A, B or C roof covering materials.

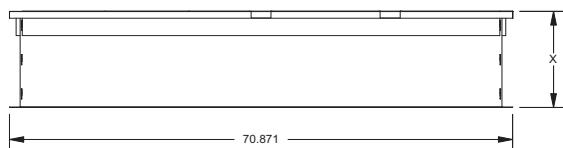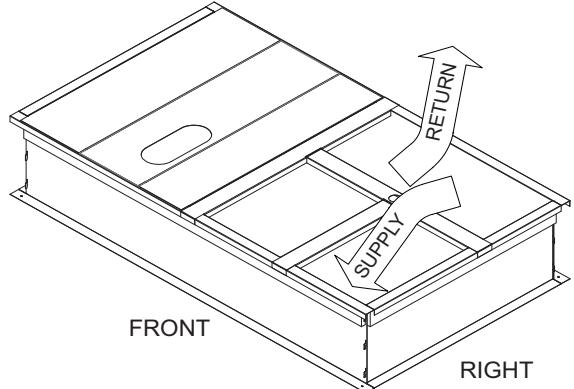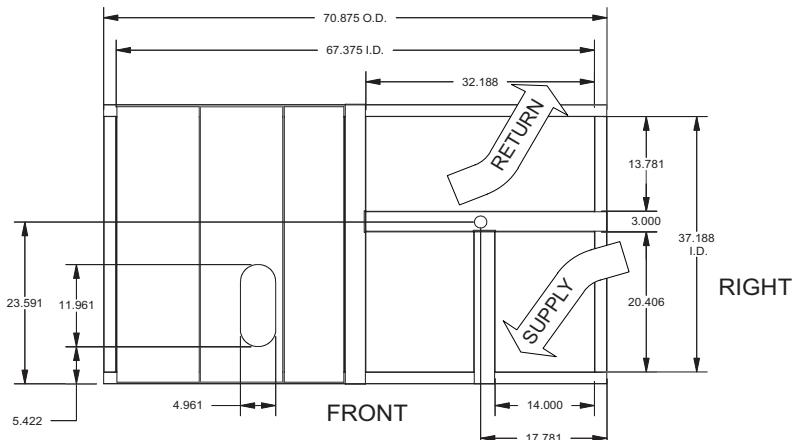XYE04-06, XXEA7, XQE04-06 Unit Roof Curb Dimensions**1RC0456, 1RC0458 Roof Curb Dimensions**

1RC0456 X= 14" Height
1RC0458 X= 24" Height

Notes:

1. Sides, ends and cross support are 18-G90. Deck pans, R/A & S/A supports are 20-G90.
2. Full perimeter wood nailer.
3. Insulated deck pans.

Unit Models used with 1RC0456, 1RC0458 Roof Curb

XYE/XQE04
XYE/XQE05
XYE/XQE06/XXEA7




NOTE: If utilities are required thru the base of the unit or thru the roof curb the following field installed accessories can be purchased thru your dealer or contractor:

- 1TB0401 - Thru the base electrical
- 1TB0402 - Thru the base electrical
- 1TB0403 - Thru the base electrical
- 1TB0404 - Thru the base electrical


XYE07-09, XXE08-09 and XXE12 Unit Clearances

Direction	Distance (in.)	Direction	Distance (in.)
Top ¹	72	Right	18
Front	48	Left	12
Rear	18 ² /36 ³	Bottom ⁴	1

1. Units must be installed outdoors. Over hanging structure or shrubs should not obscure condenser air discharge outlet.
2. Units without economizer or power exhaust.
3. Units equipped with an Economizer or Power Exhaust. Flue products must not be discharged within 10 Feet of the rear of the unit.
4. Units may be installed on combustible floors made from wood or class A, B or C roof covering materials.

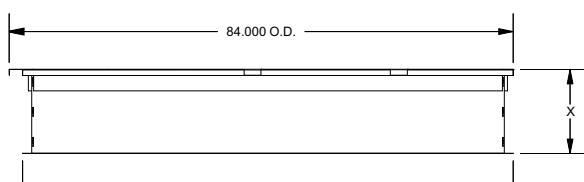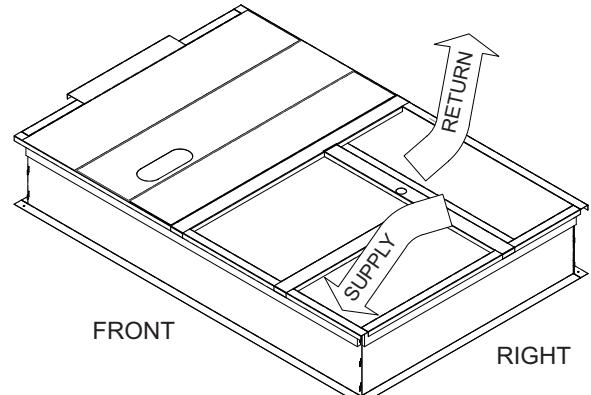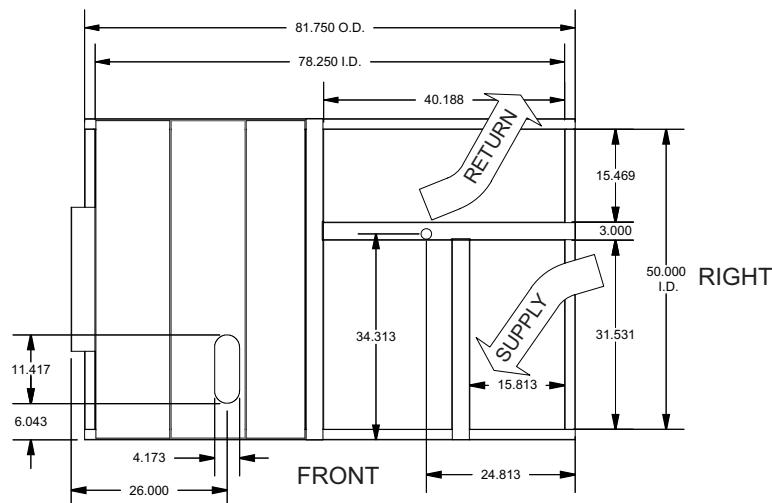XYE07-09, XXE08-09 and XXE12 Unit Roof Curb Dimensions**1RC0457, 1RC0459 Roof Curb Dimensions**

1RC0457 X= 14" Height
1RC0459 X= 24" Height

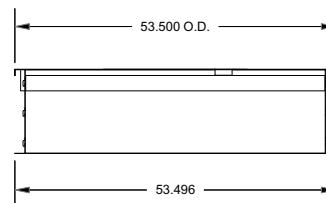**Notes:**

1. Sides, ends, unit locator and cross support are 18-G90. Deck pans, R/A & S/A supports are 20-G90.
2. Full perimeter wood nailer.
3. Insulated deck pans.

Unit Models used with 1RC0457, 1RC0459 Roof Curb

XYE07
XYE08/XXE08
XYE09/XXE09
XXE12

NOTE: If utilities are required thru the base of the unit or thru the roof curb the following field installed accessories can be purchased thru your dealer or contractor:


1TB0404 - Thru the base electrical

Economizer Options



Economizer Usage

Application	Description	Accessory Kit Number
Economizer Vertical Flow	Econ, DB, Vertical Flow, Small Footprint	2EE04706724
	Econ, DB, Vertical Flow, Large Footprint	2EE04706824
Economizer Horizontal Flow	Econ, DB, Horizontal Flow, Small Footprint, Short Cabinet	2EE04707024
	Econ, DB, Horizontal Flow, Small Footprint, Tall Cabinet	2EE04707124
	Econ, DB, Horizontal Flow, Large Footprint, Short Cabinet	2EE04707224
	Econ, DB, Horizontal Flow, Large Footprint, Tall Cabinet	2EE04707324
Power Exhaust Vertical Flow	Power Exhaust Vert Flow Small Footprint 208V-230V 1-ph	2PE04704206
	Power Exhaust Vert Flow Small Footprint 208V-230V 3-ph	2PE04704225
	Power Exhaust Vert Flow Small Footprint 460V 3-ph	2PE04704246
	Power Exhaust Vert Flow Small Footprint 575V 3-ph	2PE04704258
	Power Exhaust Vert Flow Large Footprint 208V-230V 1-ph	2PE04704306
	Power Exhaust Vert Flow Large Footprint 208V-230V 3-ph	2PE04704325
	Power Exhaust Vert Flow Large Footprint 460V 3-ph	2PE04704346
	Power Exhaust Vert Flow Large Footprint 575V 3-ph	2PE04704358
	Power Exhaust Horiz Flow Small Footprint 208V-230V 1-ph	2PE04704406
	Power Exhaust Horiz Flow Small Footprint 208V-230V 3-ph	2PE04704425
Power Exhaust Horizontal Flow	Power Exhaust Horiz Flow Small Footprint 460V 3-ph	2PE04704446
	Power Exhaust Horiz Flow Small Footprint 575V 3-ph	2PE04704458
	Power Exhaust Horiz Flow Large Footprint 208V-230V 1-ph	2PE04704506
	Power Exhaust Horiz Flow Large Footprint 208V-230V 3-ph	2PE04704525
	Power Exhaust Horiz Flow Large Footprint 460V 3-ph	2PE04704546
	Power Exhaust Horiz Flow Large Footprint 575V 3-ph	2PE04704558

Field Installed Vertical Flow Economizer


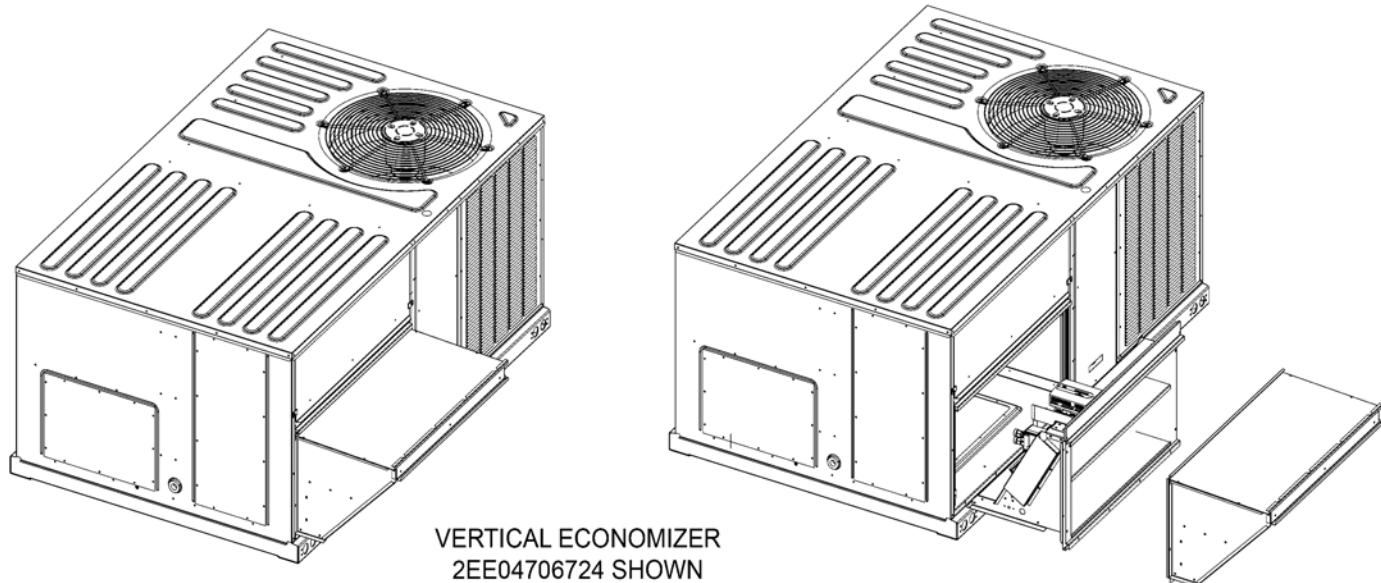


Field Installed Vertical Flow Economizer W/Power Exhaust

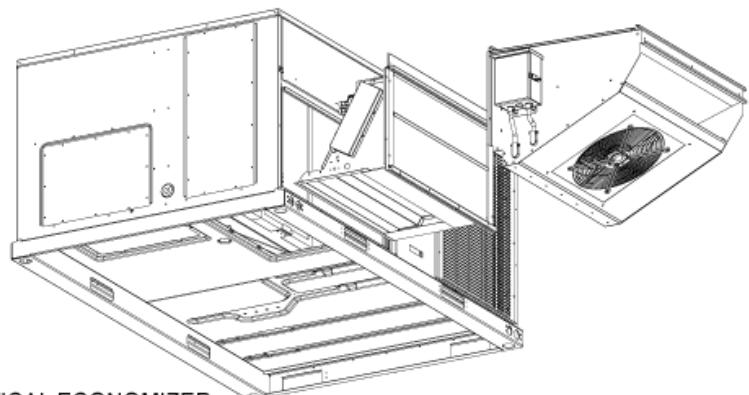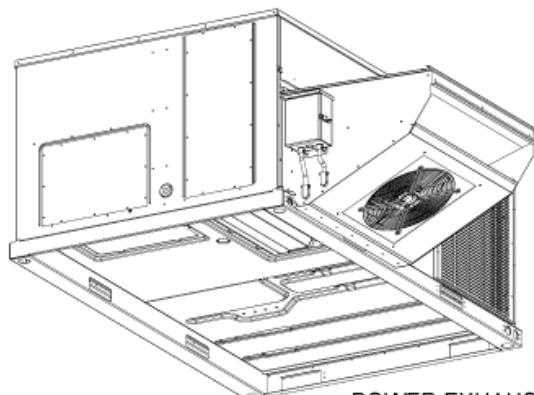


POWER EXHAUST VERTICAL ECONOMIZER
2PE04704206 SHOWN

Field Installed Horizontal Flow Economizer

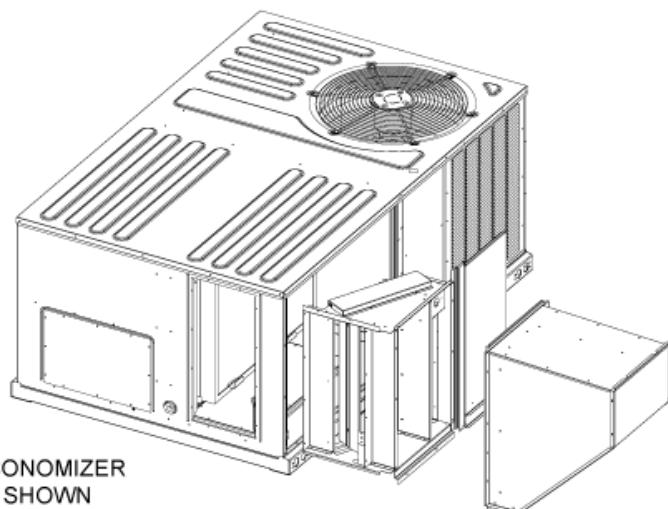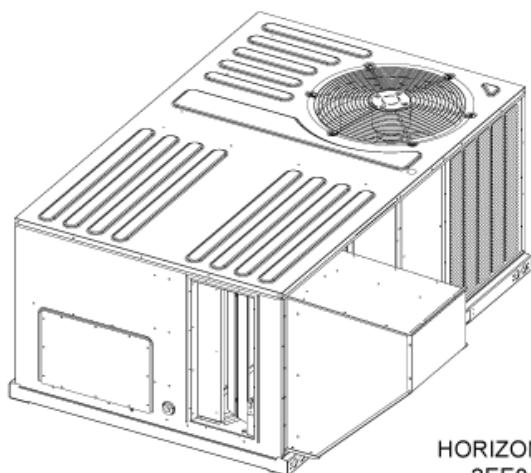

HORIZONTAL ECONOMIZER
2EE04707024 SHOWN

Field Installed Horizontal Flow Economizer W/Power Exhaust

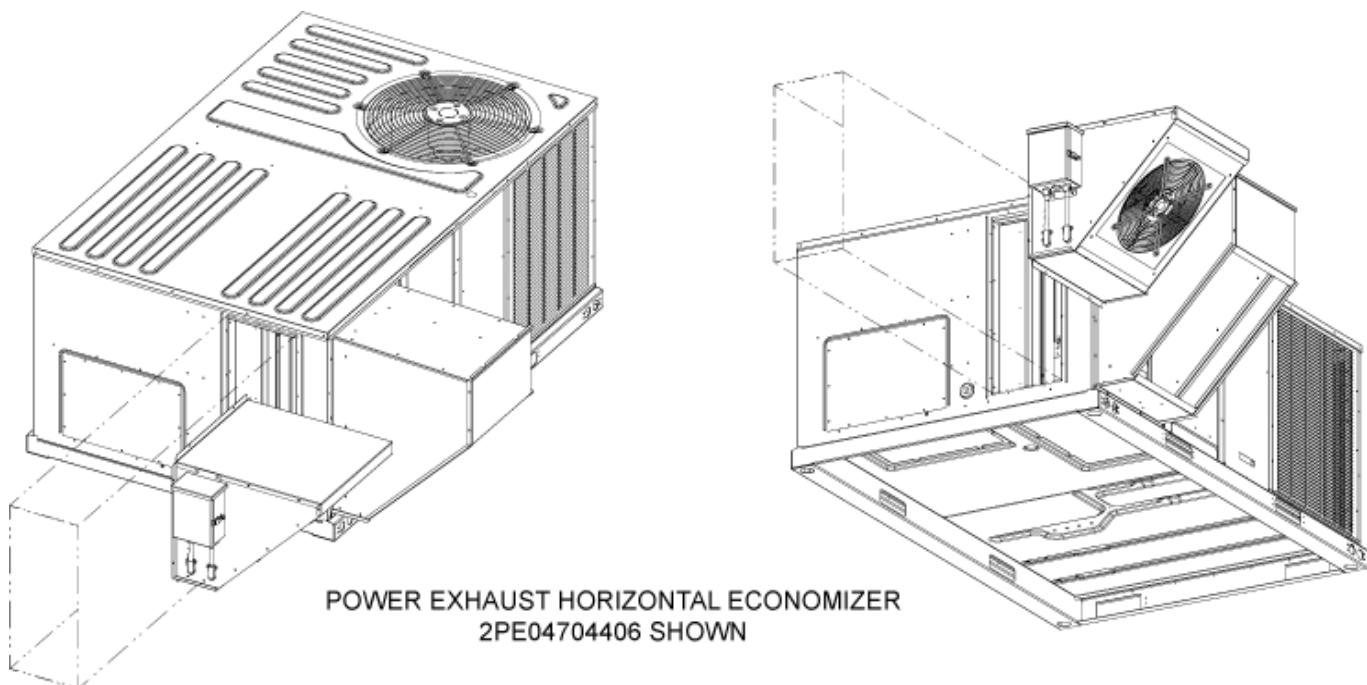

Guide Specifications

UNITARY PRODUCTS GUIDE MECHANICAL SPECIFICATIONS SINGLE PACKAGE HEAT PUMPS

3 THRU 10 NOMINAL TONS

Direct Fit™ SERIES

Size Range: 3 to 10 Tons Nominal Cooling

Model Series: XYE/XXE/XQE

DIVISION 23 – HEATING, VENTILATING, AND AIR-CONDITIONING (HVAC)

Number Title

23 00 00 HEATING, VENTILATING, AND AIR-CONDITIONING (HVAC)

23 06 00 Schedules for HVAC

23 06 80 Schedules for Decentralized HVAC Equipment

23 06 80.13 Decentralized Unitary HVAC Equipment Schedule

23 06 80.13.A. Rooftop unit schedule

23 07 00 HVAC Insulation

23 07 16 HVAC Equipment Insulation

23 07 16.13 Decentralized, Rooftop Units:

23 07 16.13.A. Evaporator fan compartment:

1. Interior cabinet surfaces shall be insulated with a minimum 1/2- in. thick, minimum 1 1/2 lb density, flexible fiberglass insulation coated on the air side.

2. Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation.

23 07 16.13.B. Gas heat compartment:

1. Aluminum foil- faced fiberglass insulation shall be used.

2. Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation.

23 09 00 Instrumentation and Control for HVAC

23 09 13 Instrumentation and Control Devices for HVAC

23 09 13.23 Sensors and Transmitters

23 09 13.23.A. Thermostats

1. Thermostat must
 - a. energize "G" when calling for fan only or continuous fan.
 - b. have capability to energize 2 different stages of cooling, and 2 different stages of heating.
 - c. include capability for occupancy scheduling.

23 09 23 Direct-digital Control system for HVAC

23 09 23.13 Decentralized, Rooftop Units:

23 09 23.13.A. Smart Equipment™ (Unit based microprocessor control)

1. Shall be ASHRAE 62- 2001 compliant.
 2. Shall include an integrated economizer controller to support an economizer with 2 to 10 v DC actuator input.
 3. Controller shall accept the following inputs: space temperature, setpoint adjustment, outdoor air temperature, indoor air quality, outdoor air quality, indoor relative humidity, compressor lockout, fire shutdown, enthalpy, fan status, remote time clock/door switch.
 4. Shall accept a CO₂ sensor in the conditioned space, and be Demand Control Ventilation ready.
 5. Unit shall provide surge protection for the controller through a circuit breaker.
 6. Shall have an LED display independently showing the status of activity on the communication bus, and processor operation.
 7. Software upgrades will be accomplished by local download. Software upgrades through chip replacements are not allowed.
- A. Unit shall be complete with self-contained low-voltage control circuit protected by a resettable circuit breaker on the 24-volt transformer side.
 - B. Unit shall incorporate a lockout circuit which provides reset capability at the space thermostat or base unit should any of the following standard safety devices trip and shut off compressor:
 - C. Loss-of-charge/Low-pressure switch.
 - D. High-pressure switch.
 - E. Freeze-protection temperature sensor, evaporator coil. If any of the above safety devices trip, an LED (light-emitting diode) indicator shall flash a diagnostic code that indicates which safety switch has tripped.
 - F. Unit shall incorporate "AUTO RESET" compressor over temperature, over current protection.
 - G. Unit shall operate with conventional thermostat designs and have a low voltage terminal strip for easy hook-up.
 - H. Unit control board shall have on-board diagnostics and fault code display.
 - I. Standard controls shall include anti-short cycle and low voltage protection, and permit cooling operation down to 45 °F.
 - J. Control board shall monitor each refrigerant safety switch independently.
 - K. Control board shall retain last 5 fault codes in non-volatile memory, which will not be lost in the event of a power loss.
- 23 09 23.13.B. RTU Open - multi- protocol, direct digital controller:
1. Shall be ASHRAE 62- 2001 compliant.
 2. Shall include built-in protocol for BACNET, Modbus, and Johnson N2.
 3. Shall allow access of up to 62 network variables (SNVT). Shall be compatible with all open controllers
 4. Baud rate Controller baud rate setting shall be selected in the Smart Equipment control.
 5. Shall have an LED display independently showing the status of serial communication, running, errors, power, all digital outputs, and all analog inputs.

6. Shall accept the following inputs: space temperature, setpoint adjustment, outdoor air temperature, indoor air quality, outdoor air quality, compressor lock- out, fire shutdown, enthalpy switch, and fan status/filter status/ humidity/ remote occupancy.
7. Software upgrades will be accomplished by local download. No software upgrades through chip replacements are allowed.

23 09 33 Electric and Electronic Control System for HVAC

23 09 33.13 Decentralized, Rooftop Units:

23 09 33.13.A. General:

1. Shall be complete with self- contained low- voltage control circuit protected by a resettable circuit breaker on the 24- v transformer side. Transformer shall have 75VA capability.
2. Shall utilize color- coded wiring.
3. Shall include a central control terminal board to conveniently and safely provide connection points for vital control functions such as: smoke detectors, phase monitor, gas controller, economizer, thermostat, DDC control options, and low and high pressure switches.

23 09 33.23.B. Safeties:

1. Compressor over- temperature, over- current. High internal pressure differential.
2. Low- pressure switch.
 - a. Low pressure switch shall use different color wire than the high pressure switch. The purpose is to assist the installer and service technician to correctly wire and or troubleshoot the rooftop unit.
3. High- pressure switch.
 - a. High pressure switch shall use different color wire than the low pressure switch. The purpose is to assist the installer and service technician to correctly wire and or troubleshoot the rooftop unit.
4. Automatic reset, motor thermal overload protector.

23 09 93 Sequence of Operations for HVAC Controls

23 09 93.13 Decentralized, Rooftop Units:

23 09 93.13 INSERT SEQUENCE OF OPERATION

23 40 13 Panel Air Filters

23 40 13.13 Decentralized, Rooftop Units:

23 40 13.13.A. Standard filter section

1. Shall consist of factory- installed, low velocity, disposable 2" thick fiberglass filters of commercially available sizes.
2. Units can accept 2" or 4" filters and have a field convertible toolless
3. Filters shall be accessible through an access panel with toolless removal as described in the unit cabinet section of this specification (23 81 19.13.H).

23 81 19 Self- Contained Air Conditioners

23 81 19.13 Small- Capacity Self- Contained Air Conditioners

23 81 19.13.A. General

1. Outdoor, rooftop mounted, electrically controlled, heating and cooling unit utilizing a fully hermetic scroll compressor(s) for cooling duty and gas combustion for heating duty.
2. Factory assembled, single- piece heating and cooling rooftop unit. Contained within the unit enclosure shall be all factory wiring, piping, controls, and special features required prior to field start- up.
3. Unit shall use environmentally sound, R-410A refrigerant.

4. Unit shall be installed in accordance with the manufacturer's instructions.
5. Unit must be selected and installed in compliance with local, state, and federal codes.

23 81 19.13.B. Quality Assurance

1. Unit meets ASHRAE 90.1 minimum efficiency requirements.
2. XYE units are Energy Star certified.
3. Unit shall be rated in accordance with AHRI Standards 210/240 or 340/360.
4. Unit shall be designed to conform to ASHRAE 15, 2001.
5. Unit shall be UL- tested and certified in accordance with ANSI Z21.47 -2012/CSA 2.3-2012, CSA C22.2 No. 236-11 (UL 1995) 4th edition and CSA C22.2 No. 3 - M 1988.
6. Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation.
7. Unit casing shall be capable of withstanding 1000- hour salt spray exposure per ASTM B117 (scribed specimen).
8. Unit shall be designed in accordance with ISO 9001, and shall be manufactured in a facility registered by ISO 9001.
9. Roof curb shall be designed to conform to NRCA Standards.
10. Unit shall be subjected to a completely automated run test on the assembly line. The data for each unit will be stored at the factory, and must be available upon request.
11. Unit shall be designed in accordance with UL Standard 1995 Fourth Edition, including tested to withstand rain.
12. Unit shake tested to assurance level 1, ASTM D4169 to ensure shipping reliability.
13. High Efficient Motors listed shall meet section 313 of the Energy Independence and Security Act of 2007 (EISA 2007).

23 81 19.13.C. Delivery, Storage, and Handling

1. Unit shall be stored and handled per manufacturer's recommendations.

23 81 19.13.E. Project Conditions

1. As specified in the contract.

23 81 19.13.F. Operating Characteristics

1. Unit shall be capable of starting and running at 125° F (52° C) ambient outdoor temperature, meeting maximum load criteria of AHRI Standard 210/240 or 340/360 at ± 10% voltage.
2. Compressor with standard controls shall be capable of operation down to 40° F (4° C), ambient outdoor temperatures. See below for head pressure control package or winter start kit.
3. Unit shall discharge supply air vertically or horizontally as shown on contract drawings.
4. Unit shall be factory configured for vertical supply & return configurations.
5. Unit shall be field convertible from vertical to horizontal airflow on all models.
6. Unit shall be capable of mixed operation: vertical supply with horizontal return or horizontal supply with vertical return.

23 81 19.13.G. Electrical Requirements

1. Main power supply voltage, phase, and frequency must match those required by the manufacturer.

23 81 19.13.H. Unit Cabinet

1. **Unit cabinet shall be constructed of galvanized steel with exterior surfaces coated with a non-chalking, powder paint finish, certified at 1000 hour salt spray test per ASTM-B117 standards.**
2. Evaporator fan compartment interior cabinet insulation shall conform to AHRI Standards 210/240 or 340/360 minimum exterior sweat criteria. Interior surfaces shall be insulated with a minimum 1/2- in. thick, 1 1/2 lb density, flexible fiberglass insulation, neoprene coated on the air side. Aluminum foil- faced fiberglass insulation shall be used in the electric heat compartment. Fan shall be a direct drive or belt drive assembly and include an adjustable pitch motor pulley. Job site selected brake horsepower shall not exceed the motors

nameplate horsepower rating plus the service factor (Only premium efficiency motors have hp rating on the nameplate). Units shall be designed to operate within the service factor. Fan wheel shall be double inlet type with forward curve blades, dynamically balanced to operate smoothly throughout the entire range of operation. Airflow design shall be constant volume. Bearings shall be sealed and permanently lubricated for longer life and no maintenance.

Condenser Fan Assembly: The outdoor fans shall be of the direct drive type, discharge air vertically, have aluminum blades riveted to corrosion resistant steel spider brackets and shall be dynamically balanced for smooth operation. The outdoor fan motors shall have permanently lubricated bearings internally protected against overload conditions and staged independently.

3. Base of unit shall have a minimum of four locations for thru- the- base gas and electrical connections (field installed), standard.
4. Base Rail
 - a. Unit shall have base rails on a minimum of 4 sides.
 - b. Holes shall be provided in the base rails for rigging shackles to facilitate maneuvering and overhead rigging.
 - c. Holes shall be provided in the base rail for moving the rooftop by fork truck.
 - d. Base rail shall be a minimum of 16 gauge thickness.
5. Condensate pan and connections:
 - a. Shall be an internally sloped condensate drain pan made of a non- corrosive material.
 - b. Shall comply with ASHRAE Standard 62.
 - c. Shall use a 3/4" - 14 NPT drain connection, possible either through the bottom or side of the drain pan. Connection shall be made per manufacturer's recommendations.
6. Top panel:
 - a. Shall be a single piece top panel.
7. Electrical Connections
 - a. All unit power wiring shall enter unit cabinet at a single, factory- prepared, knockout location.
 - b. Thru- the- base capability.
 - (1.) Standard unit shall have a thru- the- base electrical location (s) using a raised, embossed portion of the unit base-pan.
 - (2.) Optional, factory- approved, water- tight connection method must be used for thru- the- base electrical connections.
 - (3.) No base-pan penetration, other than those authorized by the manufacturer, is permitted.
8. Component access panels (standard)
 - a. Cabinet panels shall be easily removable for servicing.
 - b. Unit shall have one factory installed, toolless, removable, filter access panel.
 - c. Panels covering control box, indoor fan, indoor fan motor, gas components (where applicable), and compressors shall have a molded composite handles.
 - d. Handles shall be UV modified, composite. They shall be permanently attached, and recessed into the panel.
 - e. Screws on the vertical portion of all removable access panel shall engage into heat resistant, molded composite collars.
 - f. Collars shall be removable and easily replaceable using manufacturer recommended parts.

23 81 19.13.J. Coils

1. Standard Aluminum Fin/Copper Tube Coils:
 - a. Standard evaporator and condenser coils shall have aluminum lanced plate fins mechanically bonded to seamless internally grooved copper tubes with all joints brazed.

- b. Evaporator coils shall be leak tested to 150 psig, pressure tested to 450 psig, and qualified to CSA C22.2 No. 236-11 (UL 1995) 4th edition burst test at 1775 psig.
 - c. Condenser coils shall be leak tested to 150 psig, pressure tested to 650 psig, and qualified to CSA C22.2 No. 236-11 (UL 1995) 4th edition burst test at 1980 psig.
2. Optional E-Coat- coated aluminum- fin evaporator and condenser coils:
- a. Shall have a durable epoxy- phenolic coating to provide protection in mildly corrosive coastal environments.
 - b. Coating shall be applied to the aluminum fin stock prior to the fin stamping process to create an inert barrier between the aluminum fin and copper tube.
 - c. Epoxy- phenolic barrier shall minimize galvanic action between dissimilar metals.

23 81 19.13.K. Refrigerant Components

1. Refrigerant circuit shall include the following control, safety, and maintenance features:
 - a. Thermostatic Expansion Valve (TXV) shall help provide optimum performance across the entire operating range. Shall contain removable power element to allow change out of power element and bulb without removing the valve body. (Orifice on 3-5 Ton Units)
 - b. Refrigerant filter drier - Solid core design.
 - c. Service gauge connections on suction and discharge lines.
 - d. Pressure gauge access through a specially designed access port in the top panel of the unit.
2. There shall be gauge line access port in the skin of the rooftop, covered by a black, removable plug.
 - a. The plug shall be easy to remove and replace.
 - b. When the plug is removed, the gauge access port shall enable maintenance personnel to route their pressure gauge lines.
 - c. This gauge access port shall facilitate correct and accurate condenser pressure readings by enabling the reading with the compressor access panel on.
 - d. The plug shall be made of a leak proof, UV- resistant, composite material.
3. Compressors
 - a. Unit shall use fully hermetic, scroll compressor for each independent refrigeration circuit.
 - b. Compressor motors shall be cooled by refrigerant gas passing through motor windings.
 - c. Compressors shall be internally protected from high discharge temperature conditions.
 - d. Compressors shall be protected from an over- temperature and over- amperage conditions by an internal, motor overload device.
 - e. Compressor shall be factory mounted on rubber grommets.
 - f. Compressor motors shall have internal line break thermal, current overload and high pressure differential protection.
 - g. Crankcase heaters shall not be required for normal operating range, unless provided by the factory.

23 81 19.13.L. Filter Section

1. Filters access is specified in the unit cabinet section of this specification.
3. Shall consist of factory- installed, low velocity, throw- away 2" thick fiberglass filters.
3. Units can accept 2" or 4" filters and have a field convertible toolless

23 81 19.13.M. Evaporator Fan and Motor

1. Evaporator fan motor:
 - a. Shall have permanently lubricated bearings.
 - b. Shall have inherent automatic reset thermal protection (Only on single-phase, belt-drive motors, three - phase, belt-drive motors have internal thermostat used for external line-break control.).
2. Electric Drive (Direct Drive) X13 – 5 Speed/Torque Evaporator Fan:
 - a. Multi- speed motor with easy quick adjustment settings.

- b. Blower fan shall be double- inlet type with forward- curved blades.
 - c. Shall be constructed from steel with a corrosion resistant finish and dynamically balanced.
3. Belt- driven Evaporator Fan:
- a. Belt drive shall include an adjustable- pitch motor pulley.
 - b. Shall use sealed, permanently lubricated ball- bearing type.
 - c. Blower fan shall be double- inlet type with forward- curved blades.
 - d. Shall be constructed from steel with a corrosion resistant finish and dynamically balanced.

23 81 19.13.N. Condenser Fans and Motors

The outdoor fans shall be of the direct drive type, discharge air vertically, have aluminum blades riveted to corrosion resistant steel spider brackets and shall be dynamically balanced for smooth operation. The outdoor fan motors shall have permanently lubricated 60°C ball bearings internally protected against overload conditions and staged independently.

1. Condenser fan motors:
 - a. Shall be a totally enclosed motor.
 - b. Shall use permanently lubricated bearings.
 - c. Shall have inherent thermal overload protection with an automatic reset feature.
 - d. All models shall use a shaft- down design.
2. Condenser Fans:
 - a. Shall be a direct- driven propeller type fan.
 - b. Shall have galvanized steel blades riveted to corrosion- resistant steel spiders and shall be dynamically balanced.

23 81 19.13.O. Special Features Options and Accessories

1. Standard Integrated Economizers:
 - a. Integrated, gear- driven opposing modulating blade design type capable of simultaneous economizer and compressor operation.
 - b. Independent modules for vertical or horizontal return configurations shall be available. Vertical return modules shall be available as a factory installed option.
 - c. Damper blades shall be galvanized steel with composite gears. Plastic or composite blades on intake or return shall not be acceptable.
 - d. Shall include all hardware and controls to provide free cooling with outdoor air when temperature and/or humidity are below set-points.
 - e. Shall be equipped with gear driven dampers for both the outdoor ventilation air and the return air for positive air stream control.
 - f. Standard models shall be equipped with low- leakage dampers, not to exceed 2% leakage at 1 in. wg pressure differential. Economizers will come with Actuator and module that is tied to Smart Equipment™:
 - (1.) Combined minimum and DCV maximum damper position potentiometers with compressor staging relay.
 - (2.) Functions with solid state analog enthalpy or dry bulb changeover control sensing.
 - (3.) Contain LED indicates for: when free cooling is available when module is in DCV mode when exhaust fan contact is closed
2. Two- Position Damper
 - a. Damper shall be a Two- Position Damper. Damper travel shall be from the full closed position to the field adjustable %- open setpoint.
 - b. Damper shall include adjustable damper travel from 25% to 100% (full open).
 - c. Damper shall include single or dual blade, gear driven dampers and actuator motor.
 - d. Actuator shall be direct coupled to damper gear. No linkage arms or control rods shall be acceptable. e. Damper will admit up to 100% outdoor air for applicable rooftop units.

- f. Damper shall close upon indoor (evaporator) fan shutoff and/or loss of power.
 - g. The damper actuator shall plug into the rooftop unit's wiring harness plug. No hard wiring shall be required.
 - h. Outside air hood shall include aluminum water entrainment filter.
3. Manual damper
- a. Manual damper package shall consist of damper, air inlet screen, and rain hood which can be preset to admit up to 25 or 50% outdoor air for year round ventilation.
4. Condenser Coil Hail Guard Assembly (Factory and Field installed on all models):
- a. Shall protect against damage from hail.
 - b. Shall be of louvered style.
5. Unit- Mounted, Non- Fused Disconnect Switch:
- a. Switch shall be factory- installed, internally mounted.
 - b. National Electric Code (NEC) and UL approved non- fused switch shall provide unit power shutoff.
 - c. Shall be accessible from outside the unit.
 - d. Shall provide local shutdown and lockout capability.
6. Thru- the- Base Connectors:
- a. Kits shall provide connectors to permit gas and electrical connections to be brought to the unit through the unit base-pan.
 - b. Minimum of four connection locations per unit.
7. Propeller Power Exhaust:
- a. Power exhaust shall be used in conjunction with an integrated economizer.
 - b. Independent modules for vertical or horizontal return configurations shall be available.
 - c. Horizontal power exhaust shall be mounted in return ductwork.
 - d. Power exhaust shall be controlled by economizer controller operation. Exhaust fans shall be energized when dampers open past the 0- 100% adjustable setpoint on the economizer control.
8. Roof Curbs (Vertical):
- a. Full perimeter roof curb with exhaust capability providing separate air streams for energy recovery from the exhaust air without supply air contamination.
 - b. Formed galvanized steel with wood nailing strip and shall be capable of supporting entire unit weight.
 - c. Permits installation and securing of ductwork to curb prior to mounting unit on the curb.
9. Outdoor Air Enthalpy Sensor:
- a. The outdoor air enthalpy sensor shall be used to provide single enthalpy control. When used in conjunction with a return air enthalpy sensor, the unit will provide differential enthalpy control. The sensor allows the unit to determine if outside air is suitable for free cooling.
10. Return Air Enthalpy Sensor:
- a. The return air enthalpy sensor shall be used in conjunction with an outdoor air enthalpy sensor to provide differential enthalpy control.
11. Indoor Air Quality (CO₂) Sensor:
- a. Shall be able to provide demand ventilation indoor air quality (IAQ) control.
 - b. The IAQ sensor shall be available in duct mount, wall mount, or wall mount with LED display. The set- point shall have adjustment capability.
 - c. Shall be environmental compensated with differential sensing for reliable, stable, and drift- free sensitivity.
 - d. Shall use magnet- activated test/reset sensor switches.
 - e. Shall have tool- less connection terminal access.